



## INSTALLATION, COMMISSIONING, OPERATION & MAINTENANCE INSTRUCTIONS

### Green Frog

200kVA 33kV 415V 3PH (1500A FOR 30S)  
EARTHING AUXILIARY TRANSFORMER

**MANUAL NUMBER:** **MM0733**  
**ISSUE 0**

**TRANSFORMER SPECIFICATION:** **0105592**

**CUSTOMER ORDER NUMBER:** **7900-282**

**SERIAL NUMBERS:** **103723/1-01**

# REVISION RECORD

Revision	ECN	Change	Author	Date
0	-	First Issue	A.K	04/04/2023

1.0Description

- 1.1 Preface
- 1.2 Technical Description
- 1.3 Detailed Description

2.0Installation Instructions

- 2.1 Introduction
- 2.2 Methods of Dispatch
- 2.3 Unpacking & Examinations
- 2.4 Handling
- 2.5 Storage
- 2.6 Location
- 2.7 Foundation & Connections

3.0Commissioning Instructions

- 3.1 General
- 3.2 Pre-Commissioning Checks
- 3.3 Current Transformers
- 3.4 Buchholz Relay
- 3.5 Pressure Relief Device
- 3.6 De-Hydrating Breather
- 3.7 L.V. Fuse Switch
- 3.8 Paintwork

4.0Operating Instructions

- 4.1 Unit Isolation
- 4.2 Vector Link Connection Change

5.0Maintenance Instructions

- 5.1 Oil Sampling
- 5.2 Equipment & Devices
- 5.3 L.V. Fuse Switch
- 5.4 General
- 5.5 Torque Settings
- 5.6 Spill Management
- 5.7 Recommended Spares
- 5.8 Disposal

6.0Drawings

- 6.1 List of Drawings

7.0Appendix A – Cooling Liquid8.0Appendix B – Buchholz Relay9.0Appendix C – Pressure Relief Device10.0Appendix D – Dehydrating Breather11.0Appendix E – L.V. Fuse Switch12.0Appendix F – Paint Specification

# SECTION 1

## DESCRIPTION



## 1.1 Preface

The transformer manufactured by **iST POWER Ltd** is supplied as follows:

The neutral earthing & auxiliary transformer is a 3-Phase, outdoor, liquid cooled transformer for 33kV 50Hz 3-Phase supply. The active part is split with separate earthing and auxiliary transformers contained in one tank. The secondary output voltage is 415V 3-Phase.

## 1.2 Technical Description

Type	Liquid cooled, double wound neutral earthing and auxiliary transformer.
Cooling	ONAN (Nynas Nitro Libra) to IEC 60296
Continuous Rating	200 kVA
Rated Input Voltage	33 kV
Rated Output Voltage	415 V
Rated Input Current	3.50 A
Rated Output Current	278.24 A
Neutral Fault Current	1500 A for 30 seconds
Zero Sequence Impedance	32 $\Omega$ /Phase (-0% / +20%) (The measured value on test is stamped on the rating and diagram plate).
Positive Sequence Impedance	3 % Max Limit (The measured value on test is stamped on the rating and diagram plate).
Insulation Level	AC 70kV / AC 3kV
Lighting Impulse Level	170 kV
Frequency	50 Hz
Vector Group	ZNyn1 / ZNyn11
Phases	3

## Current Transformers

### H.V. Neutral C.T. 1

Ratio: 1000/1

Class: 5P5

Burden: 2.5VA

### H.V. Neutral C.T. 2

Ratio: 2000/1

Class: PX

Internal C.T.'s fitted on the H.V. Neutral Terminal with  
2 x 1kV 250A Porcelain bushings  
inside the C.T. Test Bushings  
Enclosure.

## Input Termination

3 x 36kV 1250A

Euromold Equipment Bushing

Type-C2 Interface

(5/8" – 11UNC – 2B)

Located inside a bolted enclosed H.V.  
terminal box.

## Neutral Termination

1 x 36kV 1250A

Euromold Equipment Bushing

Type-C2 Interface

(5/8" – 11UNC – 2B)

Located inside a bolted enclosed H.V.  
terminal box.

## Output Termination

3-Pole 400A Fuse Switch

Fitted with 315A Fuses.

400A Dis-connectable Neutral and  
Earth Links fitted.

Located inside an enclosed L.V.  
terminal box with door handle  
operation.



Fittings	Rating and Diagram Plate Marshalling Box Buchholz Relay Pressure Relief Device Dehydrating Breather Earthing Terminal Conservator Tank Lifting Lugs Common Skid Base
----------	--

Weight of Core and Coils	2834 kg
--------------------------	---------

Liquid Quantity	1350 Litres
-----------------	-------------

Total Weight	5300 kg
--------------	---------

**Specification IEC 60076**

### 1.3 Detailed Description

The transformer consists of a three phase coil assembly each mounted on a core assembly.

The coils are wound from insulated copper strip conductor helically wound with ducts for cooling. The coils have been dried out prior to immersion in oil.

The stepped leg/stepped yoke cores are built up from laminations of cold rolled silicon steel. The laminations are interleaved with mitred corners and clamped with fabricated steel frames.

The transformers are contained within a fully welded steel tank with a bolted-on lid. The tank is complete with pressure relief device, drain & filter valves, conservator, Buchholz relay and dehydrating breather.

The input leads are made onto the H.V. bushings at the side of the tank inside the H.V. terminal box. Output leads are connected to the L.V. cable box located on the opposite side. It is connected via a 3-Pole 400A fuse switch and dis-connectable neutral and earth links.

The unit is filled with mineral oil. See Appendix A for Product Data Sheet and the Material Safety Data Sheet.

#### 1.3.1 Transformer Tank and Termination Boxes

The transformer tank is of sheet steel welded construction.

The H.V. lines are located at the side of the tank inside the H.V. terminal box, behind a bolted access cover. The H.V. terminals are suitable for a Type-C2 bushing interface connection.

The Neutral bushing is located alongside the H.V. bushings inside the H.V. terminals box, behind a bolted access cover. The Neutral terminal is suitable for a Type-C2 bushing interface connection.

The L.V. connections are made at the L.V. cable box via a 400A fuse switch fitted with 315A fuses. See Appendix E for manufacturer details.

The L.V. links for re-connection of the transformer vector group are located behind a cover at the top of the L.V. cable box. See Section 4.2 for details.

### 1.3.2 Auxiliary Equipment

The transformer is fitted with the following equipment: -

- 1) Buchholz Relay with alarm and trip contacts.
- 2) Pressure Relief Device with alarm/trip contacts mounted on the tank side with a duct to direct any expelled oil towards ground level.

Other fittings include removable cable gland plates, oil filter and drain valves. A loose Envirogel dehydrating breather to be fitted on site is included.

SECTION  
2

INSTALLATION  
INSTRUCTIONS



## 2.1 **Introduction**

These instructions are intended to give guidance and assistance in the installation and maintenance of the liquid filled 3-Phase earthing auxiliary transformer.

## 2.2 **Method of Dispatch**

Every precaution is taken to ensure that the equipment will arrive at its destination in perfect condition.

The units are dispatched completely assembled, and tested on dedicated road transport.

## 2.3 **Unpacking and Examination Upon Arrival**

Immediately upon arrival the equipment should be thoroughly examined externally. Any damage should be reported at once to the Carrier and to **iST POWER Ltd** quoting the Advice Note details to enable a claim to be lodged with the responsible party. Any deficiencies of material should also be notified to the Carrier and to **iST POWER Ltd** immediately.

## 2.4 **Handling**

When lifting the equipment use the lifting points, painted yellow, with the correct lifting slings through each lifting point. Great care must be taken not to knock or damage the equipment. Lifting weight of complete unit is 5300kg. Jacking lugs are provided on each side.

## 2.5 **Storage**

The unit is suitable for storing outdoors, if required, until commissioned.

## 2.6 **Location**

As this equipment is static, the location is of course fixed. Care must be taken to protect the unit from severe environments i.e., pollution from active chemicals, hot air blasting unit or any elements not deemed normal. The unit is dispatched full of oil to operating level sealed for use outdoors with heavy duty paint finish.

## 2.7 Foundation and Connections

- The equipment must be mounted on a flat level foundation.
- Anti-vibration pads are provided to mount between the transformer base and the concrete plinth. The pads must be arranged as detailed on DWG.015364.
- The H.V. leads are connected to the terminals ZN, A4, B4, C4. Refer to Section 6.1 for details and illustrations.
- Neutral connection is made to the ZN terminal. Refer to Section 6.1 for details and illustrations.
- The L.V. connection leads to the output should be taken through cable entries provided by others and the connections fastened securely to the terminals of the fuse switch. Approved glands and cable terminations should be used. Ensure the internal earth connections to the gland plate and the box cover are made and secure.
- Ensure that an efficient earth connection is made to the earth pad terminals on the tank. Each earth pad is coated with a rust proofing grease, 3M Molykote 111, to provide long term protection against corrosion. If this is removed or damaged during installation, then it should be recoated with the same or similar grease.
- The transformer breather is shipped as a loose item with the transformer. This will be attached to the outside of the transformer or be inside the L.V. switch box. There will also be a copy of the breather fitting instructions.

To attach the breather, it is necessary to remove the  $\frac{3}{4}$ " BSP cap from the end of the breather tube. During transport, a small quantity of oil may find its way into the breather tube. This must be allowed to drain before fitting the breather to prevent the breather material being contaminated. To prevent a spillage of oil, position a 5-litre container beneath the breather tube before removing the end cap. Dispose of any oil in an approved manner.

Screw the breather onto the end of the breather pipe. The breather must be fitted in accordance with the manufacturer instruction leaflet.

See Appendix D for the breather details and the fitting instruction leaflet.

# COMMISSIONING INSTRUCTIONS

## SECTION 3



### 3.1 General

Check the equipment for any obvious signs of damage, loose items and contamination by water or other substances. Check the oil level.

### 3.2 Pre-Commissioning Checks

The following electrical tests should be carried out on the equipment.

**NOTE Testing must be carried out by a suitably qualified and experienced test engineer.**

**Under no circumstances must any H.V. testing be carried out on the transformer without the H.V. connections being fitted.**

**Testing without these fittings may result in irreparable damage to the transformer bushings.**

#### 3.2.1 Ratio Measurement

Using a proprietary Transformer Ratiometer, check the transformer ratio. Compare the results with the values given in the test certificate.

#### 3.2.2 Resistance Measurement

With the transformer isolated, measure the resistance of the windings. Compare with results in test certificate.

#### 3.2.3 Insulation Resistance Measurement

With the transformer isolated the insulation resistance should be measured.

1. Measured with a 2500V Megger the following are minimum insulation resistance values.
  - a) Transformer Windings to Earth 200MΩ.
  - b) Primary Winding to Secondary Windings 500MΩ.
2. With a 500V Megger, check the auxiliary wiring to earth. The minimum value of resistance should be 10MΩ.
3. Reconnect all leads.



### 3.3 **Current Transformer**

Using the test bushings inside the C.T. test bushings enclosure, connect the C.T. analyser accordingly (to T1 and T2 terminals). The tests that should be carried out are as follow:

- Ratio (no deviation)
- Insulation test
- Saturation point

### 3.4 **Buchholz Relay**

A Buchholz relay type BS50LA is fitted in the pipework between the conservator and the main tank. This gas detection device is fitted with normally open switches factory set.

See Appendix B for manufacturer details.

### 3.5 **Pressure Relief Device**

An auto re-setting pressure relief device is mounted on the main tank lid. It is set to release any pressure built up above 5.8PSI (0.4 atmospheres). A change-over contact indicates operation.

Operation of this device is usually an indication of major failure with the tank.

See Appendix C for manufacturer details.

### 3.6 **De-Hydrating Breather**

Desiccant breather charges must be checked on a regular basis in accordance with the manufacturers instructions supplied in this manual. We recommend that the condition of the gel should be checked every 12 months.

Refer to Appendix D for manufacturer details.

### 3.7 **L.V. Fuse Switch**

The L.V. fuse switch is a 3-Pole 400A unit fitted with 315A fuse links. The neutral and earth are separate bolted links.

Refer to Appendix E for manufacturer details.

**3.8****Paintwork**

The exterior paintwork should be inspected, and any damage caused through transport, installation or commissioning should be made good immediately.

The final colour is Dark Admiralty Grey to BS381C Shade 632. The corrosion protection is rated at C4(H) in accordance with ISO 12944 (iST POWER Ltd Paint Specification 704-60210).

See Appendix F for details.

# SECTION 4

# OPERATING INSTRUCTIONS




## 4.1 Unit Isolation

The transformer has no inherent means of input isolation. The supply to the transformer of 33kV 3-Phase must therefore be isolated remotely and the terminals earthed.

**NOTE** Isolate all supplies prior to working on this equipment.

## 4.2 Vector Link Connection Change

The vector group can be changed between ZNyn1 and ZNyn11 using the copper busbar links located behind the L.V. cable box top panel. A sticker (shown below) affixed on a Perspex cover illustrates the desired arrangements.

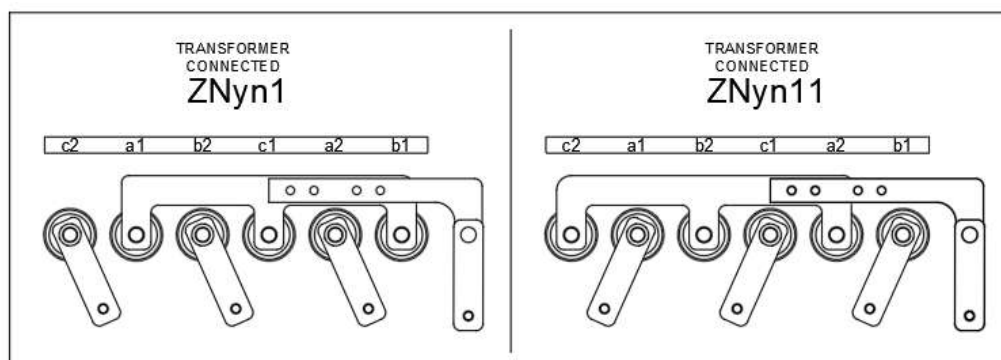

SECTION  
5

MAINTENANCE  
INSTRUCTIONS



**NOTE** Maintenance must only be carried out when the equipment has been totally isolated.

## 5.1 Oil Sampling

The insulating liquid is uninhibited mineral oil (Nynas Nitro Libra). See Appendix A for the data sheets. Oil samples should be taken via the sampling valve according to the attached schedule.

Following commissioning, oil samples should be taken at the following intervals: -

- a) after 6 months
- b) after 12 months
- c) after 60 months
- d) thereafter every 5 years

The samples should have physical analysis, DGA, water content and breakdown strength measured and recorded for on-going monitoring. Any trend that indicates a deterioration of the transformer should be noted and the frequency of sampling increased as required.

After taking any oil sample, check that the liquid level is correct via the liquid level gauge. Taking a liquid sample will remove 2.5 - 3 litres of oil.

**NOTE** Replace or top up with Uninhibited Mineral Oil to IEC 60296.

## 5.2 Equipment & Devices

### 5.2.1 Buchholz Relay

The Buchholz Relay is fitted with set alarm and trip relays. These contacts should be checked every 12 months for correct operation. See Appendix B for manufacturer documents.

### 5.2.2 Pressure Relief Device

The P.R.D. does not require maintenance during the life of the transformer. However, it is advisable that contacts be checked every 12 months for correct operation of the switch only. See Appendix C for manufacturer documents.

### 5.2.3 Desiccant Breather

The breather does not require maintenance. However, it will need replacing as the silica gel ages and loses its dehydrating properties. See Appendix D for details and manufacture documents.

### 5.3 L.V. Fuse Switch

The L.V. Fuse Switch requires no maintenance.

Refer to Appendix E for details.

### 5.4 General

The housing of the pressure relief device, L.V. fuse switch and marshalling equipment should be checked for ingress of water or debris every 12 months and vacuumed/cleaned out as necessary.

The paintwork should be touched up where required.

The transformer liquid level should be checked in the sight glass. The level will be affected by the ambient temperature and the operating load on the transformer.

The whole transformer should be checked for oil leaks.

## 5.5 Torque Settings

Maximum tightening torque settings for threaded metric **Steel Grade 8.8** nut and bolt. Threads are to be lightly lubricated.

Bolt Size	Approximate Torque (Nm)	
	No Gasket	6mm Gasket
M6	8	5
M8	20	13
M10	40	26
M12	70	45
M16	175	113
M20	341	219

## 5.6 Spill Management

### 5.6.1 Personal precautions

Spilt product can constitute a slip hazard. Avoid contact with skin and eyes.

### 5.6.2 Environmental precautions

In the event of a large spillage, clean as thoroughly as possible and contact local authority. Avoid flushing into drains.

### 5.6.3 Cleaning procedures

Use an inert absorbent material (e.g. sand, oil absorbent granules, etc.) and place in labelled containers. Product and packaging must be disposed of in accordance with local and national regulations.



## 5.7 Recommended Spares

Due to the nature of the product, there are very few items that will degrade during the lifespan of the transformer. The only item that will require replacement is the desiccant breather charge. The correct item for the transformer is listed below:

Transformer  
200 kVA

Breather Charge  
Brownell Type R1

The waste parts must be disposed of in a suitable manner in accordance to environmental regulations.

## 5.8 Disposal


Disposal of this equipment at the end of its operational life must be in accordance with the environmental legislation in force at the time of disposal.

The transformer is constructed in such a way that the different components can easily be recycled at the end of its life span. However, the components can only be recycled after the cooling liquid has been drained. The liquid should be drained and disposed of by a specialist waste contractor in accordance with local regulations.

**NOTE      The transformer does not contain any PCBs, PCTs, PCBTs or asbestos material. Consider using the services of a specialist recycling company who have the capacity, skills and knowledge to recycle transformers.**



# SECTION 6

# LIST OF DRAWINGS

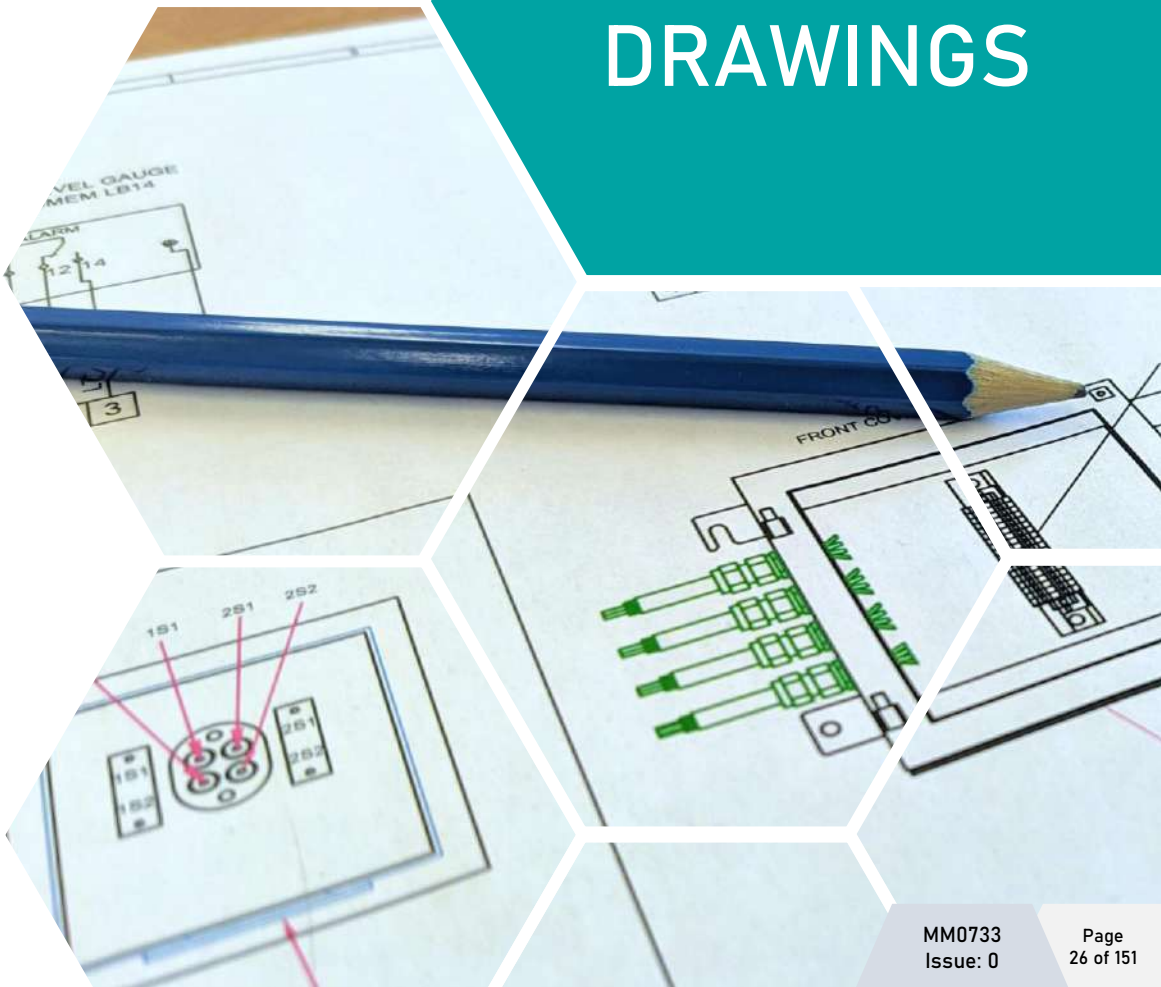

## 6.1 List of Drawings


015348	Outline Drawing
015349	Rating and Diagram Plate
015350	Auxiliary Wiring Diagram
015364	Anti-Vibration Pads Layout

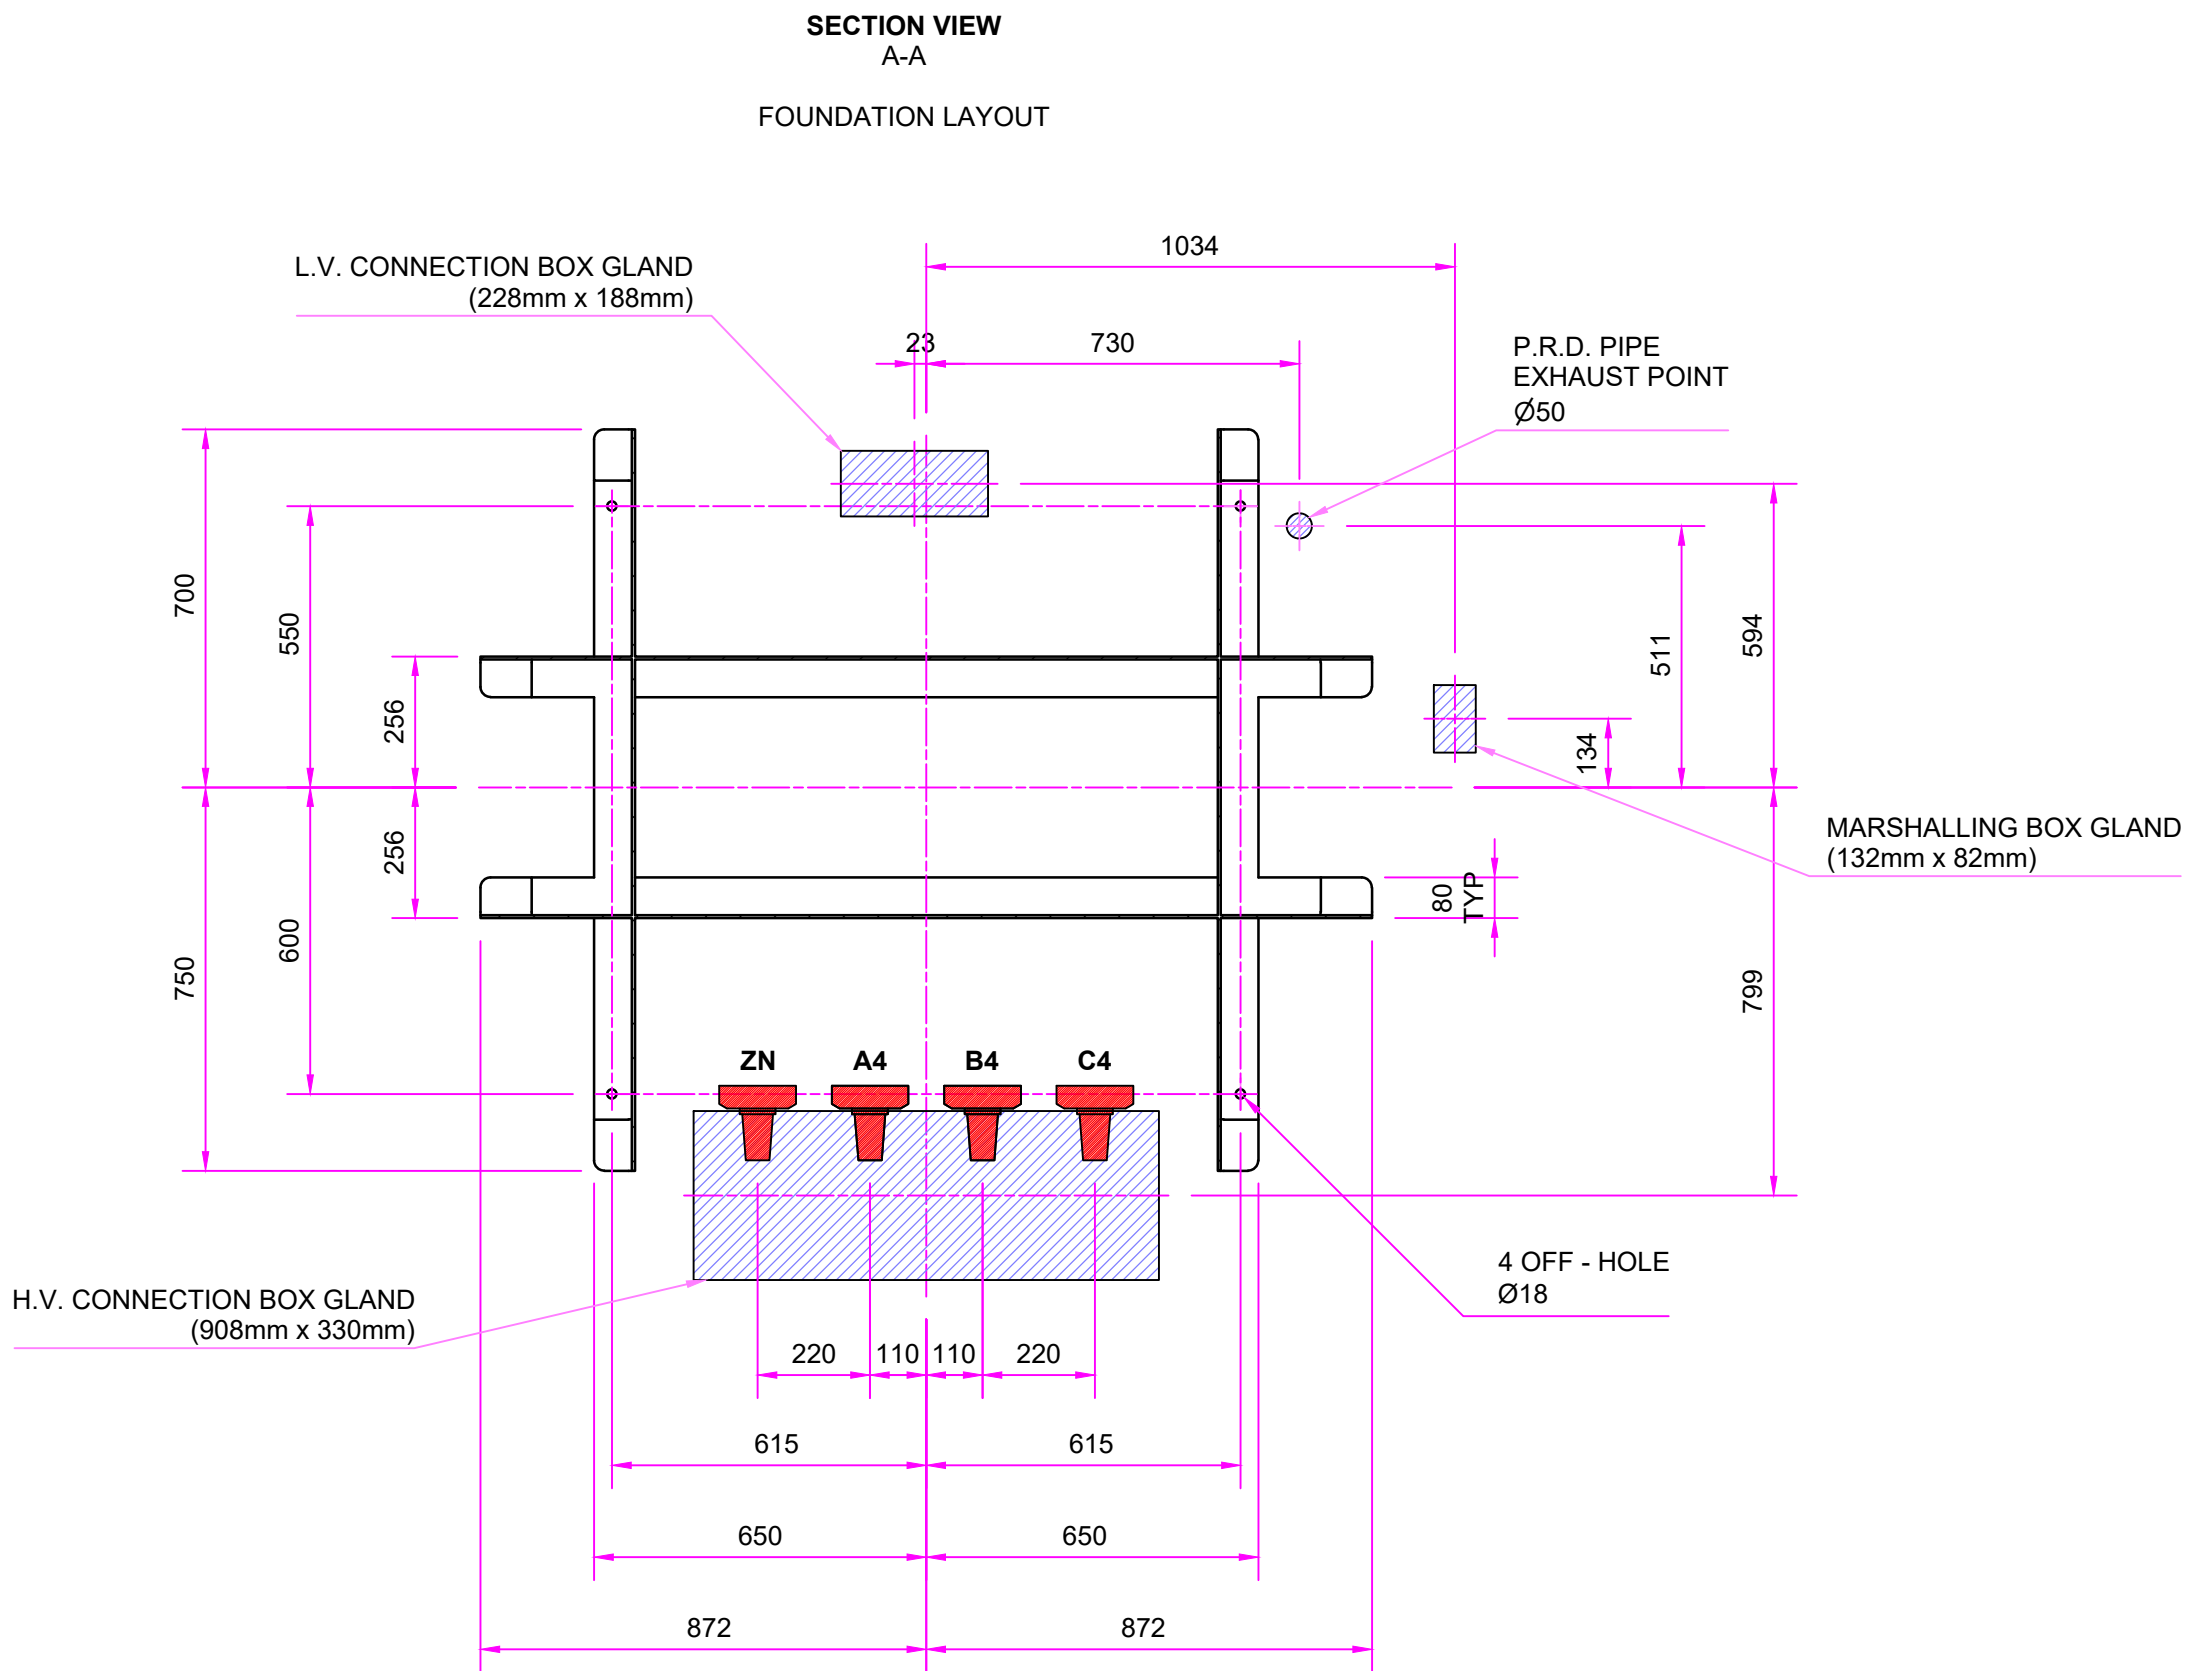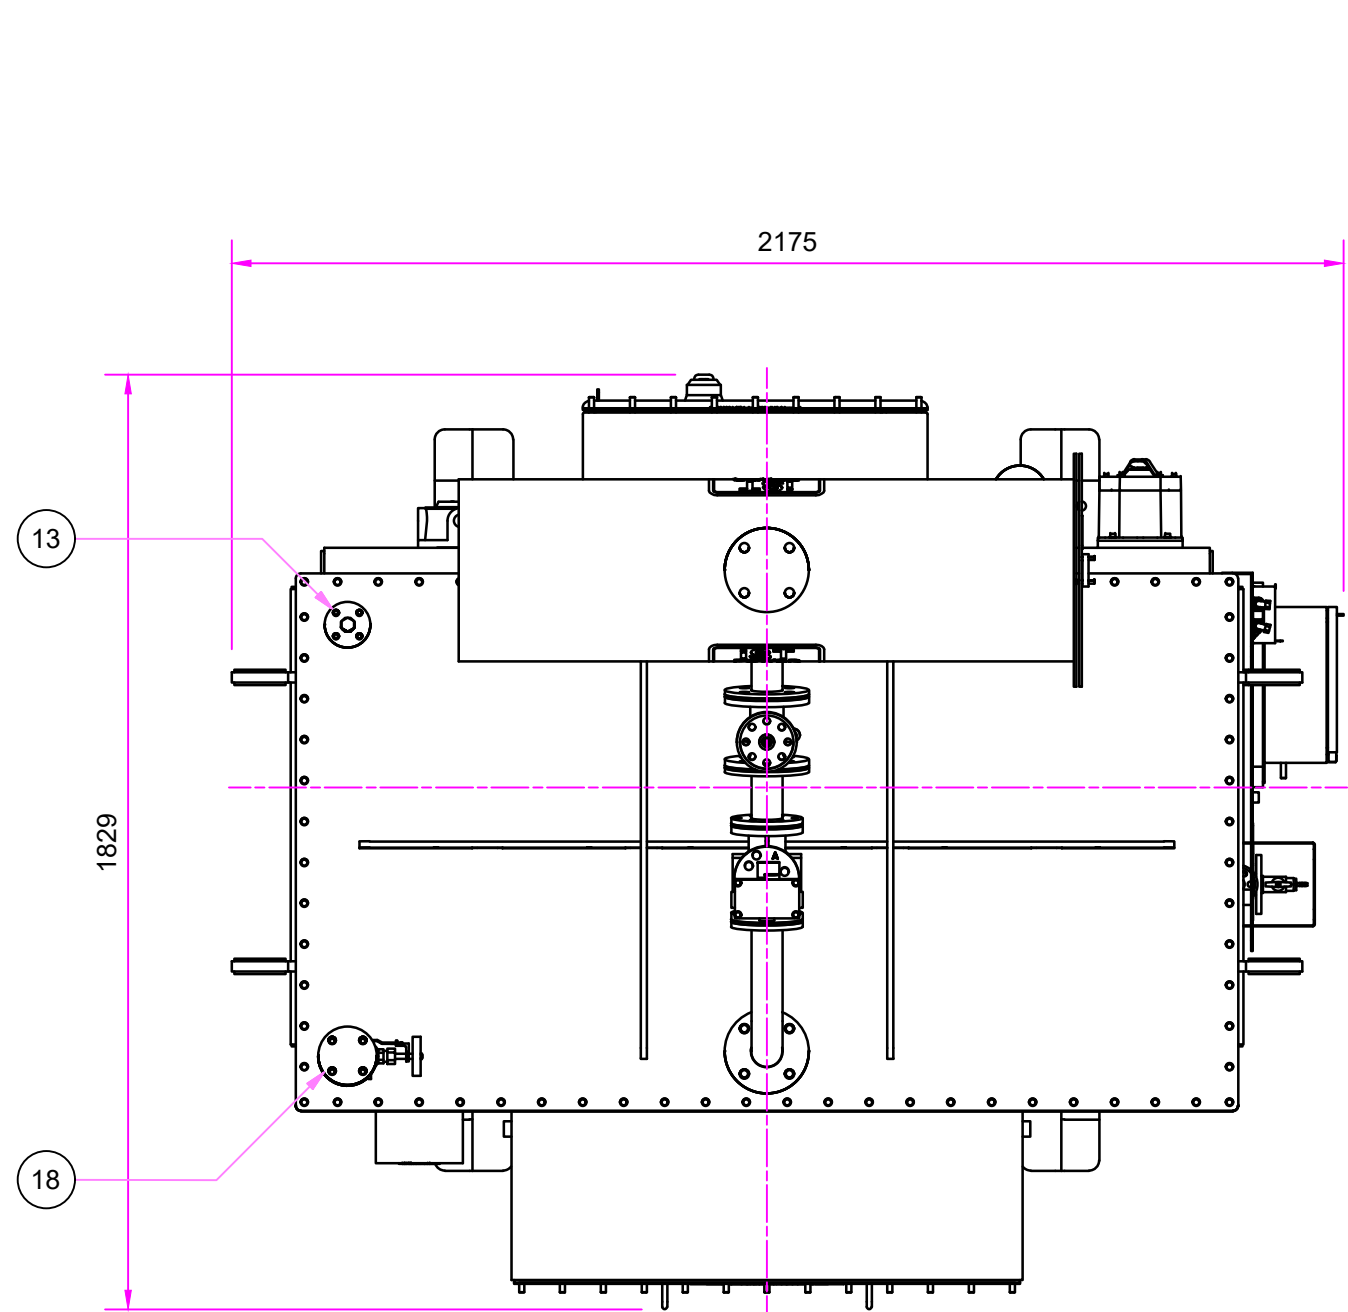


TRANSFORMER SPECIFICATION	
DESIGNED TO LIMIT THE EARTH FAULT CURRENT	1500A FOR 30s
AUXILIARY POWER	200kVA
RATED VOLTAGE	33000V / 415V
RATED CURRENT	3.50A / 278.24A
VECTOR CONNECTION	ZNyn1 / ZNyn11

APPROXIMATE MASS	
CORE & COILS	2834 kg
COOLING LIQUID 1350L (MINERAL OIL)	1310 kg
TOTAL MASS	5300 kg



PARTS LIST	
ITEM	DESCRIPTION
1	LINE & NEUTRAL TERMINALS - 36kV 1250A INTERFACE TYPE-C BUSHINGS
2	H.V. CABLES SCREEN EARTH POINT C/W M10 FASTENERS
3	400A 3-POLE FUSE SWITCH C/W 315A FUSES
4	400A DISCONNECTABLE NEUTRAL LINK
5	400A DISCONNECTABLE EARTH LINK
6	VECTOR CHANGE-OVER LINKS
7	C.T. TEST BUSHINGS ENCLOSURE
8	CORE EARTH TERMINAL
9	DE-HYDRATING BREATHING
10	BUCHHOLZ RELAY
11	PRESSURE RELIEF DEVICE C/W OIL DIRECTION DUCT
12	BUCHHOLZ PETCOCK ENCLOSURE
13	THERMOMETER POCKET
14	MARSHALLING BOX
15	CONSERVATOR COVER C/W PRISMATIC OIL GAUGE
16	CONSERVATOR
17	VALVE (DN25) - DRAIN / SAMPLING VALVE (BEHIND COVER)
18	VALVE (DN25) TOP FILTER VALVE
19	VALVE (DN25) - CONSERVATOR DRAIN VALVE
20	VALVE (DN50) - CONSERVATOR ISOLATION VALVE
21	FLANGE (DN50) - TRANSFORMER OIL FILLING POINT
22	LABEL - RATING & DIAGRAM PLATE
23	EARTH LUG (AT 2 PLACES) - 2 HOLES @ Ø14
24	LIFTER / HAULAGE POINT (AT 4 PLACES) - HOLE @ Ø40
25	JACKING POINT / HAULAGE POINT (AT 4 PLACES) - 2 HOLES @ Ø30
26	SKID UNDERBASE / HAULAGE POINT - HOLES @ Ø45

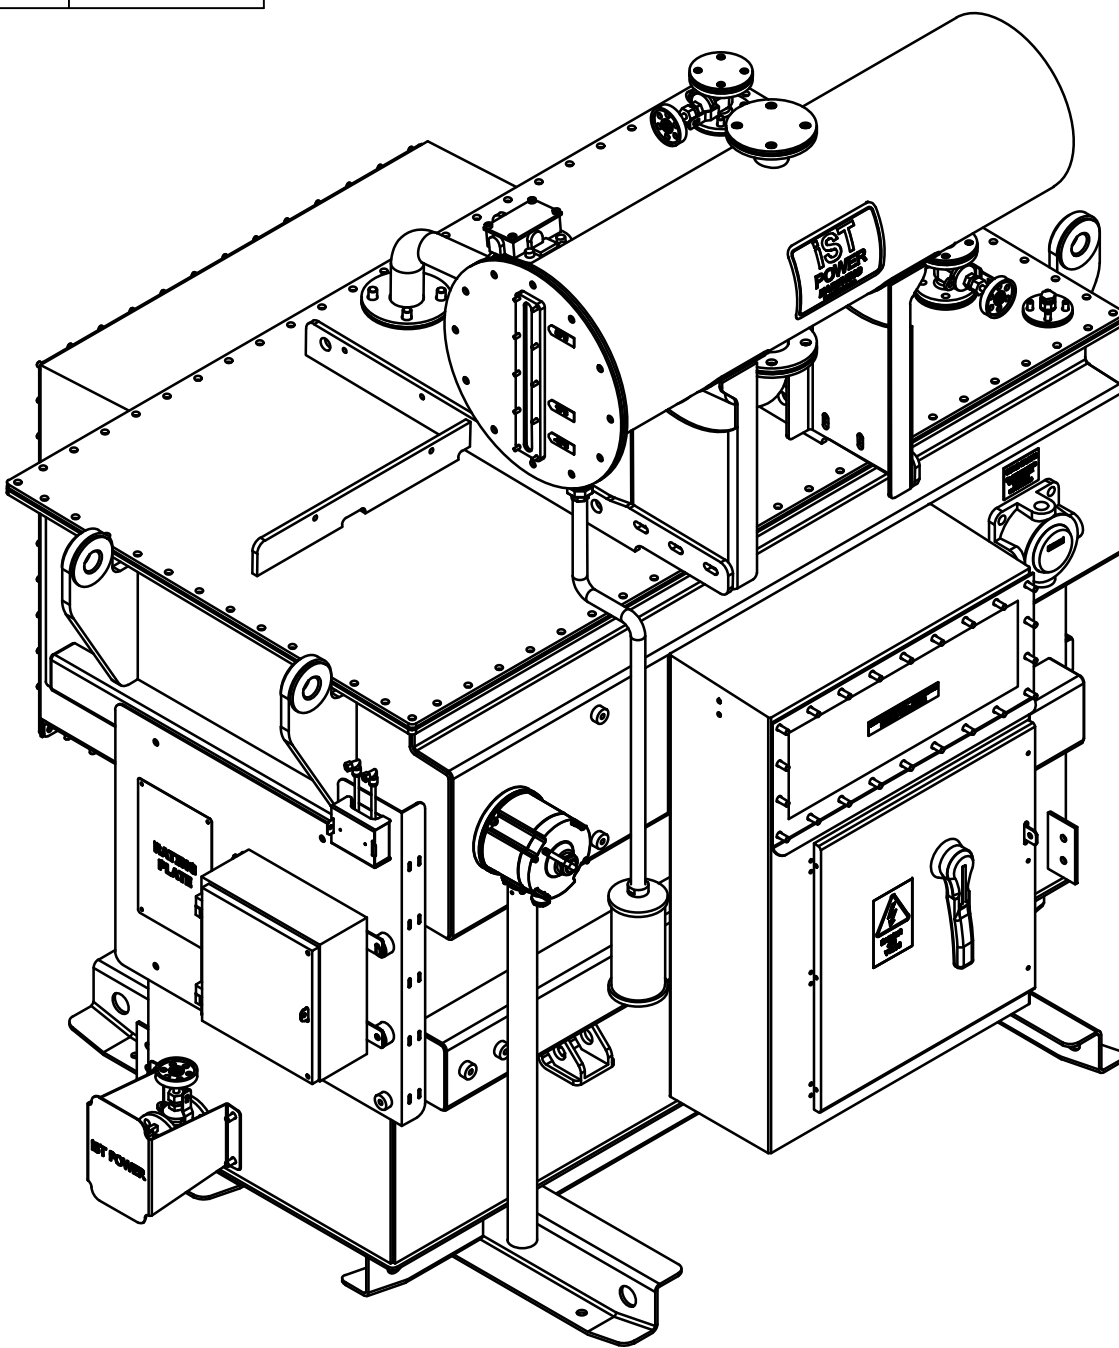


PAINT FINISH & CORROSION PROTECTION	
IST POWER PAINT SPECIFICATION	704-60210
CORROSION PROTECTION	C4(H)
FINAL COLOUR	DARK ADMIRALTY GREY TO BS381C SHADE 632

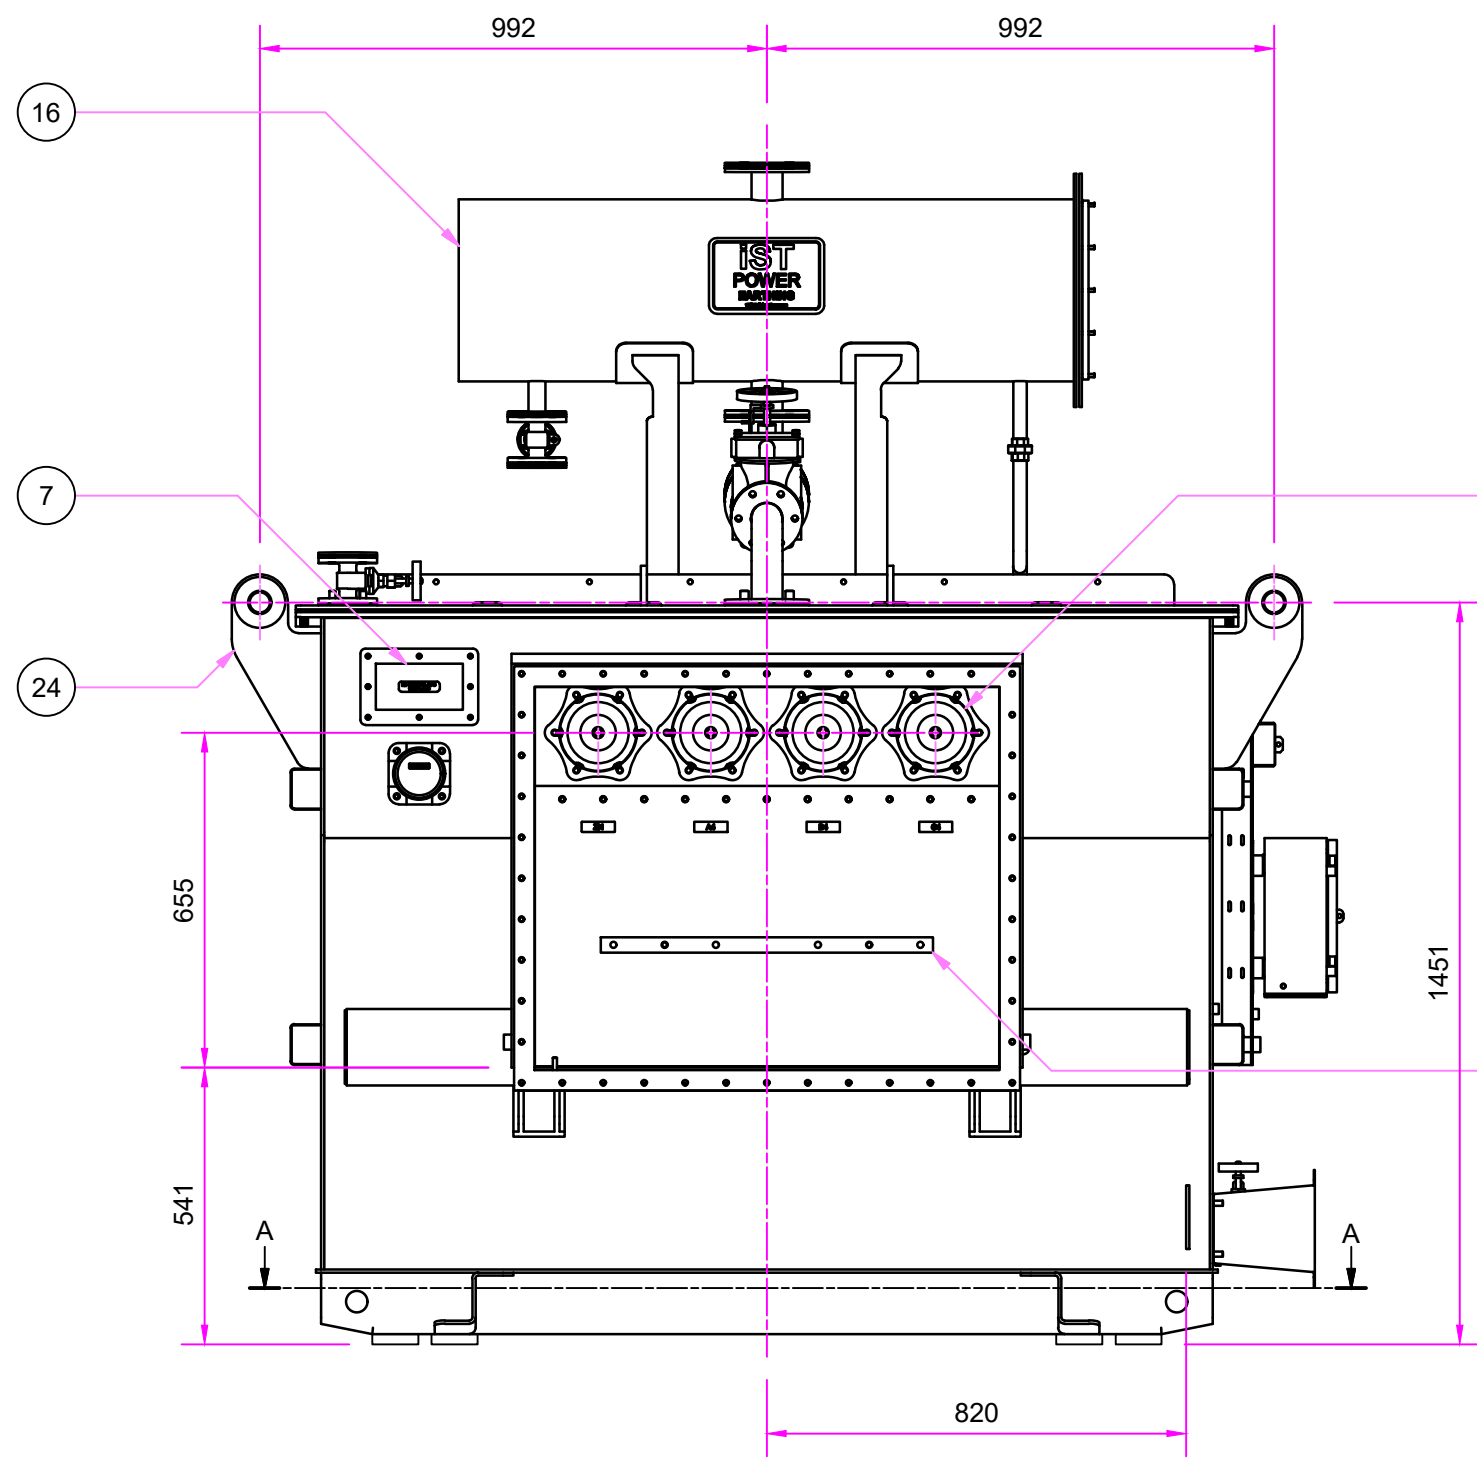


H.V. CABLEBOX SHOWN WITHOUT FRONT COVER FOR CLARITY

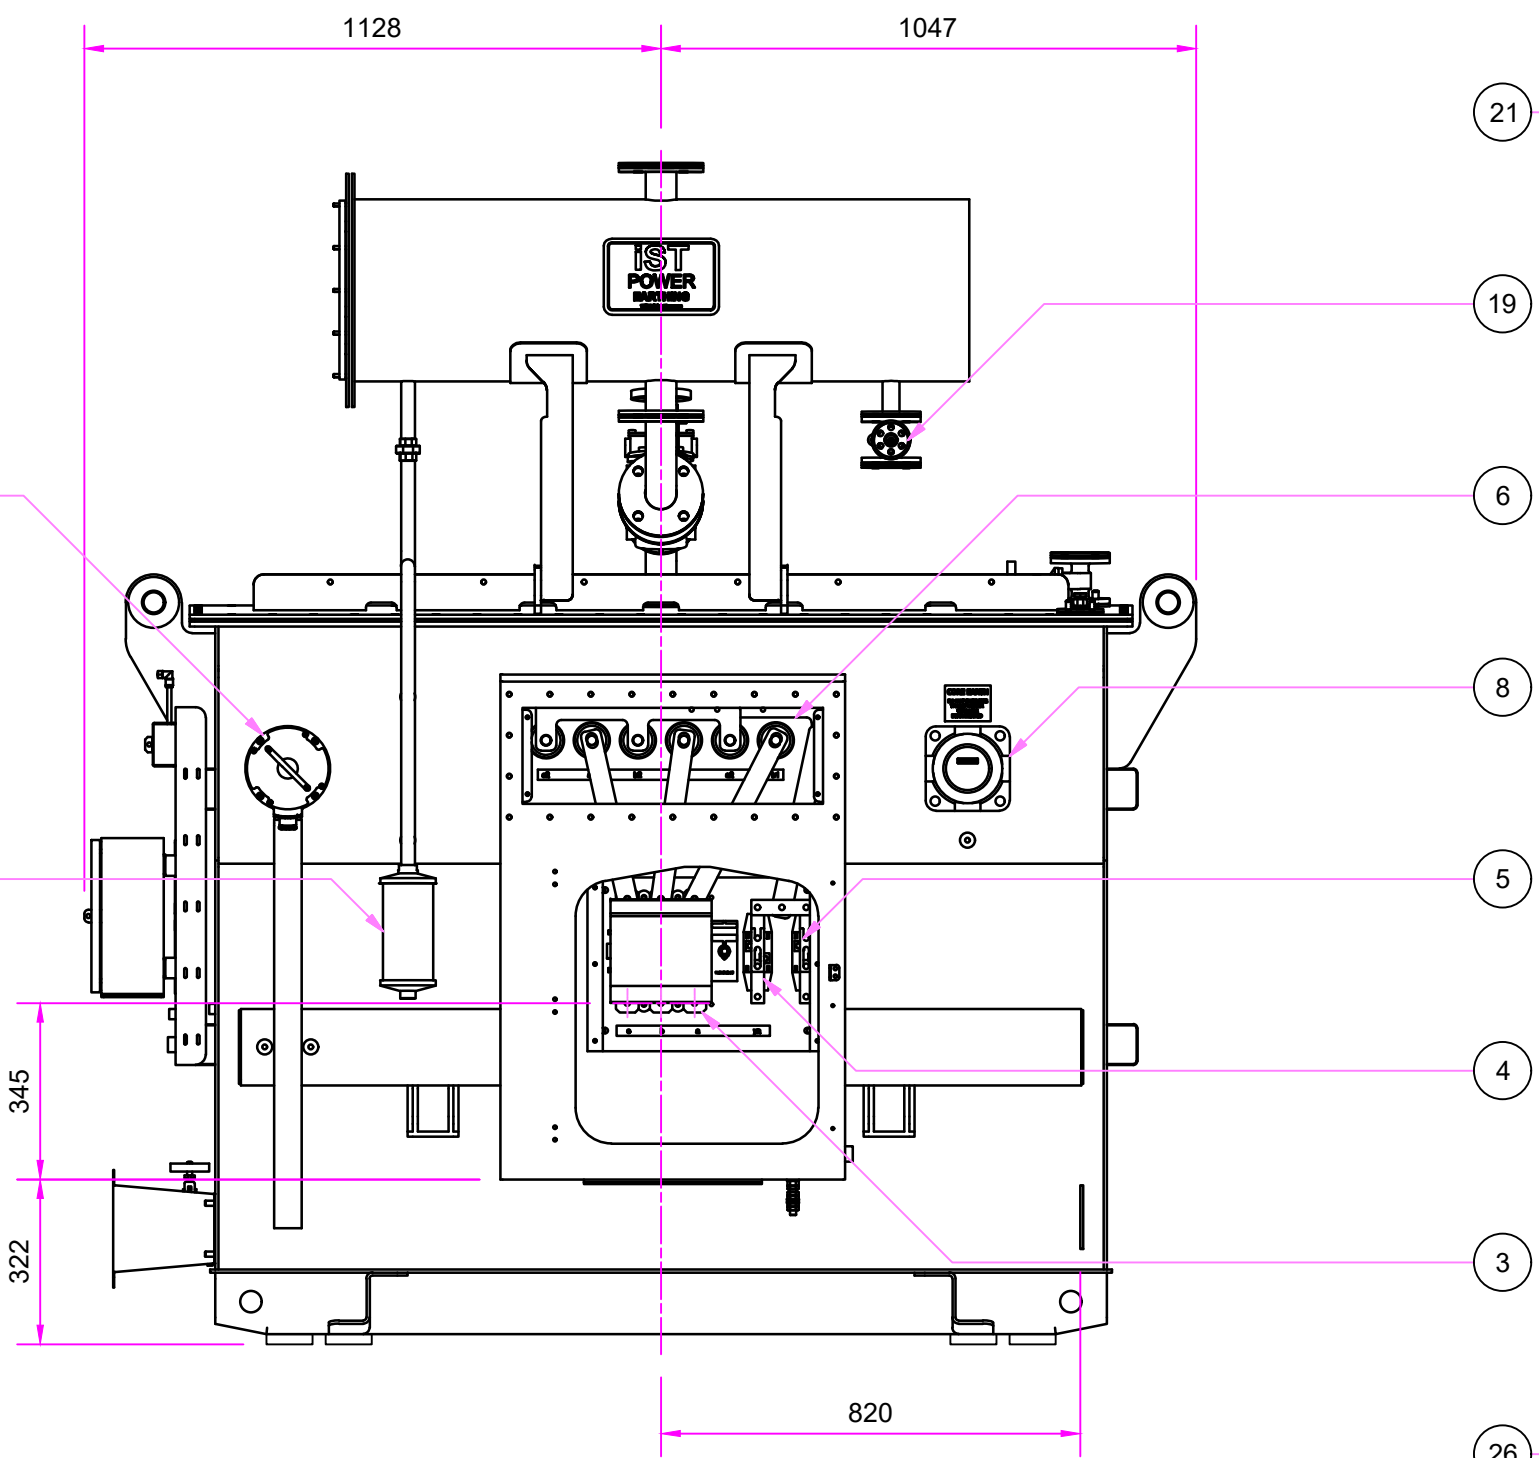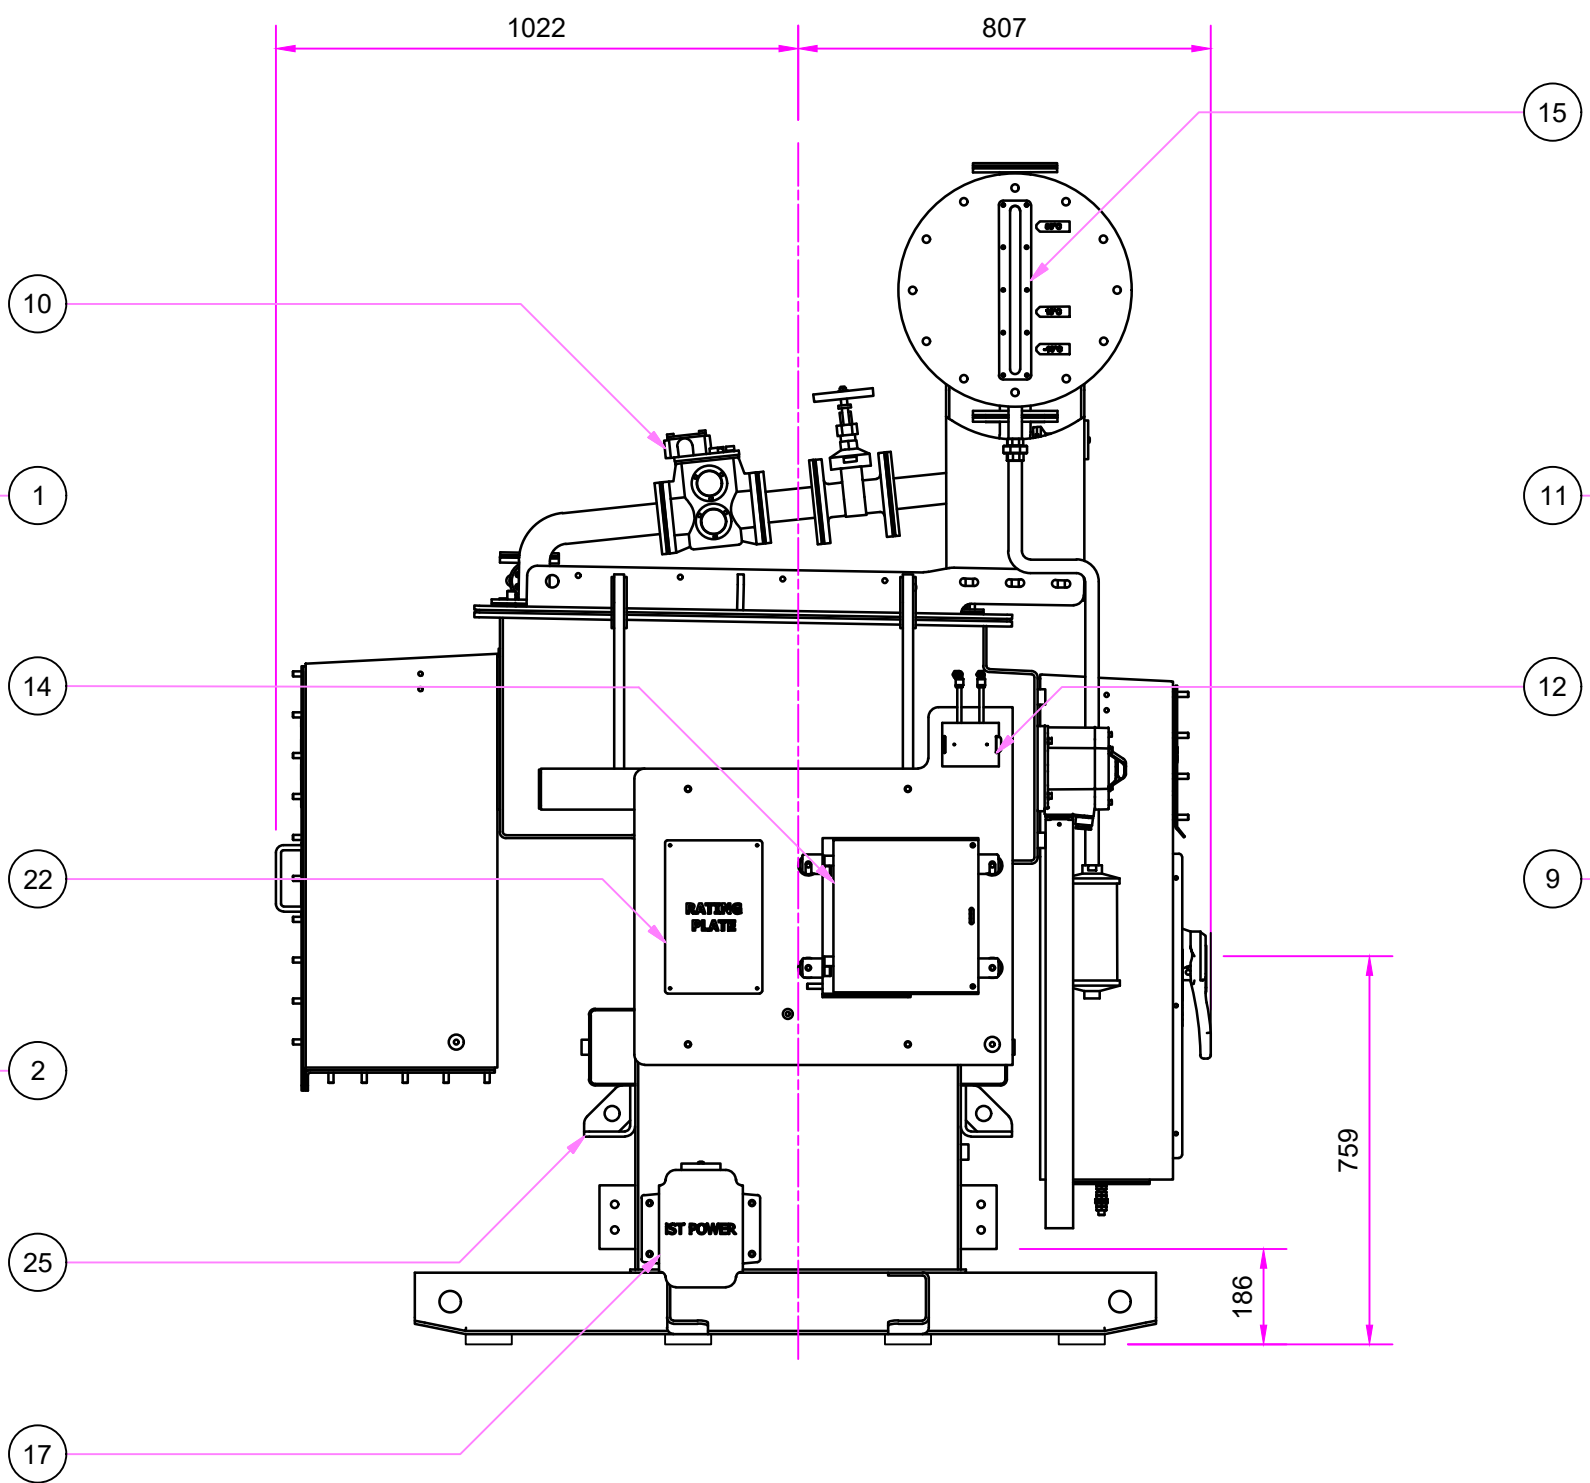


L.V. CABLEBOX SHOWN WITHOUT DOORS & COVER PLATES FOR CLARITY

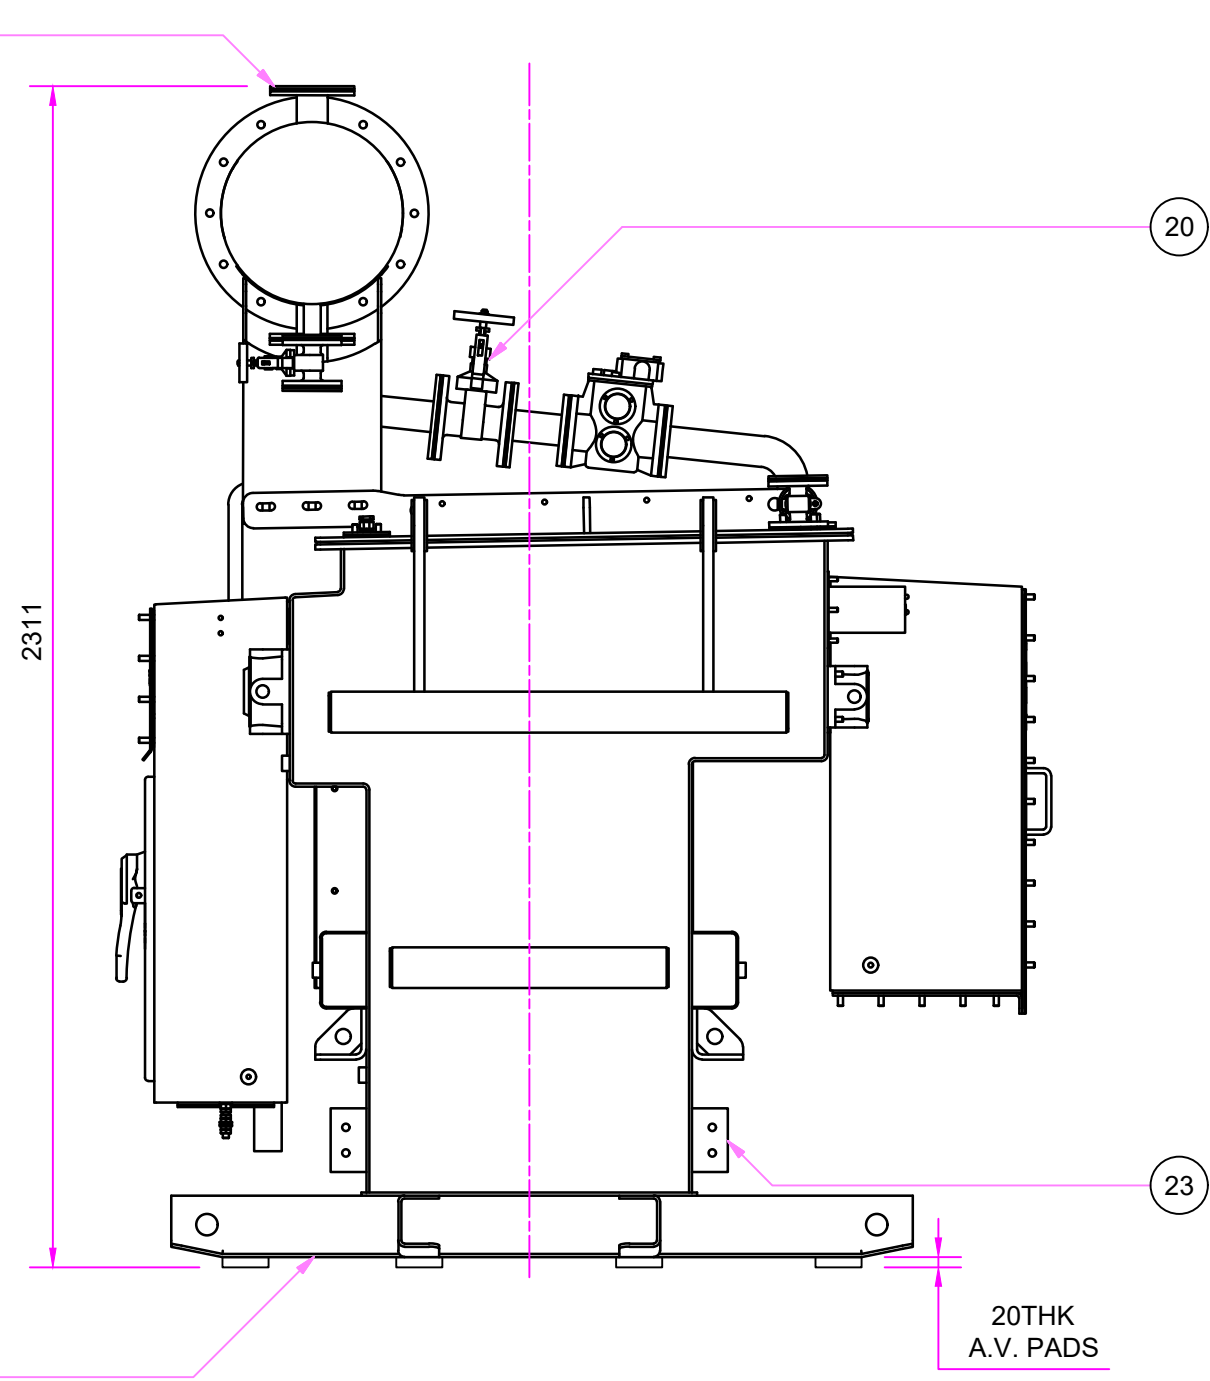


WHERE USED 0105592				TOLERANCES UNLESS OTHERWISE STATED : NO DECIMAL PLACE ±1mm. ONE DECIMAL PLACE ±0.4mm ANGULAR ±1°						A1 840 x 594					
ISSUE	BY	ECN	DESCRIPTION			DATE	TITLE								
0			NEW				OUTLINE OF 200kVA 33kV 415V 1500A FOR 30S ONAN EARTHING AUXILIARY TRANSFORMER								
1	R.L.	M2255	SEE ECN			15/02/2023									
2															
3															
4															
5															
6															
7															
8															
							THE INFORMATION, DATA, AND DRAWINGS EMBODIED IN THIS DOCUMENT ARE STRICTLY CONFIDENTIAL, AND ARE SUPPLIED WITH THE UNDERSTANDING THAT THEY WILL NOT BE DISCLOSED TO THIRD PARTIES WITHOUT THE PRIOR WRITTEN CONSENT OF IST Power Ltd					IST POWER IST Power Ltd LEICESTER : 0116 283 3321 MANCHESTER : 0161 428 9507 ALL INFORMATION, ILLUSTRATIONS, AND DATA CONTAINED HEREIN COPYRIGHT © IST Power Ltd ALL RIGHTS RESERVED			
DRAWN BY			R.LOBO			CHECKED		M.K.		SCALE				DATE	
										1 : 15				13/12/2022	
DRAWING No.							015348							SHEET No. 1 OF 1	



IF IN DOUBT ASK

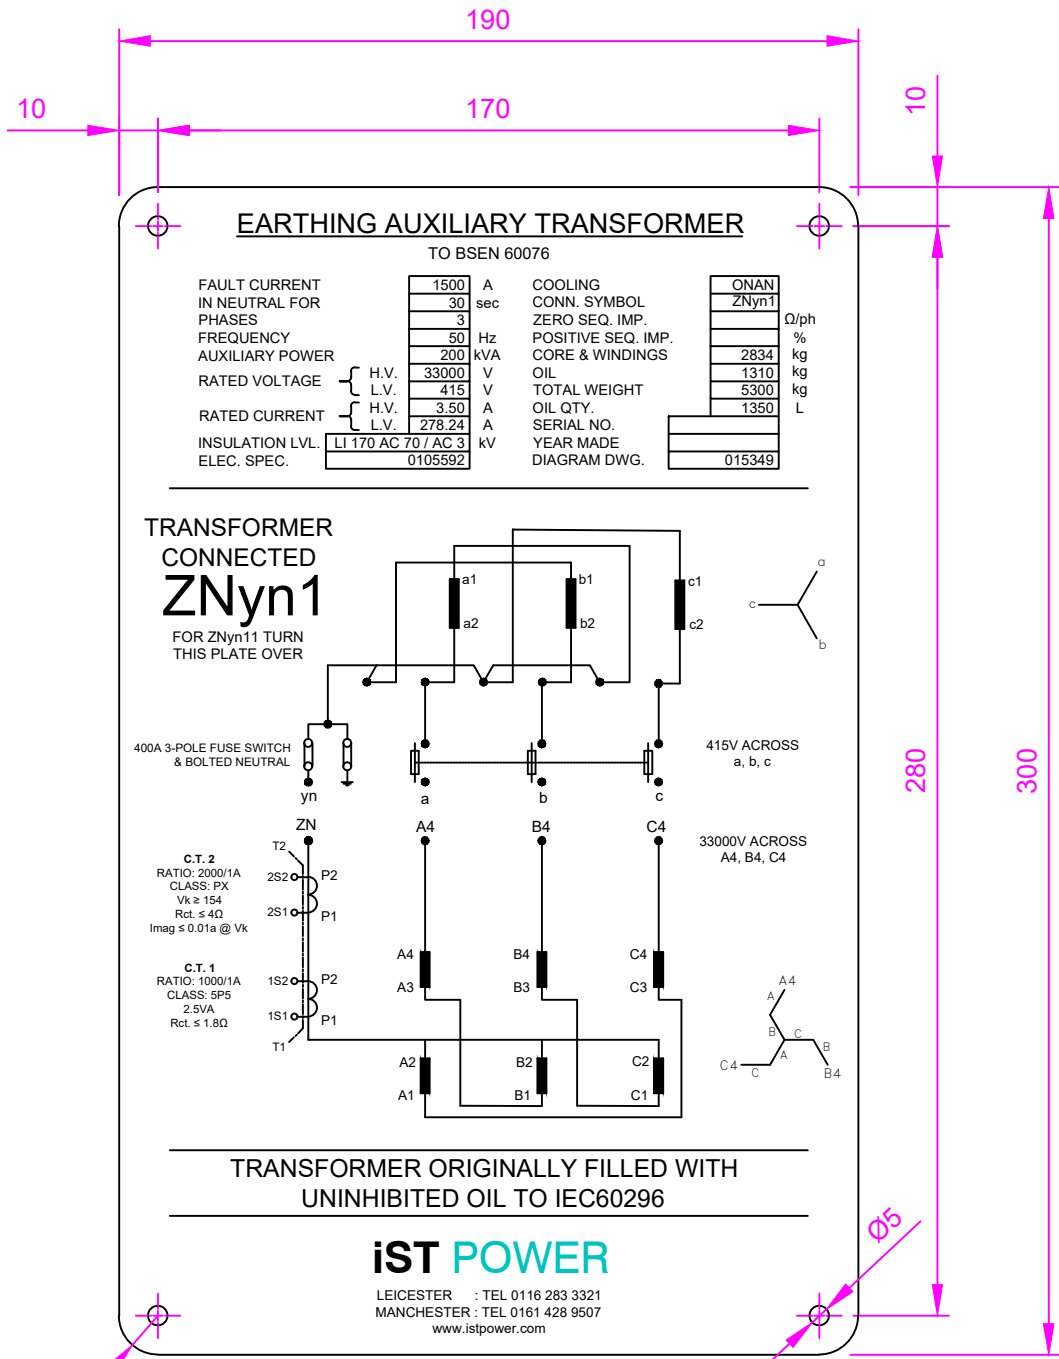

FRONT FACE

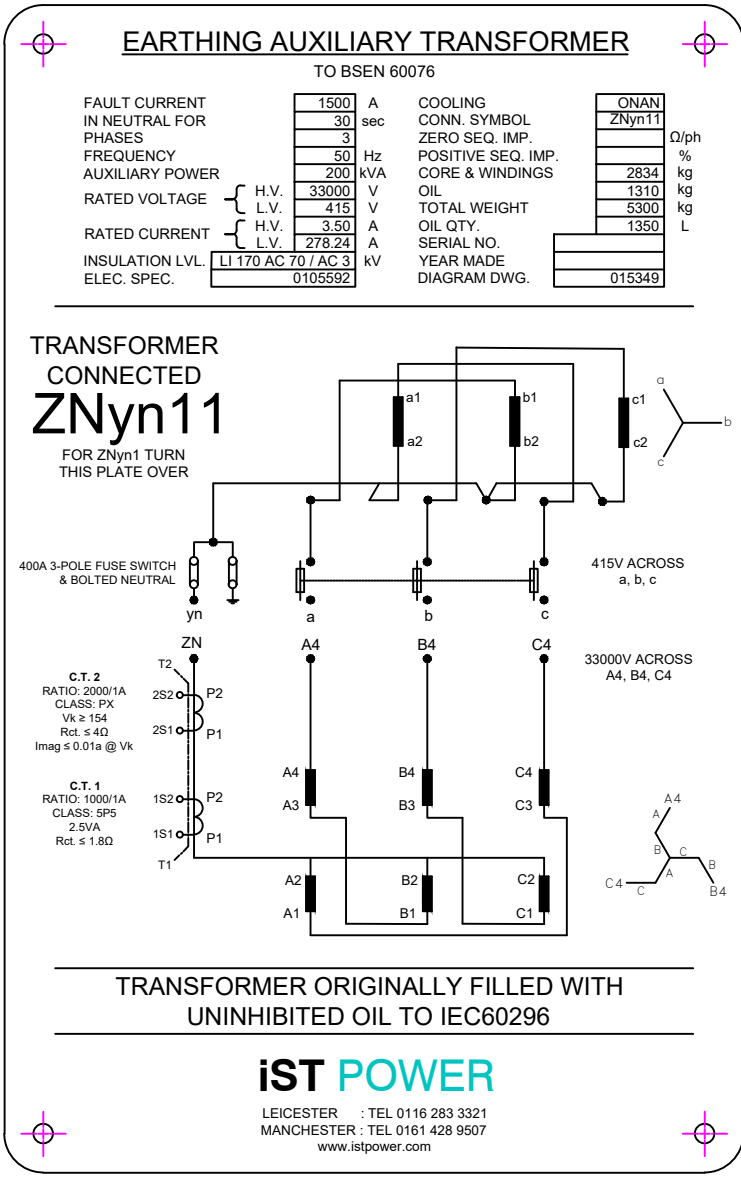

REAR FACE

MATERIAL : 1.2THK STAINLESS STEEL  
PLATE SIZE : 300 x 190

NOTE : REMOVE ALL BURRS & SHARP EDGES

ENGRAVE OR SCREEN PRINT.  
TO BE SUITABLE FOR HARSH ENVIRONMENT.

ZERO SEQUENCE IMPEDANCE, POSITIVE SEQUENCE  
IMPEDANCE, SERIAL NUMBER & YEAR OF MANUFACTURE  
ARE TO BE ENGRAVED AFTER TEST.


**ist - Swis 721 BT - TEXT**  
**COLOUR - BLACK (RED=0 ; GREEN=0; BLUE=0)**

**POWER - Swis 721 LtEx BT - TEXT**  
**COLOUR - (RED=0 ; GREEN=196; BLUE=191)**

**ALL OTHER LETTERING AND MARKINGS TO BE BLACK**

WHERE USED 0105592

TOLERANCES UNLESS OTHERWISE STATED : NO DECIMAL PLACE ±1mm ONE DECIMAL PLACE ±0.4mm ANGULAR ±1°



A3 297 X 420

ISSUE	BY	ECN	DESCRIPTION	DATE
0			NEW	
1	R.L.	M2255	SEE ECN	15/02/23
2	R.L.	M2266	SEE ECN	02/03/23

**TITLE**

**RATING & DIAGRAM PLATE OF**  
**200kVA 33kV 415V 1500A FOR 30s ONAN**  
**EARTHING AUXILIARY TRANSFORMER**

THE INFORMATION, DATA, AND  
DRAWINGS EMBODIED IN THIS  
DOCUMENT ARE STRICTLY  
CONFIDENTIAL, AND ARE SUPPLIED WITH  
THE UNDERSTANDING THAT THEY WILL  
NOT BE DISCLOSED TO THIRD PARTIES  
WITHOUT THE PRIOR WRITTEN CONSENT  
OF IST Power Ltd

**ist POWER**


**IST Power Ltd.**  
**LEICESTER : 0116 2833321**  
**MANCHESTER : 0161 428 9507**

ALL INFORMATION, ILLUSTRATIONS, AND DATA  
CONTAINED HEREIN COPYRIGHT © IST Power Ltd  
ALL RIGHTS RESERVED.


DRAWN R.LOBO	CHECKED M.K.	SCALE 1 : 1.2	DATE 15/12/2022
DRAWING No. 015349			SHEET No. 1 OF 1

IF IN DOUBT ASK



PRESSURE RELIEF DEVICE

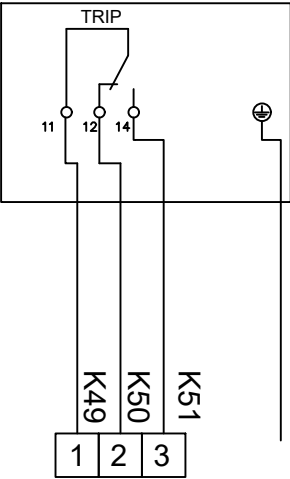

BUCHHOLZ RELAY

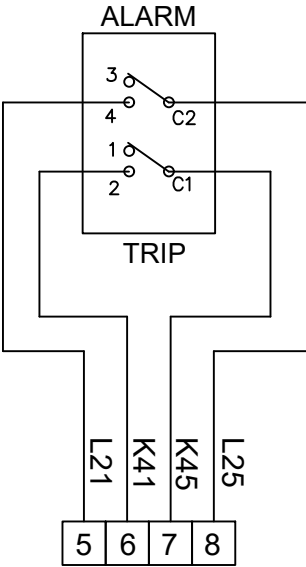


C.T. DETAILS

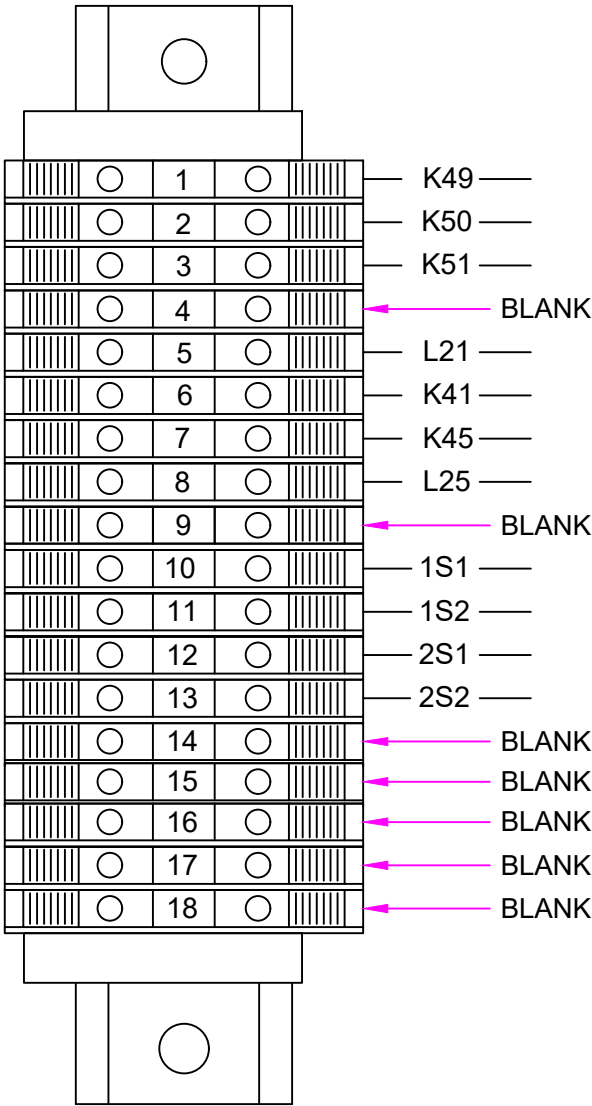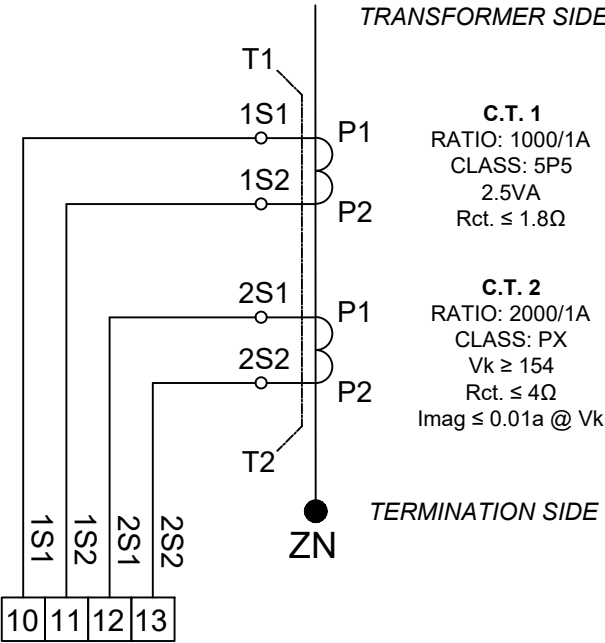

2.5mmSQ 4 CORE PVC SWA CABLE

INSTRUMENT	CONTACTS	OPERATION	COMMENTS
PRESSURE RELIEF DEVICE	1 N.O. 1 N.C.	CHANGE OVER ON RELEASE	RELEASE AT 5.8 P.S.I.(40kPa)
BUCHHOLZ RELAY	1 N.O. ALARM 1 N.O. TRIP	CLOSES ON EXCESS GAS CLOSES ON OIL SURGE	ALARM TRIP

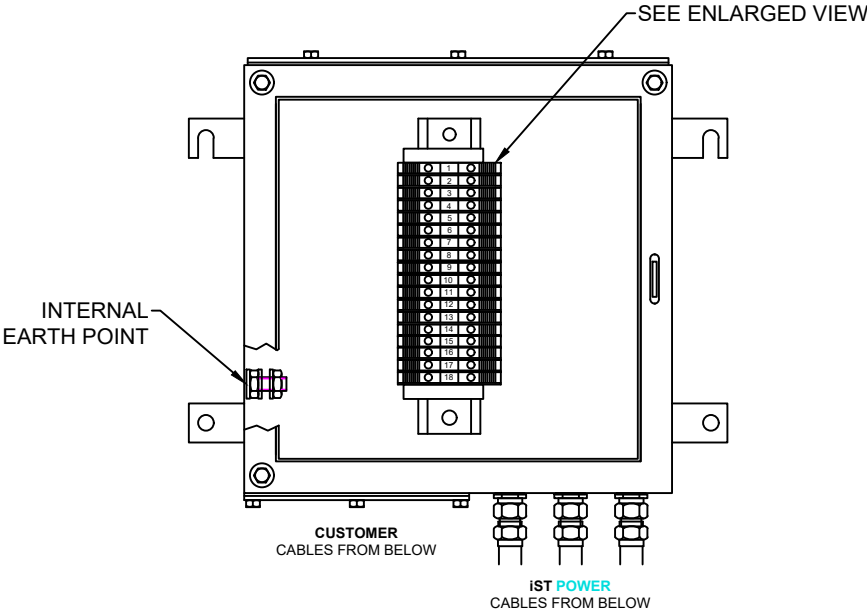


TERMINAL BLOCKS ARE ALL KLIPPON TYPE WDU 10/SL.

TERMINAL BLOCKS TO BE NUMBERED.  
WIRES TERMINATED WITH HOOKED BLADE TYPE CRIMPS.

WHERE USED 0105592

TOLERANCES UNLESS OTHERWISE STATED : NO DECIMAL PLACE ±1mm ONE DECIMAL PLACE ±0.4mm ANGULAR ±1°



A3 297 X 420

ISSUE	BY	ECN	DESCRIPTION	DATE
0			NEW	
1	R.L.	M2255	SEE ECN	15/02/23
2	R.L.	M2266	SEE ECN	02/03/23

AUXILIARY WIRING DIAGRAM OF  
200kVA 33kV 415V 1500A FOR 30s ONAN  
EARTHING AUXILIARY TRANSFORMER

THE INFORMATION, DATA, AND  
DRAWINGS EMBODIED IN THIS  
DOCUMENT ARE STRICTLY  
CONFIDENTIAL, AND ARE SUPPLIED WITH  
THE UNDERSTANDING THAT THEY WILL  
NOT BE DISCLOSED TO THIRD PARTIES  
WITHOUT THE PRIOR WRITTEN CONSENT  
OF IST Power Ltd

IST POWER

IST Power Ltd.  
LEICESTER : 0116 2833321  
MANCHESTER : 0161 428 9507

ALL INFORMATION, ILLUSTRATIONS, AND DATA  
CONTAINED HEREIN COPYRIGHT © IST Power Ltd  
ALL RIGHTS RESERVED.

DRAWN  
M.K.


CHECKED  
R.LOBO


SCALE  
N.T.S.

DATE  
15/12/2022

DRAWING No. 015350

SHEET No.  
1 OF 1

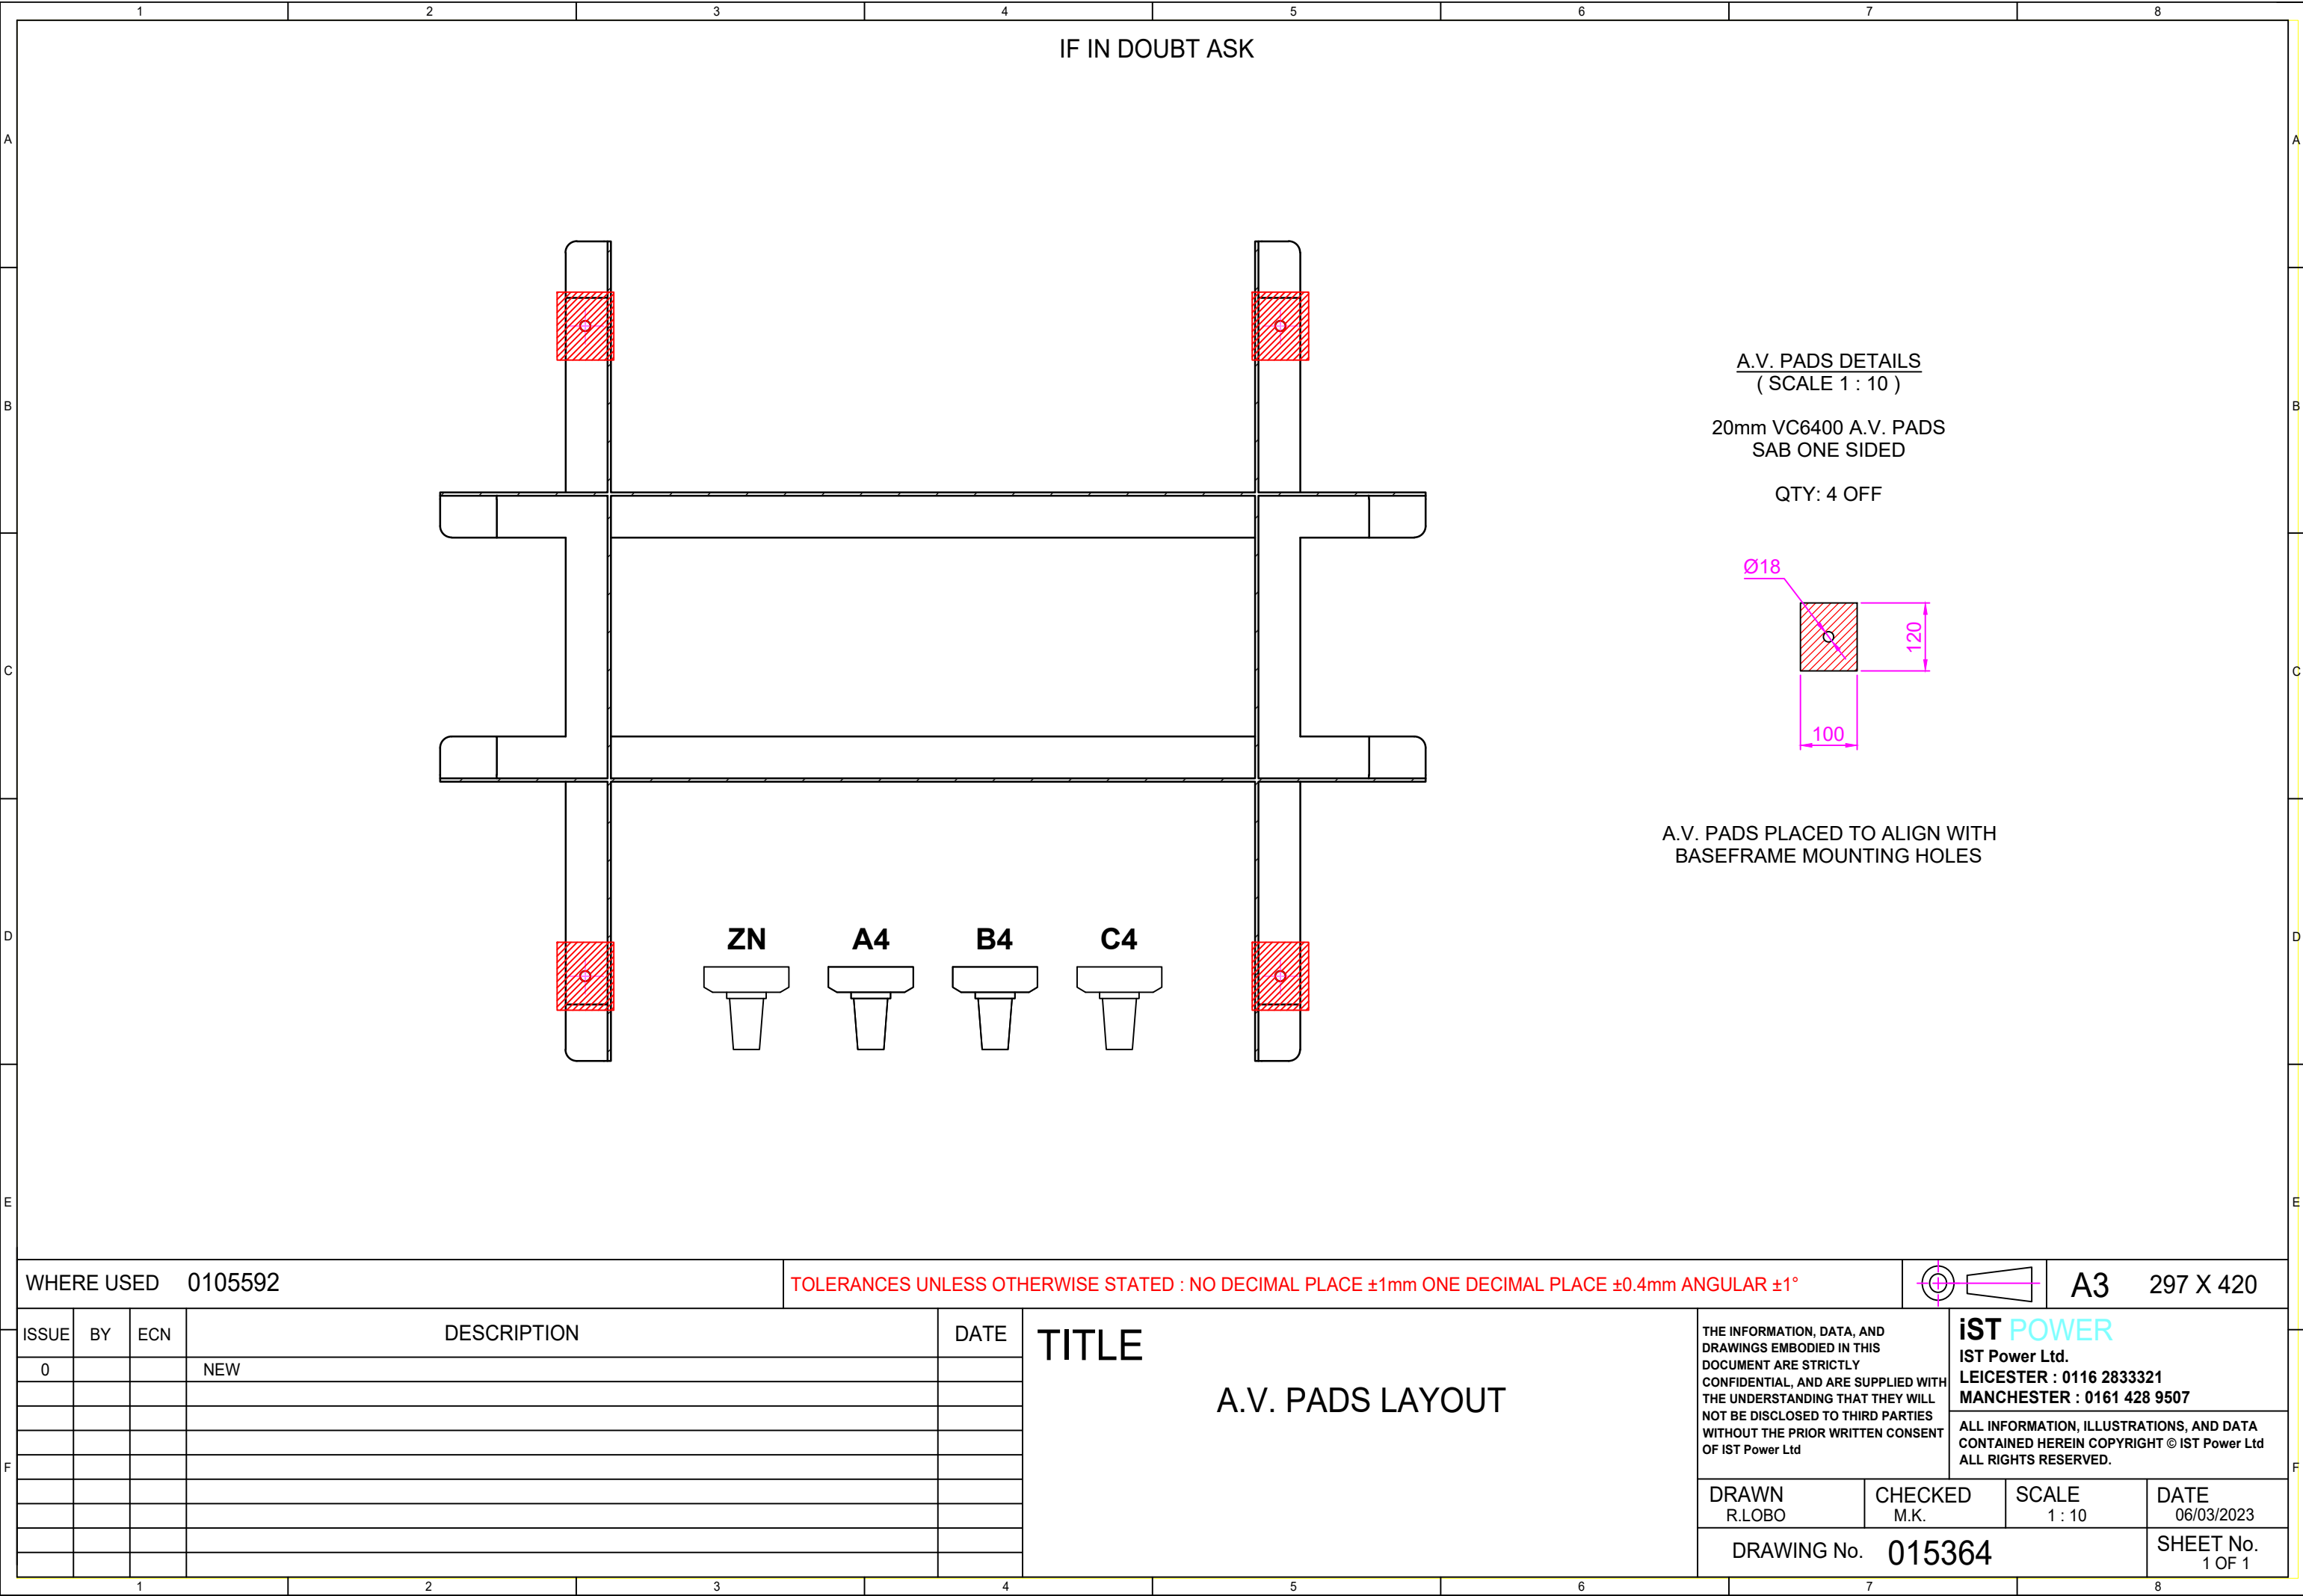

WHERE USED				0105592				TOLERANCES UNLESS OTHERWISE STATED : NO DECIMAL PLACE ±1mm ONE DECIMAL PLACE ±0.4mm ANGULAR ±1°						A3		297 X 420	
ISSUE	BY	ECN	DESCRIPTION				DATE	TITLE  A.V. PADS LAYOUT				THE INFORMATION, DATA, AND DRAWINGS EMBODIED IN THIS DOCUMENT ARE STRICTLY CONFIDENTIAL, AND ARE SUPPLIED WITH THE UNDERSTANDING THAT THEY WILL NOT BE DISCLOSED TO THIRD PARTIES WITHOUT THE PRIOR WRITTEN CONSENT OF IST Power Ltd		<div>ist POWER</div> <div>IST Power Ltd.</div> <div>LEICESTER : 0116 2833321</div> <div>MANCHESTER : 0161 428 9507</div> <div>ALL INFORMATION, ILLUSTRATIONS, AND DATA CONTAINED HEREIN COPYRIGHT © IST Power Ltd</div> <div>ALL RIGHTS RESERVED.</div>			
0			NEW														
DRAWN		CHECKED		SCALE		DATE											
R.LOBO		M.K.		1 : 10		06/03/2023											
DRAWING No.						015364		SHEET No.									
								1 OF 1									

SECTION  
7

COOLING LIQUID:  
NYNAS NITRO LIBRA

(PRODUCT DATA SHEET – 2 PAGES)  
(SAFETY DATA SHEET – 22 PAGES)

APPENDIX A





Nytro Libra is an uninhibited transformer oil that conforms to IEC 60296 Edition 4.0. Developed and formulated to deliver solid resistance to oil degradation, Nytro Libra provides good oxidation stability thanks to its natural inhibitors. This increases the possibilities for a longer transformer life with less maintenance.

### **Designed for heavy duty**

This product has been specially developed for use in oil-filled electrical equipment – including power and distribution transformers, rectifiers, circuit breakers and switchgears.

### **Performance and benefits**

Good heat transfer. Thanks to low viscosity and viscosity index, this standard grade offers extremely good heat transfer characteristics, ensuring heat is efficiently removed from core and windings.

Reliable oxidation stability. Developed and formulated to deliver good resistance to oil degradation, this grade also provides good oxidation stability for enhanced transformer life and minimum maintenance.

Very good low temperature properties. Naphthenic characteristics allow the transformer to start at the lowest possible temperature – without using pour point depressants.

High dielectric strength. This insulating oil both meets and exceeds the toughest demands on dielectric strength – when stored and handled correctly.

### **Product description**

Nytro Libra fulfils the requirements for IEC 60296 Edition 4.0 uninhibited oil. Nynas classify this product as a standard grade.

Nytro Libra is rigorously analysed and passes the following corrosion tests:

- ASTM D1275
- IEC 62535
- DIN 51353

In accordance with IEC 60296 Edition 4.0, all additives are declared.

### **There's more to us than this**

We're delighted you chose one of our transformer oils. If you have any questions about other products and services, get in touch with your local Nynas contact. Besides top quality oils, we offer a wide range of services, including rapid delivery worldwide, sample analysis, training, seminars and much more. All you have to do is ask. Find out more at [www.nynas.com](http://www.nynas.com)



# Nytro Libra

PROPERTY	UNIT	TEST METHOD	SPECIFICATION LIMITS		TYPICAL DATA
			MIN	MAX	
1 - Function					
Viscosity, 40°C	mm <sup>2</sup> /s	ISO 3104		12.0	9.4
Viscosity, -30°C	mm <sup>2</sup> /s	ISO 3104		1800	1050
Pour point	°C	ISO 3016		-40	-51
Water content	mg/kg	IEC 60814		30	<20
Breakdown voltage					
- Before treatment	kV	IEC 60156	30		40-60
- After treatment	kV	IEC 60296	70		>70
Density, 20°C	kg/dm <sup>3</sup>	ISO 12185		0.895	0.876
DDF at 90°C		IEC 60247		0.005	<0.001
2 - Refining/stability					
Appearance		IEC 60296	Clear, free from sediment		complies
Acidity	mg KOH/g	IEC 62021		0.01	<0.01
Interfacial tension	mN/m	EN 14210	40		47
Corrosive sulphur		DIN 51353	non-corrosive		non-corrosive
Potentially corrosive sulphur		IEC 62535	non-corrosive		non-corrosive
Corrosive sulphur		ASTM D 1275	non-corrosive		non-corrosive
DBDS	mg/kg	IEC 62697-1		not detectable	not detectable
Antioxidant	wt %	IEC 60666		not detectable	not detectable
Metal passivator additives	mg/kg	IEC 60666		not detectable	not detectable
2-Furfural and related compounds content	mg/kg	IEC 61198		0.05	<0.05
Aromatic content	%	IEC 60590			9
3 - Performance					
Oxidation stability at 120°C,164 h		IEC 61125 C			
Total acidity	mg KOH/g			1.2	0.65
Sludge	wt %			0.8	0.16
DDF at 90°C				0.500	0.070
4 - Health, safety and environment (HSE)					
Flash point, PM	°C	ISO 2719	135		150
PCA	wt %	IP 346		3	<3
PCB		IEC 61619	not detectable		not detectable

Nytro Libra is an uninhibited insulating oil, meeting IEC 60296 Ed.4 (2012) General specifications. Breakdown voltage after treatment as per definition given in IEC 60296, section 6.4.

Severely Hydrotreated Insulating Oil  
Issuing date: 2017-10-11



# NYTRO® LIBRA



## SAFETY DATA SHEET

Date of printing	2019-10-21
Date of issue/ Date of revision	2019-10-21
Date of previous issue	2018-11-07
Version	5

### SECTION 1: Identification of the substance/mixture and of the company/undertaking

#### 1.1 Product identifier

Product name	NYTRO® LIBRA
Product description	Insulating oil
Product type	Liquid.

#### 1.2 Relevant identified uses of the substance or mixture and uses advised against

Identified uses	
Distribution of substance - Industrial Formulation and (re)packing of substances and mixtures - Industrial Use in functional fluids - Industrial Use in functional fluids - Professional	
Uses advised against	Reason
This product must not be used in applications other than those recommended in Section 1, without first seeking the advice of the supplier.	-

#### 1.3 Details of the supplier of the safety data sheet

Supplier/Manufacturer	Head office: Nynas AB P.O. Box 10700 SE-121 29 Stockholm SWEDEN +46 8 602 12 00 (Office hours 8 am - 4.30 pm (CET)) www.nynas.com
e-mail address of person responsible for this SDS	ProductHSE@nynas.com

#### 1.4 Emergency telephone number

Telephone number	+44 (0) 1235 239 670
Hours of operation	24 hour service
<u>National advisory body/Poison Centre</u>	
Telephone number 020 - 99 60 00 (Kemiakuten, 24h service)	

### SECTION 2: Hazards identification

#### 2.1 Classification of the substance or mixture

Product definition	Mixture
<u>Classification according to Regulation (EC) No. 1272/2008 [CLP/GHS]</u>	
Asp. Tox. 1, H304	

The product is classified as hazardous according to Regulation (EC) 1272/2008 as amended.  
See Section 16 for the full text of the H statements declared above.  
See Section 11 for more detailed information on health effects and symptoms.

## SECTION 2: Hazards identification

## 2.2 Label elements

Hazard pictograms



Signal word

Danger

Hazard statements

H304 - May be fatal if swallowed and enters airways.

Precautionary statements

Prevention

Not applicable.

Response

P301 + P310 + P331 - IF SWALLOWED: Immediately call a POISON CENTER or physician. Do NOT induce vomiting.

Storage

P405 - Store locked up.

Disposal

P501 - Dispose of contents and container in accordance with all local, regional, national and international regulations.

Supplemental label elements

Not applicable.

Annex XVII - Restrictions on the manufacture, placing on the market and use of certain dangerous substances, mixtures and articles

Not applicable.

## 2.3 Other hazards

Product meets the criteria for PBT or vPvB according to Regulation (EC) No. 1907/2006, Annex XIII

This mixture does not contain any substances that are assessed to be a PBT or a vPvB.

Other hazards which do not result in classification

Prolonged or repeated contact may dry skin and cause irritation.

## SECTION 3: Composition/information on ingredients

## 3.2 Mixtures

Mixture

Product/ingredient name	Identifiers	%	Regulation (EC) No. 1272/2008 [CLP]	Type
Distillates (petroleum), hydrotreated light naphthenic	REACH #: 01-2119480375-34 EC: 265-156-6 CAS: 64742-53-6 Index: 649-466-00-2	50 - 70	Asp. Tox. 1, H304	[1] [2]
Distillates (petroleum), hydrotreated light paraffinic	REACH #: 01-2119487077-29 EC: 265-158-7 CAS: 64742-55-8	0 - 50	Asp. Tox. 1, H304	[1] [2]
Distillates (petroleum), hydrotreated heavy paraffinic	REACH #: 01-2119484627-25 EC: 265-157-1 CAS: 64742-54-7 Index: 649-467-00-8	0 - 50	Not classified.	[2]
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	REACH #: 01-2119474878-16 EC: 276-737-9 CAS: 72623-86-0 Index: 649-482-00-X	0 - 50	Asp. Tox. 1, H304	[1] [2]
Distillates (petroleum), solvent-refined heavy naphthenic	REACH #: 01-2119483621-38	0 - 5	Not classified.	[2]

## SECTION 3: Composition/information on ingredients

	EC: 265-097-6 CAS: 64741-96-4 Index: 649-457-00-3		See Section 16 for the full text of the H statements declared above.	
--	---	--	--	--

Regulation (EC) No. 1272/2008 [CLP] Annex VI Nota L applies to the base oil(s) in this product. Nota L - The classification as a carcinogen need not apply if it can be shown that the substance contains less than 3 % DMSO extract as measured by IP 346.

There are no additional ingredients present which, within the current knowledge of the supplier and in the concentrations applicable, are classified as hazardous to health or the environment, are PBTs, vPvBs or Substances of equivalent concern, or have been assigned a workplace exposure limit and hence require reporting in this section.

Type

[1] Substance classified with a health or environmental hazard

[2] Substance with a workplace exposure limit

[3] Substance meets the criteria for PBT according to Regulation (EC) No. 1907/2006, Annex XIII

[4] Substance meets the criteria for vPvB according to Regulation (EC) No. 1907/2006, Annex XIII

[5] Substance of equivalent concern

[6] Additional disclosure due to company policy

Occupational exposure limits, if available, are listed in Section 8.

## SECTION 4: First aid measures

## 4.1 Description of first aid measures

Eye contact	Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. If irritation, blurred vision or swelling occurs and persists, obtain medical advice from a specialist.
Inhalation	If breathing is difficult, remove victim to fresh air and keep at rest in a position comfortable for breathing. If casualty is unconscious and: If not breathing, if breathing is irregular or if respiratory arrest occurs, provide artificial respiration or oxygen by trained personnel. Get medical attention if adverse health effects persist or are severe. Maintain an open airway.
Skin contact	Wash with soap and water. Remove contaminated clothing and shoes. Handle with care and dispose of in a safe manner. Seek medical attention if skin irritation, swelling or redness develops and persists.
Ingestion	Accidental high pressure injection through the skin requires immediate medical attention. Do not wait for symptoms to develop.  Always assume that aspiration has occurred. Do not induce vomiting. Can enter lungs and cause damage. If vomiting occurs, the head should be kept low so that vomit does not enter the lungs. Seek professional medical attention or send the casualty to a hospital. Do not wait for symptoms to develop.
Protection of first-aiders	Never give anything by mouth to an unconscious person. If unconscious, place in recovery position and get medical attention immediately. Maintain an open airway. Loosen tight clothing such as a collar, tie, belt or waistband.  No action shall be taken involving any personal risk or without suitable training. It may be dangerous to the person providing aid to give mouth-to-mouth resuscitation.  Before attempting to rescue casualties, isolate area from all potential sources of ignition including disconnecting electrical supply. Ensure adequate ventilation and check that a safe, breathable atmosphere is present before entry into confined spaces.

## 4.2 Most important symptoms and effects, both acute and delayed

Over-exposure signs/symptoms

Eye contact	Slight irritant
-------------	-----------------

## SECTION 4: First aid measures

Inhalation	Inhalation of oil mist or vapours at elevated temperatures may cause respiratory irritation.
Skin contact	Adverse symptoms may include the following: irritation dryness cracking
Ingestion	Adverse symptoms may include the following: Nausea or vomiting. diarrhoea

### 4.3 Indication of any immediate medical attention and special treatment needed

Notes to physician	Due to low viscosity there is a risk of aspiration if the product enters the lungs. Treat symptomatically.
Specific treatments	Always assume that aspiration has occurred.

## SECTION 5: Firefighting measures

### 5.1 Extinguishing media

Suitable extinguishing media	Use dry chemical, CO <sub>2</sub> , water spray (fog) or foam.
Unsuitable extinguishing media	Do not use direct water jets on the burning product; they could cause splattering and spread the fire. Simultaneous use of foam and water on the same surface is to be avoided as water destroys the foam.

### 5.2 Special hazards arising from the substance or mixture

Hazards from the substance or mixture	In a fire or if heated, a pressure increase will occur and the container may burst. This substance will float and can be reignited on surface water.
Hazardous combustion products	Incomplete combustion is likely to give rise to a complex mixture of airborne solid and liquid particulates, gases, including carbon monoxide, H <sub>2</sub> S, SO <sub>x</sub> (sulfur oxides) or sulfuric acid and unidentified organic and inorganic compounds.

### 5.3 Advice for firefighters

Special precautions for fire-fighters	Promptly isolate the scene by removing all persons from the vicinity of the incident if there is a fire. No action shall be taken involving any personal risk or without suitable training.
Special protective equipment for fire-fighters	Fire-fighters should wear appropriate protective equipment and self-contained breathing apparatus (SCBA) with a full face-piece operated in positive pressure mode. Clothing for fire-fighters (including helmets, protective boots and gloves) conforming to European standard EN 469 will provide a basic level of protection for chemical incidents.

## SECTION 6: Accidental release measures

### 6.1 Personal precautions, protective equipment and emergency procedures

For non-emergency personnel	Avoid breathing vapour or mist. Keep non-involved personnel away from the area of spillage. Alert emergency personnel. Except in case of small spillages, the feasibility of any actions should always be assessed and advised, if possible, by a trained, competent person in charge of managing the emergency. Stop leak if safe to do so. Avoid direct contact with the product. Stay upwind/keep distance from source. In case of large spillages, alert occupants in downwind areas.
-----------------------------	---

Eliminate all ignition sources if safe to do so. Spillages of limited amounts of product, especially in the open air when vapours will be usually quickly dispersed, are dynamic situations, which will presumably limit the exposure to dangerous concentrations.

Note : recommended measures are based on the most likely spillage scenarios for this material; however, local conditions (wind, air temperature, wave/current direction and speed) may significantly influence the choice of appropriate actions. For this

## SECTION 6: Accidental release measures

	reason, local experts should be consulted when necessary. Local regulations may also prescribe or limit actions to be taken.
For emergency responders	Small spillages: normal antistatic working clothes are usually adequate.  Large spillages: full body suit of chemically resistant and thermal resistant material should be used. Work gloves providing adequate chemical resistance, specifically to aromatic hydrocarbons. Note : gloves made of PVA are not water-resistant, and are not suitable for emergency use. Safety helmet, antistatic non-skid safety shoes or boots. Goggles and /or face shield, if splashes or contact with eyes is possible or anticipated.  Respiratory protection : A half or full-face respirator with filter(s) for organic vapours (and when applicable for H <sub>2</sub> S) a Self Contained Breathing Apparatus (SCBA) can be used according to the extent of spill and predictable amount of exposure. If the situation cannot be completely assessed, or if an oxygen deficiency is possible, only SCBA's should be used.
6.2 Environmental precautions	Prevent product from entering sewers, rivers or other bodies of water. If necessary dike the product with dry earth, sand or similar non-combustible materials. In case of soil contamination, remove contaminated soil and treat in accordance with local regulations.  In case of small spillages in closed waters (i.e. ports), contain product with floating barriers or other equipment. Collect spilled product by absorbing with specific floating absorbents.  If possible, large spillages in open waters should be contained with floating barriers or other mechanical means. If this is not possible, control the spreading of the spillage, and collect the product by skimming or other suitable mechanical means. The use of dispersants should be advised by an expert, and, if required, approved by local authorities.
6.3 Methods and material for containment and cleaning up	
Small spill	Stop leak if without risk. Absorb spilled product with suitable non-combustible materials.
Large spill	Large spillages may be cautiously covered with foam, if available, to limit vapour cloud formation. Do not use water jet. When inside buildings or confined spaces, ensure adequate ventilation. Transfer collected product and other contaminated materials to suitable containers for recovery or safe disposal. Approach the release from upwind. Contaminated absorbent material may pose the same hazard as the spilt product.
6.4 Reference to other sections	See Section 1 for emergency contact information. See Section 8 for information on appropriate personal protective equipment. See Section 13 for additional waste treatment information.

## SECTION 7: Handling and storage

The information in this section contains generic advice and guidance. The list of Identified Uses in Section 1 should be consulted for any available use-specific information provided in the Exposure Scenario(s).

General information	Obtain special instructions before use. Keep away from heat/sparks/open flames/hot surfaces. - No smoking. Use and store only outdoors or in a well-ventilated area. Hazard of slipping on spilt product. Avoid release to the environment.
7.1 Precautions for safe handling	
Protective measures	Do not ingest. Do not breathe dust/fume/gas/mist/vapours/spray. Avoid contact with eyes, skin and clothing. Keep in the original container or an approved alternative made from a compatible material, kept tightly closed when not in use.  Prevent the risk of slipping. Take precautionary measures against static discharge. Avoid splash filling of bulk volumes when handling hot liquid product. Empty containers retain product residue and can be hazardous.



## SECTION 7: Handling and storage


Advice on general occupational hygiene	<p>Nota : See Section 8 for information on appropriate personal protective equipment. See section 13 for waste disposal information.</p> <p>Ensure that proper housekeeping measures are in place. Contaminated materials should not be allowed to accumulate in the workplaces and should never be kept inside the pockets. Eating, drinking and smoking should be prohibited in areas where this material is handled, stored and processed. Wash hands thoroughly after handling. Change contaminated clothes at the end of working shift. See also Section 8 for additional information on hygiene measures.</p>
7.2 Conditions for safe storage, including any incompatibilities	<p>Storage area layout, tank design, equipment and operating procedures must comply with the relevant regional, national or local legislation. Storage installations should be designed with adequate bunds in case of leaks or spills. Cleaning, inspection and maintenance of internal structure of storage tanks must be done only by properly equipped and qualified personnel as defined by national, local or company regulations.</p> <p>Store separately from oxidising agents.</p> <p>Recommended materials for containers, or container linings use mild steel, stainless steel. Not suitable : Some synthetic materials may be unsuitable for containers or container linings depending on the material specification and intended use. Compatibility should be checked with the manufacturer.</p> <p>Keep only in the original container or in a suitable container for this kind of product. Keep container tightly closed and sealed until ready for use. Do not store in unlabelled containers. Containers that have been opened must be carefully resealed and kept upright to prevent leakage. Empty containers may contain harmful, flammable/combustible or explosive residue or vapours. Do not cut, grind, drill, weld, reuse or dispose of containers unless adequate precautions are taken against these hazards. Store locked up. Protect from sunlight.</p>
7.3 Specific end use(s)	
Recommendations	Not available.
Industrial sector specific solutions	Not available.

## SECTION 8: Exposure controls/personal protection

The information in this section contains generic advice and guidance. The list of Identified Uses in Section 1 should be consulted for any available use-specific information provided in the Exposure Scenario(s).

### 8.1 Control parameters

#### Occupational exposure limits

Product/ingredient name	Exposure limit values
 Distillates (petroleum), hydrotreated light naphthenic	<b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b> TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume
Distillates (petroleum), hydrotreated light paraffinic	<b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b> TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume
Distillates (petroleum), hydrotreated heavy paraffinic	<b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b> TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	<b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b>



## SECTION 8: Exposure controls/personal protection

Distillates (petroleum), solvent-refined heavy naphthenic	TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume <b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b>
Oil mist	TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume <b>[Air contaminant]</b> <b>Work environment authority Regulation 2018:1 (Sweden, 2/2018).</b>
	TWA: 1 mg/m <sup>3</sup> 8 hours. Form: mist and fume STEL: 3 mg/m <sup>3</sup> 15 minutes. Form: mist and fume

## Recommended monitoring procedures

If this product contains ingredients with exposure limits, personal, workplace atmosphere or biological monitoring may be required to determine the effectiveness of the ventilation or other control measures and/or the necessity to use respiratory protective equipment. Reference should be made to monitoring standards, such as the following: European Standard EN 689 (Workplace atmospheres - Guidance for the assessment of exposure by inhalation to chemical agents for comparison with limit values and measurement strategy) European Standard EN 14042 (Workplace atmospheres - Guide for the application and use of procedures for the assessment of exposure to chemical and biological agents) European Standard EN 482 (Workplace atmospheres - General requirements for the performance of procedures for the measurement of chemical agents) Reference to national guidance documents for methods for the determination of hazardous substances will also be required.

## DNELs/DMELs

Product/ingredient name	Type	Exposure	Value	Population	Effects
Distillate (petroleum), hydrotreated light naphthenic	DNEL	Long term Inhalation	5,58 mg/m <sup>3</sup>	Workers	Local
Distillates (petroleum), hydrotreated light paraffinic	DNEL	Long term Inhalation	5,58 mg/m <sup>3</sup>	Workers	Local
Distillate (petroleum), hydrotreated heavy paraffinic	DNEL	Long term Inhalation	5,58 mg/m <sup>3</sup>	Workers	Local
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	DNEL	Long term Inhalation	5,58 mg/m <sup>3</sup>	Workers	Local

## PNECs

No PNECs available

## PNEC Summary

Hydrocarbon Block Method (Petrisk)

## 8.2 Exposure controls

## Appropriate engineering controls

Mechanical ventilation and local exhaust will reduce exposure via the air. Use oil resistant material in construction of handling equipment. Store under recommended conditions and if heated, temperature control equipment should be used to avoid overheating.

## Individual protection measures

## Hygiene measures

Wash hands, forearms and face thoroughly after handling chemical products, before eating, smoking and using the lavatory and at the end of the working period. Ensure that eyewash stations and safety showers are close to the workstation location. Wash contaminated clothing before reuse.

## Eye/face protection

Recommended: Safety glasses with side shields.

## Skin protection

## Hand protection

4 - 8 hours (breakthrough time): nitrile rubber

## Body protection

Wear protective clothing if there is a risk of skin contact. Change contaminated clothes at the end of working shift.

## Other skin protection

Appropriate footwear and any additional skin protection measures should be selected based on the task being performed and the risks involved and should be approved by a specialist before handling this product.

**SECTION 8: Exposure controls/personal protection**

Respiratory protection	Respirator selection must be based on known or anticipated exposure levels, the hazards of the product and the safe working limits of the selected respirator. Use a properly fitted, particulate filter respirator complying with an approved standard if a risk assessment indicates this is necessary.
Environmental exposure controls	Emissions from ventilation or work process equipment should be checked to ensure they comply with the requirements of environmental protection legislation. In some cases, fume scrubbers, filters or engineering modifications to the process equipment will be necessary to reduce emissions to acceptable levels.

**SECTION 9: Physical and chemical properties**

## 9.1 Information on basic physical and chemical properties

Appearance

Physical state	Liquid.
Colour	Light yellow
Odour	Odourless/Light petroleum.
Odour threshold	Not available.
pH	Not applicable.
Melting point/freezing point	-51°C
Initial boiling point and boiling range	Not available.
Flash point	Closed cup: >140°C [Pensky-Martens.]
Evaporation rate	Not available.
Flammability (solid, gas)	Not available.
Upper/lower flammability or explosive limits	Not available.
Vapour pressure (Calculated)	<0,01 kPa [room temperature]
Density	0,88 g/cm <sup>3</sup> [15°C]
Solubility(ies)	Insoluble in water.
Partition coefficient: n-octanol/water	Not available.
Auto-ignition temperature	200°C
Decomposition temperature	>280°C
Viscosity	Kinematic (40°C): 0,096 cm <sup>2</sup> /s (9,6 cSt)
Explosive properties	Not available.
Oxidising properties	Not available.
DMSO extractable compounds for base oil substance(s) according to IP346	< 3%

**SECTION 10: Stability and reactivity**

10.1 Reactivity	No specific test data related to reactivity available for this product or its ingredients.
10.2 Chemical stability	Stable under normal conditions.
10.3 Possibility of hazardous reactions	Under normal conditions of storage and use, hazardous reactions will not occur.
10.4 Conditions to avoid	Keep away from extreme heat and oxidizing agents. Take precautionary measures against static discharge.
10.5 Incompatible materials	Oxidizing agent

## SECTION 10: Stability and reactivity

10.6 Hazardous decomposition products

Incomplete combustion is likely to give rise to a complex mixture of airborne solid and liquid particulates, gases, including carbon monoxide, H<sub>2</sub>S, SO<sub>x</sub> (sulfur oxides) or sulfuric acid and unidentified organic and inorganic compounds.

## SECTION 11: Toxicological information

## 11.1 Information on toxicological effects

## Acute toxicity

Product/ingredient name	Result	Species	Dose	Exposure	Remarks
Distillates (petroleum), hydrotreated light naphthenic	LC50 Inhalation Dusts and mists	Rat	>5,53 mg/l	4 hours	EMBSI 1988 (similar material)
	LD50 Dermal	Rabbit	>5000 mg/kg	-	API 1982 (similar material)
	LD50 Oral	Rat	>5000 mg/kg	-	API 1982 (similar material)
Distillates (petroleum), hydrotreated light paraffinic	LC50 Inhalation Dusts and mists	Rat	>5,53 mg/l	4 hours	EMBSI 1988 (similar material)
	LD50 Dermal	Rabbit	>5000 mg/kg	-	API 1982 (similar material)
	LD50 Oral	Rat	>5000 mg/kg	-	API 1982 (similar material)
Distillates (petroleum), hydrotreated heavy paraffinic	LC50 Inhalation Dusts and mists	Rat	>5,53 mg/l	4 hours	EMBSI 1988 (similar material)
	LD50 Dermal	Rabbit	>5000 mg/kg	-	API 1982 (similar material)
	LD50 Oral	Rat	>5000 mg/kg	-	API 1982 (similar material)
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	LC50 Inhalation Dusts and mists	Rat - Male, Female	>5,53 mg/l	4 hours	EMBSI 1988 (similar material)
	LD50 Dermal	Rabbit	>5000 mg/kg	-	API 1982 (similar material)
	LD50 Oral	Rat	>5000 mg/kg	-	API 1982 (similar material)

## Conclusion/Summary

Based on available data, the classification criteria are not met.

## Acute toxicity estimates

N/A

## Irritation/Corrosion

Product/ingredient name	Result	Species	Score	Observation	Remarks
Distillates (petroleum), hydrotreated light naphthenic	Skin - Non-irritant to skin.	Rabbit	0 to 1	24 to 72 hours	API 1982 (similar material)
	Eyes - Non-irritating to the eyes.	Rabbit	0 to 0,11	24 to 72 hours	API 1982 (similar material)
Distillates (petroleum), hydrotreated light paraffinic	Skin - Non-irritant to skin.	Rabbit	0 to 1	24 to 72 hours	API 1982 (similar material)
	Eyes - Non-irritating to the eyes.	Rabbit	0 to 0,11	24 to 72 hours	API 1982 (similar material)
Distillates (petroleum), hydrotreated heavy paraffinic	Skin - Non-irritant to skin.	Rabbit	0 to 1	24 to 72 hours	API 1982 (similar material)
	Eyes - Non-irritating to the eyes.	Rabbit	0 to 0,11	24 to 72 hours	API 1982 (similar material)

## SECTION 11: Toxicological information

Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	eyes. Skin - Non-irritant to skin.	Rabbit	0 to 1	hours 24 to 72 hours	material) API 1982 (similar material)
	Eyes - Non-irritating to the eyes.	Rabbit	0 to 0,11	24 to 72 hours	API 1982(similar material)

Skin Based on available data, the classification criteria are not met.

Eyes Based on available data, the classification criteria are not met.

Respiratory Based on available data, the classification criteria are not met.

Sensitisation

Product/ingredient name	Route of exposure	Species	Result	Remarks
Distillates (petroleum), hydrotreated light naphthenic	skin	Guinea pig	Not sensitizing	API 1982(similar material)
Distillates (petroleum), hydrotreated light paraffinic	skin	Guinea pig	Not sensitizing	API 1982(similar material)
Distillates (petroleum), hydrotreated heavy paraffinic	skin	Guinea pig	Not sensitizing	API 1982 (similar material)
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	skin	Guinea pig	Not sensitizing	UBTL 1984j,k,l (similar material)

Skin Based on available data, the classification criteria are not met.

Respiratory Based on available data, the classification criteria are not met.

Mutagenicity

Conclusion/Summary Based on available data, the classification criteria are not met.

Carcinogenicity

Conclusion/Summary The base oil(s) in this product is based on an severely hydrotreated distillate. The product should not be regarded as a carcinogen.

Reproductive toxicity

Conclusion/Summary Based on available data, the classification criteria are not met.

Teratogenicity

Conclusion/Summary Based on available data, the classification criteria are not met.

Aspiration hazard

Product/ingredient name	Result
Distillates (petroleum), hydrotreated light naphthenic	ASPIRATION HAZARD - Category 1
Distillates (petroleum), hydrotreated light paraffinic	ASPIRATION HAZARD - Category 1
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	ASPIRATION HAZARD - Category 1

Potential chronic health effects

Product/ingredient name	Result	Species	Dose	Exposure
Distillate (petroleum), hydrotreated light naphthenic	Sub-chronic LOAEL Oral	Rat	125 mg/kg	-
	Sub-chronic NOAEL Dermal	Rat	>2000 mg/kg	-
	Sub-acute NOEL Inhalation	Rat	220 mg/m <sup>3</sup>	6 hours; 5 days per week
	Dusts and mists	Rat	125 mg/kg	-
Distillates (petroleum), hydrotreated light paraffinic	Sub-chronic LOAEL Oral	Rat	125 mg/kg	-
	Sub-chronic NOAEL Dermal	Rat	>2000 mg/kg	-
	Sub-acute NOEL Inhalation	Rat	220 mg/m <sup>3</sup>	6 hours; 5 days per week
	Dusts and mists	Rat		

## SECTION 11: Toxicological information

Distillate (petroleum), hydrotreated heavy paraffinic	Sub-chronic LOAEL Oral	Rat	125 mg/kg	-
	Sub-chronic NOAEL Dermal	Rat	>2000 mg/kg	-
	Sub-acute NOEL Inhalation Dusts and mists	Rat	220 mg/m <sup>3</sup>	6 hours; 5 days per week
	Sub-chronic LOAEL Oral	Rabbit	125 mg/kg	-
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	Sub-chronic NOAEL Dermal	Rat	>2000 mg/kg	-
	Sub-chronic NOEL Inhalation Dusts and mists	Rat	220 mg/m <sup>3</sup>	6 hours; 5 days per week

Specific hazard

## Aspiration hazard

Aspiration means the entry of a liquid substance directly into the trachea and lower respiratory tract.

Aspiration of hydrocarbon substances can result in severe acute effects such as chemical pneumonitis, varying degree of pulmonary injury or death.

This property relates to the potential for low viscosity material to spread quickly into the deep lung and cause severe pulmonary tissue damage.

Classification of a hydrocarbon substance for aspiration hazard is made on the basis of reliable human evidence or on the basis of physical properties.

## SECTION 12: Ecological information

## 12.1 Toxicity

Product/ingredient name	Result	Species	Exposure
Distillates (petroleum), hydrotreated light naphthenic	Acute EL50 >10000 mg/l	Daphnia	48 hours
Distillates (petroleum), hydrotreated light paraffinic	Acute LL50 >100 mg/l	Fish	96 hours
	Acute NOEL >100 mg/l	Algae	72 hours
	Chronic NOEL 10 mg/l Fresh water	Daphnia	21 days
	Acute EL50 >10000 mg/l	Daphnia	48 hours
Distillates (petroleum), hydrotreated heavy paraffinic	Acute LL50 >100 mg/l	Fish	96 hours
	Acute NOEL >100 mg/l	Algae	72 hours
	Chronic NOEL 10 mg/l Fresh water	Daphnia	21 days
	Acute EL50 >1000 mg/l	Daphnia	48 hours
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	Acute LL50 >100 mg/l	Fish	96 hours
	Acute NOEL >100 mg/l	Algae	72 hours
	Chronic NOEL 10 mg/l Fresh water	Daphnia	21 days
	Acute EL50 >10000 mg/l	Daphnia	48 hours
	Acute LL50 >100 mg/l	Fish	96 hours
	Acute NOEL >100 mg/l	Algae	72 hours
	Chronic NOEL 10 mg/l Fresh water	Daphnia	21 days

## Conclusion/Summary

Based on available data, the classification criteria are not met.

## 12.2 Persistence and degradability

Product/ingredient name	Aquatic half-life	Photolysis	Biodegradability
Distillates (petroleum), hydrotreated light naphthenic	-	-	Inherent
Distillates (petroleum), hydrotreated light paraffinic	-	-	Inherent
Distillates (petroleum), hydrotreated heavy paraffinic	-	-	Inherent
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	-	-	Inherent

## Conclusion/Summary

Inherently biodegradable.

## SECTION 12: Ecological information

## 12.3 Bioaccumulative potential

Product/ingredient name	LogP <sub>ow</sub>	BCF	Potential
Distillates (petroleum), hydrotreated light naphthenic	2 to 6	<500	low
Distillates (petroleum), hydrotreated light paraffinic	2 to 6	<500	low
Distillates (petroleum), hydrotreated heavy paraffinic	2 to 6	<500	low
Lubricating oils (petroleum), C15-30, hydrotreated neutral oil-based	2 to 6	<500	low

Conclusion/Summary                      The product has a potential to bioaccumulate.

## 12.4 Mobility in soil

Mobility                                      High mobility in soil predicted, based on log Kow > 3.0.

## 12.5 Results of PBT and vPvB assessment

This mixture does not contain any substances that are assessed to be a PBT or a vPvB.

## 12.6 Other adverse effects

Insoluble in water. Spills may form a film on water surfaces causing physical damage to organisms. Oxygen transfer could also be impaired.

## SECTION 13: Disposal considerations

The information in this section contains generic advice and guidance. The list of Identified Uses in Section 1 should be consulted for any available use-specific information provided in the Exposure Scenario(s).

## 13.1 Waste treatment methods

Product

Methods of disposal                      Where possible (e.g. in the absence of relevant contamination), recycling of used substance is feasible and recommended. This substance can be burned or incinerated, subject to national/local authorizations, relevant contamination limits, safety regulations and air quality legislation. Contaminated or waste substance (not directly recyclable): Disposal can be carried out directly, or by delivery to qualified waste handlers. National legislation may identify a specific organization, and/or prescribe composition limits and methods for recovery or disposal.

Hazardous waste                              Yes.

European waste catalogue (EWC)

Waste code	Waste designation
13 03 07*	mineral-based non-chlorinated insulating and heat transmission oils

Packaging

Methods of disposal                      The generation of waste should be avoided or minimised wherever possible. Waste packaging should be recycled. Incineration or landfill should only be considered when recycling is not feasible.

## SECTION 14: Transport information

International transport regulations

## SECTION 14: Transport information

	ADR/RID	ADN	IMO/IMDG Classification	ICAO/IATA Classification
<b>14.1 UN number</b>	Not regulated.	Not regulated.	Not regulated.	Not regulated.
<b>14.2 UN proper shipping name</b>	-	-	-	-
<b>14.3 Transport hazard class(es)</b>	-	-	-	-
<b>14.4 Packing group</b>	-	-	-	-
<b>14.5 Environmental hazards</b>	No.	No.	No.	No.

**14.6 Special precautions for user**

**Transport within user's premises:** always transport in closed containers that are upright and secure. Ensure that persons transporting the product know what to do in the event of an accident or spillage.

**14.7 MARPOL Annex 1**

Oils

## SECTION 15: Regulatory information

## 15.1 Safety, health and environmental regulations/legislation specific for the substance or mixture

EU Regulation (EC) No. 1907/2006 (REACH)Annex XIV - List of substances subject to authorisation

None of the components are listed.

Substances of very high concern

None of the components are listed.

Annex XVII - Restrictions on the manufacture, placing on the market and use of certain dangerous substances, mixtures and articles

Not applicable.

Other EU regulations

Industrial emissions (integrated pollution prevention and control) - Air

Not listed

Industrial emissions (integrated pollution prevention and control) - Water

Not listed

Ozone depleting substances (1005/2009/EU)

Not listed.

Prior Informed Consent (PIC) (649/2012/EU)

Not listed.

Seveso Directive

This product is not controlled under the Seveso Directive.

National inventory

Australia

All components are listed or exempted.

Canada

All components are listed or exempted.



## SECTION 15: Regulatory information

China	All components are listed or exempted.
Japan	<b>Japan inventory (ENCS):</b> Not determined. <b>Japan inventory (ISHL):</b> All components are listed or exempted.
New Zealand	All components are listed or exempted.
Philippines	All components are listed or exempted.
Republic of Korea	All components are listed or exempted.
Taiwan	All components are listed or exempted.
United States	All components are listed or exempted.
Thailand	Not determined.
Turkey	All components are listed or exempted.
Viet Nam	Not determined.

15.2 Chemical safety assessment Complete.

## SECTION 16: Other information

Revision comments Not available.

Indicates information that has changed from previously issued version.

Abbreviations and acronyms ATE = Acute Toxicity Estimate  
CLP = Classification, Labelling and Packaging Regulation [Regulation (EC) No. 1272/2008]  
DMEL = Derived Minimal Effect Level  
DNEL = Derived No Effect Level  
EUH statement = CLP-specific Hazard statement  
N/A = Not available  
PBT = Persistent, Bioaccumulative and Toxic  
PNEC = Predicted No Effect Concentration  
RRN = REACH Registration Number  
SGG = Segregation Group  
vPvB = Very Persistent and Very Bioaccumulative

Procedure used to derive the classification according to Regulation (EC) No. 1272/2008 [CLP/GHS]

Classification	Justification
Asp. Tox. 1, H304	Calculation method

### Sweden

Full text of abbreviated H statements	H304	May be fatal if swallowed and enters airways.
Full text of classifications [CLP/ GHS]	Asp. Tox. 1, H304	ASPIRATION HAZARD - Category 1
Date of printing	2019-10-21	
Date of issue/ Date of revision	2019-10-21	
Date of previous issue	2018-11-07	
Version	5	

### Notice to reader

To the best of our knowledge, the information contained herein is accurate. However, neither the above-named supplier, nor any of its subsidiaries, assumes any liability whatsoever for the accuracy or completeness of the information contained herein.

Final determination of suitability of any material is the sole responsibility of the user. All materials may present unknown hazards and should be used with caution. Although certain hazards are described herein, we cannot guarantee that these are the only hazards that exist.

The information provided herein does not in any way constitute a product warranty, product specification, agreement on quality or similar.

NYNAS®, NYFLEX®, NYTEX®, NYTRO®, NYBASE®, NYFROST™, NYFERT™, NYPAR™, NYPASS™, NYPRINT™, NYSPRAY™, NYHIB™, NYSWITCHO™, DISTRO™ and Nynas Logo are trademarks of Nynas.



## Section 1 - Title

Short title of the exposure scenario	Distribution of substance - Industrial
List of use descriptors	<b>Identified use name:</b> Distribution of substance - Industrial <b>Process Category:</b> PROC01, PROC02, PROC03, PROC04, PROC08a, PROC08b, PROC09, PROC15 <b>Subsequent service life relevant for that use:</b> No. <b>Environmental Release Category:</b> ERC04, ERC05, ERC06a, ERC06b, ERC06c, ERC06d, ERC07, ESVOC SpERC 1.1b.v1
Environmental contributing scenarios	<b>Use of non-reactive processing aid at industrial site (no inclusion into or onto article) - ERC04</b> <b>Use of reactive processing aid at industrial site (no inclusion into or onto article) - ERC06b</b> <b>Use of monomer in polymerisation processes at industrial site (inclusion or not into/onto article) - ERC06c</b> <b>Use of reactive process regulators in polymerisation processes at industrial site (inclusion or not into/onto article) - ERC06d</b> <b>Use of functional fluid at industrial site - ERC07</b> <b>Use of intermediate - ERC06a</b> <b>Use at industrial site leading to inclusion into/onto article - ERC05</b>
Health Contributing scenarios	<b>General exposures (open systems) - PROC04</b> <b>General exposures (closed systems) - PROC01, PROC02, PROC03</b> <b>With sample collection - PROC03</b> <b>Laboratory activities - PROC15</b> <b>Bulk transfers - PROC08b</b> <b>Drum and small package filling - PROC09</b> <b>Clean-down and maintenance of equipment - PROC08a</b> <b>Storage - PROC01, PROC02</b>
Industry Association	Concawe - 2017
Processes and activities covered by the exposure scenario	Bulk loading (including marine vessel/barge, rail/road car and IBC loading) of substance within closed or contained systems, including incidental exposures during its sampling, storage, unloading, maintenance and associated laboratory activities.

## Section 2 - Exposure controls

### 2.1 Control of environmental exposure

Amounts used	Annual site tonnage (tonnes/year) 28 Maximum daily site tonnage (kg/day) 1400
Frequency and duration of use	Continuous release Emission days (days per year) 20
Other conditions affecting environmental exposure	Release fraction to air from process (initial release prior to RMM) 0.0001 Release fraction to wastewater from process (initial release prior to RMM) 1.0E-7 Release fraction to soil from process (initial release prior to RMM) 1.0E-5
<u>Technical on-site conditions and measures to reduce or limit discharges, air emissions and releases to soil</u>	Prevent discharge of undissolved substance to or recover from onsite wastewater. If discharging to domestic sewage treatment plant, no onsite wastewater treatment required.
Risk management measures - Air	Treat air emissions. (%) 90
Organisational measures to prevent/limit release from site	Do not apply industrial sludge to natural soils. Sewage sludge should be incinerated, contained or reclaimed.

## Section 2 - Exposure controls

<u>Conditions and measures related to sewage treatment plant</u>	<p>Estimated substance removal from wastewater via domestic sewage treatment (%) 94,2</p> <p>Total efficiency of removal from wastewater after on-site and off-site (municipal treatment plant) RMMs (%) 94,2</p> <p>Maximum allowable site tonnage (<math>M_{\text{Safe}}</math>) based on release following total wastewater treatment removal (kg/day) 45000</p> <p>Assumed on-site sewage treatment plant flow (<math>\text{m}^3/\text{d}</math>) 2000</p>
--	--

### 2.2 Control of worker exposure

#### General measures applicable to all activities

Concentration of substance in mixture or article	Covers percentage substance in the product up to 100 %.
Frequency and duration of use	Covers daily exposures up to 8 hours
Other conditions affecting workers exposure	Assumes a good basic standard of occupational hygiene is implemented Assumes use at not more than 20°C above ambient temperature. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

#### Risk management measures (RMM)

Clean-down and maintenance of equipment - PROC 8a  
 Drain down system prior to equipment break-in or maintenance.

Storage - PROC 1 & 2  
 Store substance within a closed system.

## Section 3 - Exposure estimation and reference to its source

### 3.1 Environment

Exposure assessment (environment):	<p>The Hydrocarbon Block Method has been used to calculate environmental exposure with the Petrorisk model.</p> <p>Risk Characterisation Ratio (RCR) air 0.009</p> <p>Risk Characterisation Ratio (RCR) water 0.077</p>
------------------------------------	---

### 3.2 Workers

Exposure assessment (human):	Qualitative approach used to conclude safe use.
Exposure estimation and reference to its source	A DNEL (derived no effect levels) cannot be derived. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

## Section 1 - Title

Short title of the exposure scenario	Formulation and (re)packing of substances and mixtures - Industrial
List of use descriptors	<b>Identified use name:</b> Formulation and (re)packing of substances and mixtures - Industrial <b>Process Category:</b> PROC01, PROC02, PROC03, PROC04, PROC05, PROC08a, PROC08b, PROC09, PROC14, PROC15 <b>Subsequent service life relevant for that use:</b> No. <b>Environmental Release Category:</b> ERC02, ESVOC SpERC 2.2.v1 <b>Formulation into mixture - ERC02</b>
Environmental contributing scenarios	
Health Contributing scenarios	<b>General exposures (open systems) - PROC04</b> <b>General exposures (closed systems) - PROC01, PROC02, PROC03</b> <b>Batch processes at elevated temperatures - PROC03</b> <b>With sample collection - PROC03</b> <b>Laboratory activities - PROC15</b> <b>Bulk transfers - PROC08b</b> <b>Mixing operations (open systems) - PROC05</b> <b>Transfer from/pouring from containers - PROC08a</b> <b>Drum/batch transfers - PROC08b</b> <b>Tabletting, compression, extrusion or pelletisation - PROC14</b> <b>Drum and small package filling - PROC09</b> <b>Clean-down and maintenance of equipment - PROC08a</b> <b>Storage - PROC01, PROC02</b>

Industry Association	Concawe - 2017
Processes and activities covered by the exposure scenario	Formulation, packing and re-packing of the substance and its mixtures in batch or continuous operations, including storage, materials transfers, mixing, tabletting, compression, pelletisation, extrusion, large and small scale packing, sampling, maintenance and associated laboratory activities.

## Section 2 - Exposure controls

### 2.1 Control of environmental exposure

Amounts used	Annual site tonnage (tonnes/year) 13000 Maximum daily site tonnage (kg/day) 42000
Frequency and duration of use	Continuous release Emission days (days per year) 300
Other conditions affecting environmental exposure	Release fraction to air from process (initial release prior to RMM) 0.0025 Release fraction to wastewater from process (initial release prior to RMM) 5.0E-6 Release fraction to soil from process (initial release prior to RMM) 0.0001
<u>Technical on-site conditions and measures to reduce or limit discharges, air emissions and releases to soil</u>	Prevent discharge of undissolved substance to or recover from onsite wastewater. If discharging to domestic sewage treatment plant, no onsite wastewater treatment required.
Risk management measures - Water	Treat on-site wastewater (prior to receiving water discharge) to provide the required removal efficiency of (%) 85,7
Organisational measures to prevent/limit release from site	Do not apply industrial sludge to natural soils. Sewage sludge should be incinerated, contained or reclaimed.

## Section 2 - Exposure controls

### Conditions and measures related to sewage treatment plant

Estimated substance removal from wastewater via domestic sewage treatment (%) 94,2  
 Total efficiency of removal from wastewater after on-site and off-site (municipal treatment plant) RMMs (%) 94,2  
 Maximum allowable site tonnage ( $M_{\text{safe}}$ ) based on release following total wastewater treatment removal (kg/day) 67000  
 Assumed on-site sewage treatment plant flow ( $\text{m}^3/\text{d}$ ) 2000

### 2.2 Control of worker exposure

#### General measures applicable to all activities

Concentration of substance in mixture or article	Covers percentage substance in the product up to 100 %.
Frequency and duration of use	Covers daily exposures up to 8 hours
Other conditions affecting workers exposure	Assumes a good basic standard of occupational hygiene is implemented Assumes use at not more than 20°C above ambient temperature. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

#### Risk management measures (RMM)

Clean-down and maintenance of equipment - PROC 8a  
 Drain down system prior to equipment break-in or maintenance.

Storage - PROC 1 & 2  
 Store substance within a closed system.

## Section 3 - Exposure estimation and reference to its source

### 3.1 Environment

Exposure assessment (environment):	The Hydrocarbon Block Method has been used to calculate environmental exposure with the Petrorisk model. Risk Characterisation Ratio (RCR) air 0.11 Risk Characterisation Ratio (RCR) water 0.87
------------------------------------	--

### 3.2 Workers

Exposure assessment (human):	Qualitative approach used to conclude safe use.
Exposure estimation and reference to its source	A DNEL (derived no effect levels) cannot be derived. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

## Section 1 - Title

Short title of the exposure scenario	Use in functional fluids - Industrial
List of use descriptors	<b>Identified use name:</b> Use in functional fluids - Industrial <b>Process Category:</b> PROC01, PROC02, PROC03, PROC04, PROC08a, PROC08b, PROC09 <b>Subsequent service life relevant for that use:</b> No. <b>Environmental Release Category:</b> ERC07
Environmental contributing scenarios	<b>Use of functional fluid at industrial site - ERC07</b>
Health Contributing scenarios	<b>General exposures (closed systems) - PROC02</b> <b>Bulk transfers - PROC01, PROC02, PROC03</b> <b>Storage - PROC01, PROC02</b> <b>Drum/batch transfers - PROC08b</b> <b>Filling of articles/equipment - PROC09</b> <b>Filling of equipment from drums or containers - PROC08a</b> <b>General exposures (open systems) - PROC04</b> <b>Remanufacture of reject articles - PROC09</b>
Industry Association	Concawe - 2017
Processes and activities covered by the exposure scenario	Use as functional fluids e.g. cable oils, transfer oils, coolants, insulators, refrigerants, hydraulic fluids in industrial equipment including maintenance and related material transfers.

## Section 2 - Exposure controls

### 2.1 Control of environmental exposure

Amounts used	Annual site tonnage (tonnes/year) 10 Maximum daily site tonnage (kg/day) 500
Frequency and duration of use	Continuous release Emission days (days per year) 20
Other conditions affecting environmental exposure	Release fraction to air from process (initial release prior to RMM) 0.0005 Release fraction to wastewater from process (initial release prior to RMM) 1.0E-6 Release fraction to soil from process (initial release prior to RMM) 0.001
<u>Technical on-site conditions and measures to reduce or limit discharges, air emissions and releases to soil</u>	Prevent discharge of undissolved substance to or recover from onsite wastewater. If discharging to domestic sewage treatment plant, no onsite wastewater treatment required.
Organisational measures to prevent/limit release from site	Do not apply industrial sludge to natural soils. Sewage sludge should be incinerated, contained or reclaimed.
<u>Conditions and measures related to sewage treatment plant</u>	Estimated substance removal from wastewater via domestic sewage treatment (%) 94,2 Total efficiency of removal from wastewater after on-site and off-site (municipal treatment plant) RMMs (%) 94,2 Maximum allowable site tonnage ( $M_{\text{safe}}$ ) based on release following total wastewater treatment removal (kg/day) 8100 Assumed on-site sewage treatment plant flow ( $\text{m}^3/\text{d}$ ) 2000

### 2.2 Control of worker exposure

#### General measures applicable to all activities

Frequency and duration of use	Covers daily exposures up to 8 hours
-------------------------------	--------------------------------------

## Section 2 - Exposure controls

Other conditions affecting workers exposure	Assumes a good basic standard of occupational hygiene is implemented Assumes use at not more than 20°C above ambient temperature. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.
---	--

### Risk management measures (RMM)

General exposures (open systems), Elevated temperature - PROC 04  
Restrict area of openings to equipment. Provide extract ventilation to points where emissions occur. Local exhaust ventilation - efficiency of at least 90 %.

Clean-down and maintenance of equipment - PROC 8a  
Drain down system prior to equipment break-in or maintenance.

Storage - PROC 1, 2  
Store substance within a closed system.

## Section 3 - Exposure estimation and reference to its source

### 3.1 Environment

Exposure assessment (environment):	Not available.
------------------------------------	----------------

### 3.2 Workers

Exposure assessment (human):	Qualitative approach used to conclude safe use.
Exposure estimation and reference to its source	A DNEL (derived no effect levels) cannot be derived. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

## Section 1 - Title

Short title of the exposure scenario	Use in functional fluids - Professional
List of use descriptors	<b>Identified use name:</b> Use in functional fluids - Professional <b>Process Category:</b> PROC01, PROC02, PROC03, PROC08a, PROC09, PROC20 <b>Subsequent service life relevant for that use:</b> No. <b>Environmental Release Category:</b> ERC09a, ERC09b, ESVOC SpERC 9.13b.v1
Environmental contributing scenarios	<b>Widespread use of functional fluid (outdoor)</b> - ERC09b <b>Widespread use of functional fluid (indoor)</b> - ERC09a
Health Contributing scenarios	<b>Drum/batch transfers</b> - PROC08a <b>Transfer from/pouring from containers</b> - PROC09 <b>Operation of equipment containing engine oils and similar</b> - PROC01, PROC02, PROC03, PROC20 <b>Remanufacture of reject articles</b> - PROC09 <b>Equipment cleaning and maintenance</b> - PROC08a <b>Storage</b> - PROC01, PROC02
Industry Association	Concawe - 2017
Processes and activities covered by the exposure scenario	Use as functional fluids e.g. cable oils, transfer oils, coolants, insulators, refrigerants, hydraulic fluids in industrial equipment including maintenance and related material transfers.

## Section 2 - Exposure controls

### 2.1 Control of environmental exposure

Amounts used	Annual site tonnage (tonnes/year) 0,016 Maximum daily site tonnage (kg/day) 0,044
Frequency and duration of use	Continuous release Emission days (days per year) 365
Other conditions affecting environmental exposure	Release fraction to air from process (initial release prior to RMM) 0.05 Release fraction to wastewater from process (initial release prior to RMM) 0.013 Release fraction to soil from process (initial release prior to RMM) 0.025
<u>Technical on-site conditions and measures to reduce or limit discharges, air emissions and releases to soil</u>	If discharging to domestic sewage treatment plant, no onsite wastewater treatment required.
Risk management measures - Water	Treat on-site wastewater (prior to receiving water discharge) to provide the required removal efficiency of (%) 38,5

### 2.2 Control of worker exposure

#### General measures applicable to all activities

Concentration of substance in mixture or article	Covers percentage substance in the product up to 100 %.
Frequency and duration of use	Covers daily exposures up to 8 hours
Other conditions affecting workers exposure	Assumes a good basic standard of occupational hygiene is implemented Assumes use at not more than 20°C above ambient temperature. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.

#### Risk management measures (RMM)

## Section 2 - Exposure controls

Drum/batch transfers - PROC 8a  
Use drum pumps.

Clean-down and maintenance of equipment - PROC 8a  
Drain down system prior to equipment break-in or maintenance.

Storage - PROC 1, 2  
Store substance within a closed system.

## Section 3 - Exposure estimation and reference to its source

### 3.1 Environment

Exposure assessment (environment):	Not available.
---------------------------------------	----------------

### 3.2 Workers

Exposure assessment (human):	Qualitative approach used to conclude safe use.
---------------------------------	---

Exposure estimation and reference to its source	A DNEL (derived no effect levels) cannot be derived. There are no routine anticipated exposures by ingestion related to any supported uses of the substance. The risk arising from aspiration hazard is solely related to the physico-chemical properties of the substance. The risk can therefore be controlled by implementing risk management measures tailored to this specific risk.
--	---





SECTION  
8

APPENDIX B

BUCHHOLZ RELAY:  
ABB/COMEM BS50LA

(MANUFACTURER DETAILS - 18 PAGES)




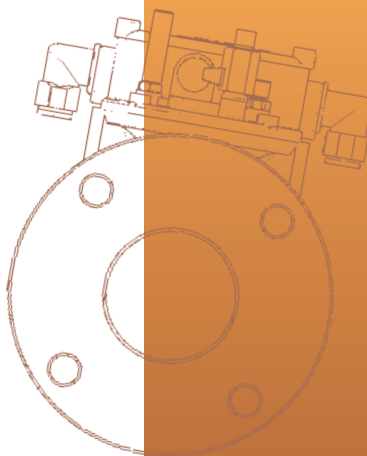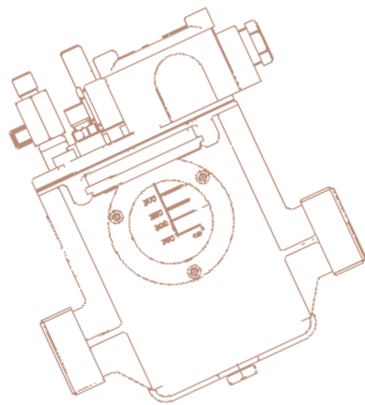


GAS-ACTUATED RELAYS  
**BUCHHOLZ** TYPE  
ACCORDING TO  
CENELEC EN 50216-2 STANDARD  
AND  
**GAS SAMPLING DEVICE**



## **GAS-ACTUATED RELAYS *BUCHHOLZ* TYPE**

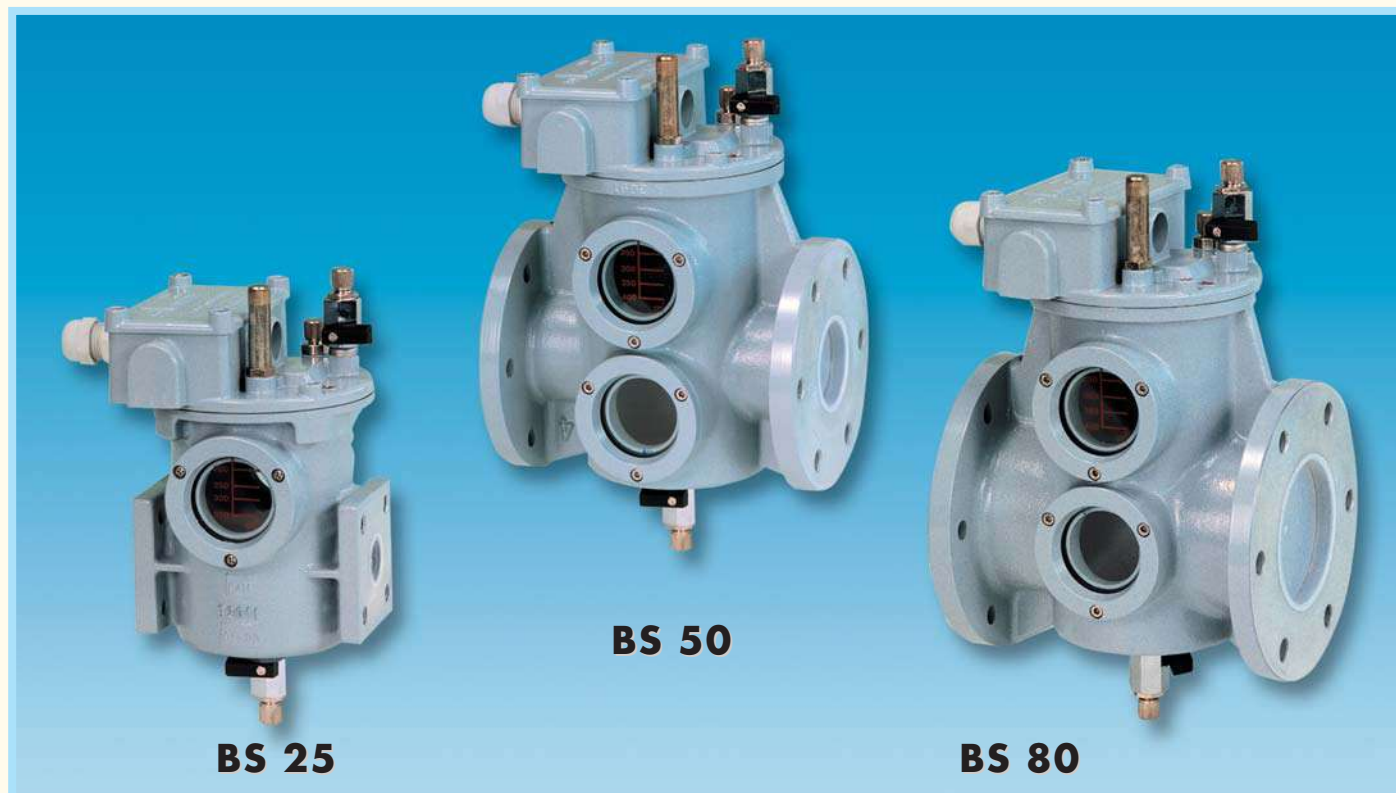

## **GAS-ACTUATED RELAYS *BUCHHOLZ* TYPE**

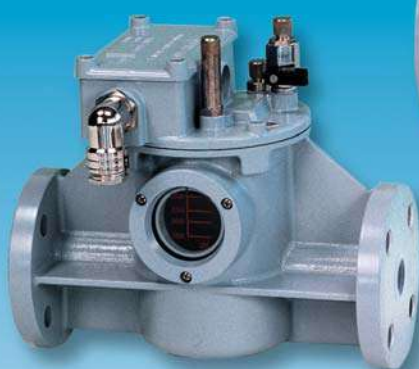

**NF 25**



**NF 50**




**NF 80**





**C 1**




**C 4**

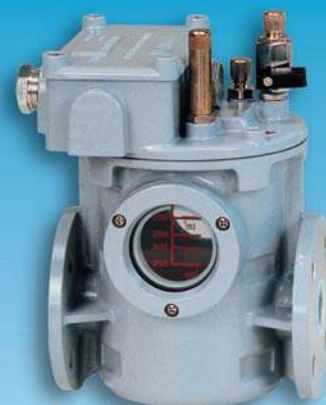



**C 01**

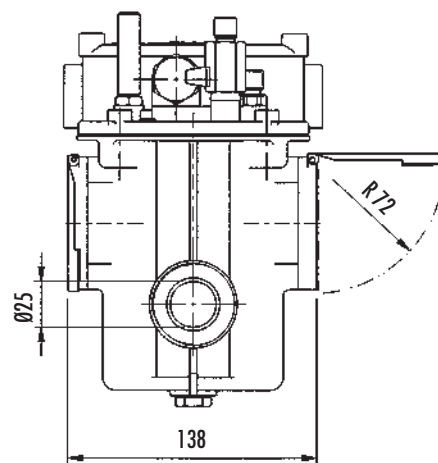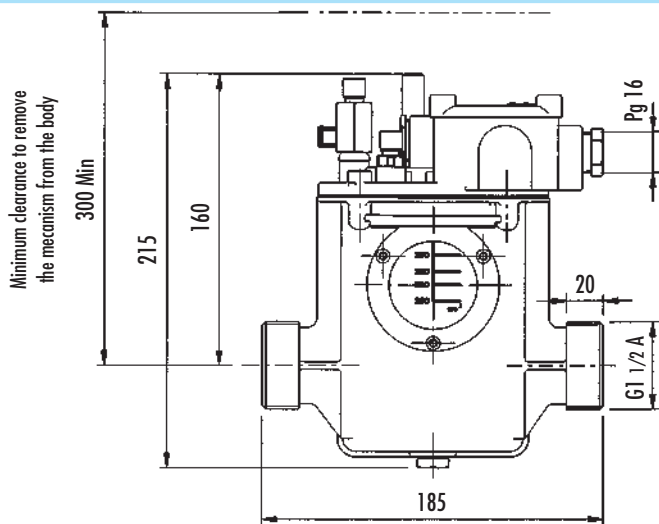


**BG 25**

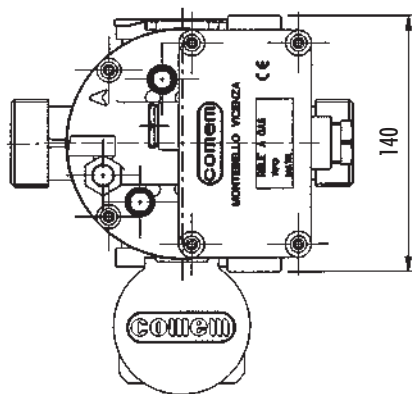

Weight **2.1 kg**

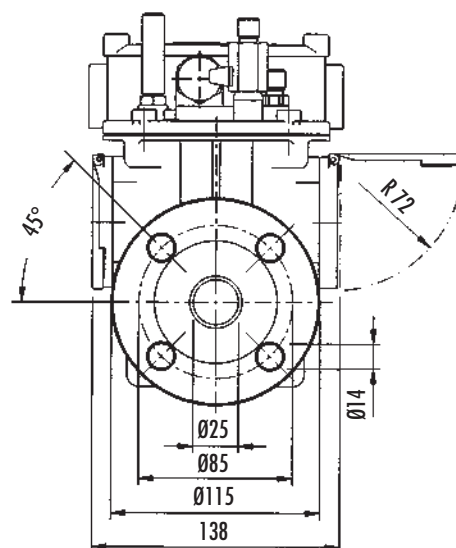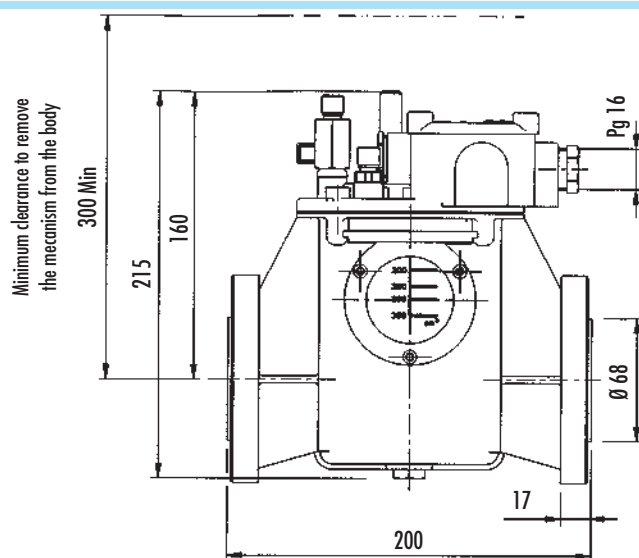


**BR 25**

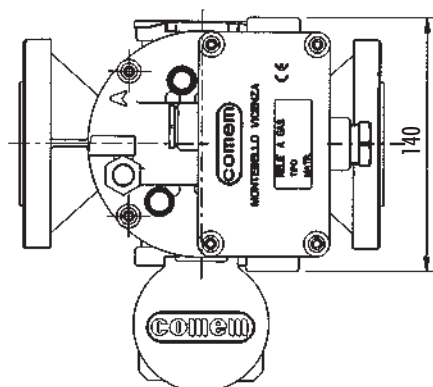

Weight **2.9 kg**




Minimum clearance to remove the mechanism from the body  
330 Min

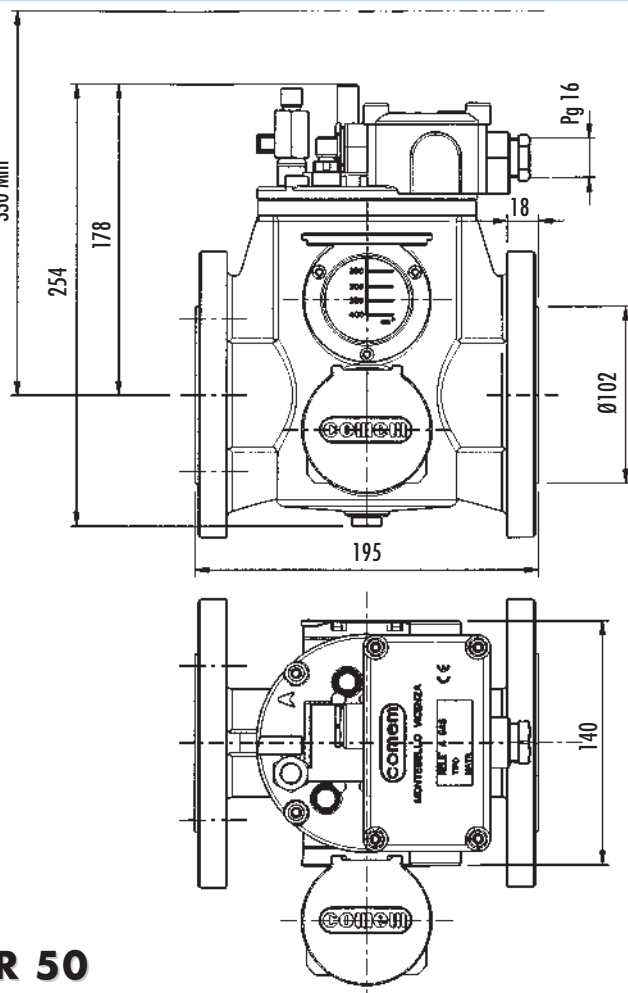

**BR 50**



Weight **4.9 kg**

Minimum clearance to remove the mechanism from the body  
400 Min


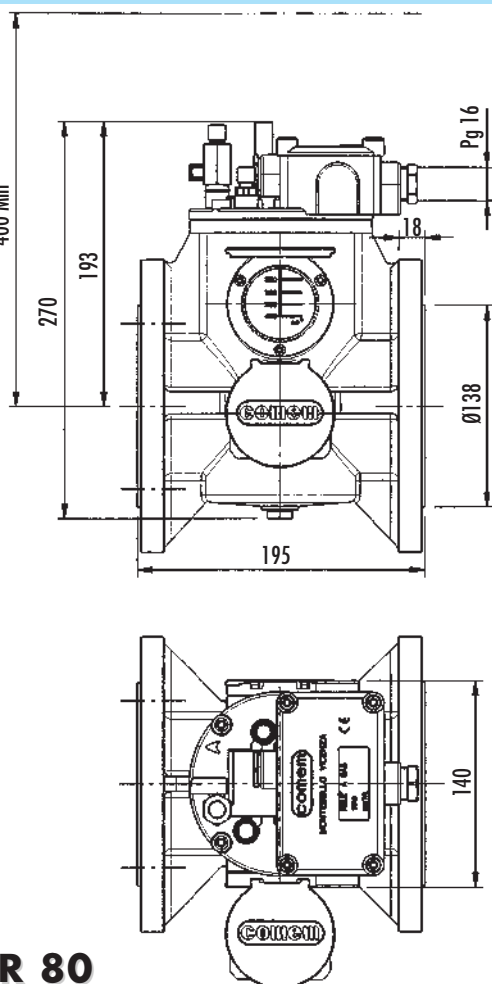


**BR 80**



AVAILABLE WITH N° 8 HOLES

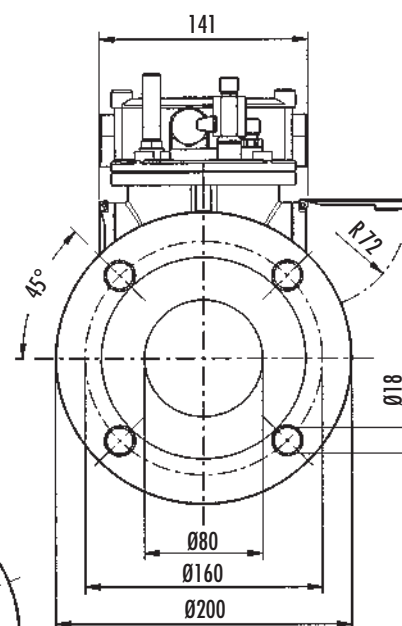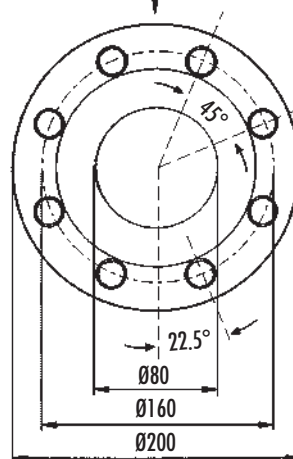

Weight **5.8 kg**

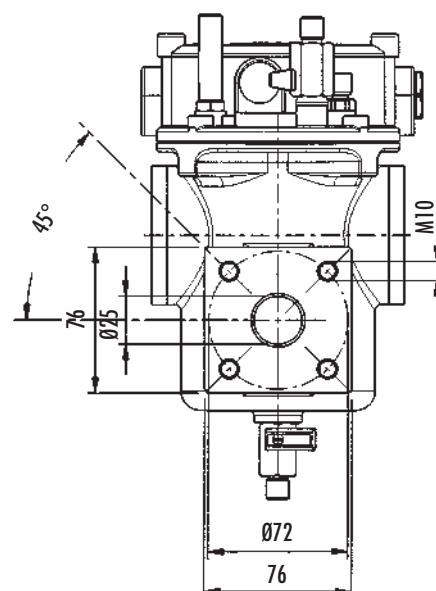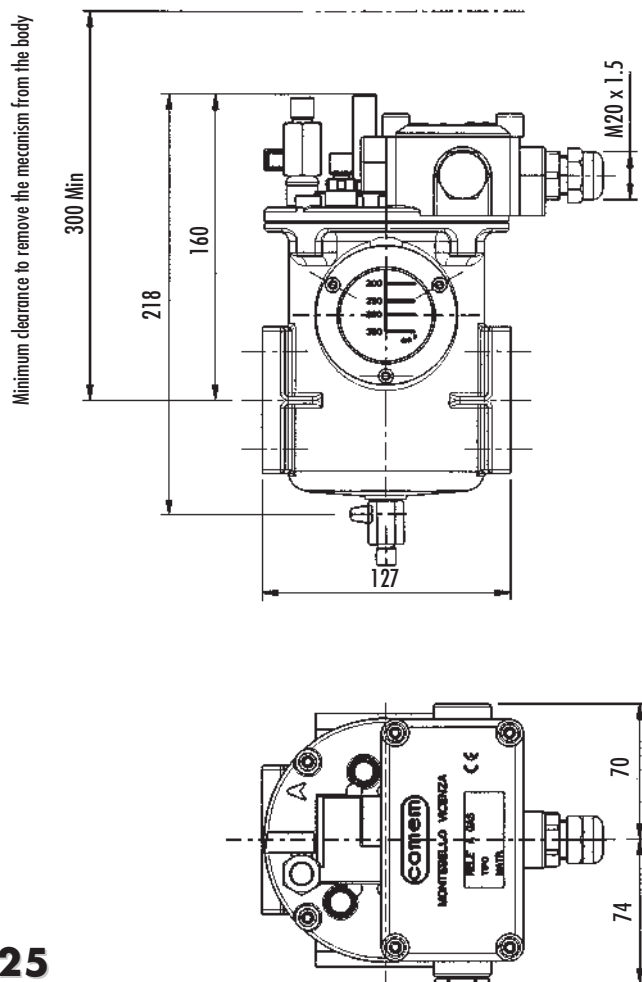
**BS 25**

**Weight** **2.2 kg**

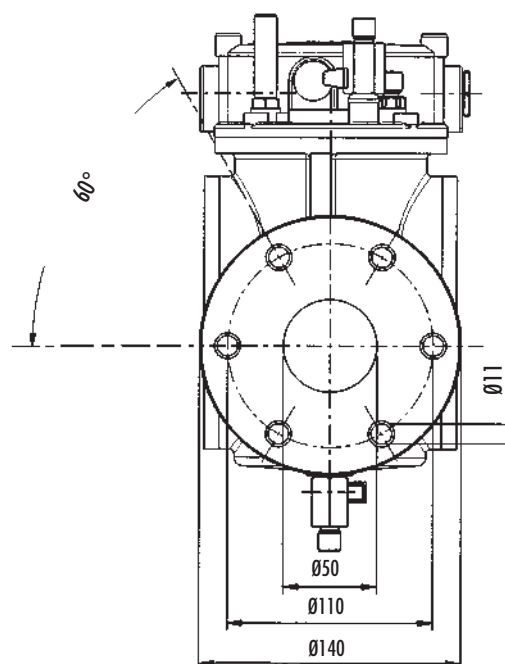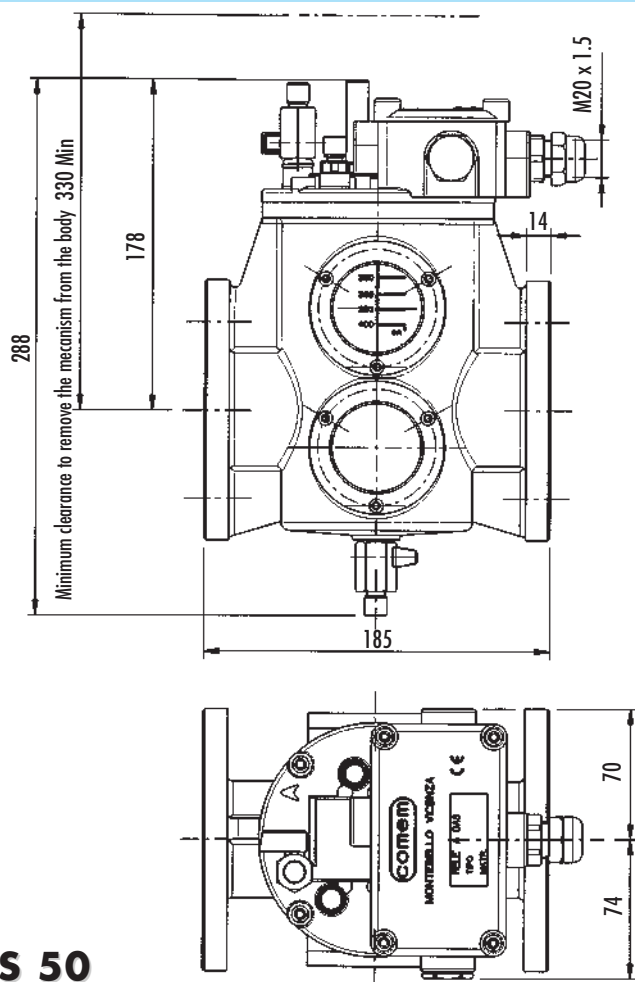**BS 50**


**Weight** **4.1 kg**

## BS 80

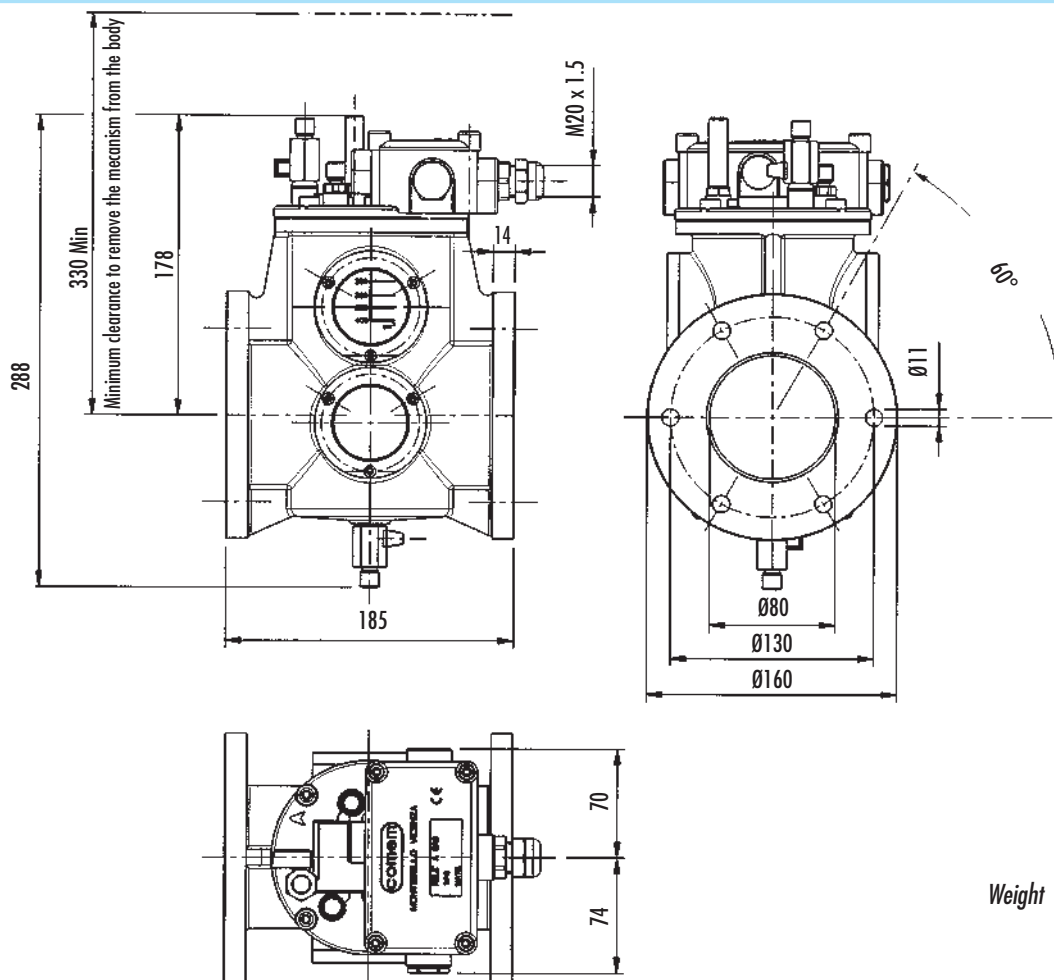

Weight **4.3 kg**


## NF 25

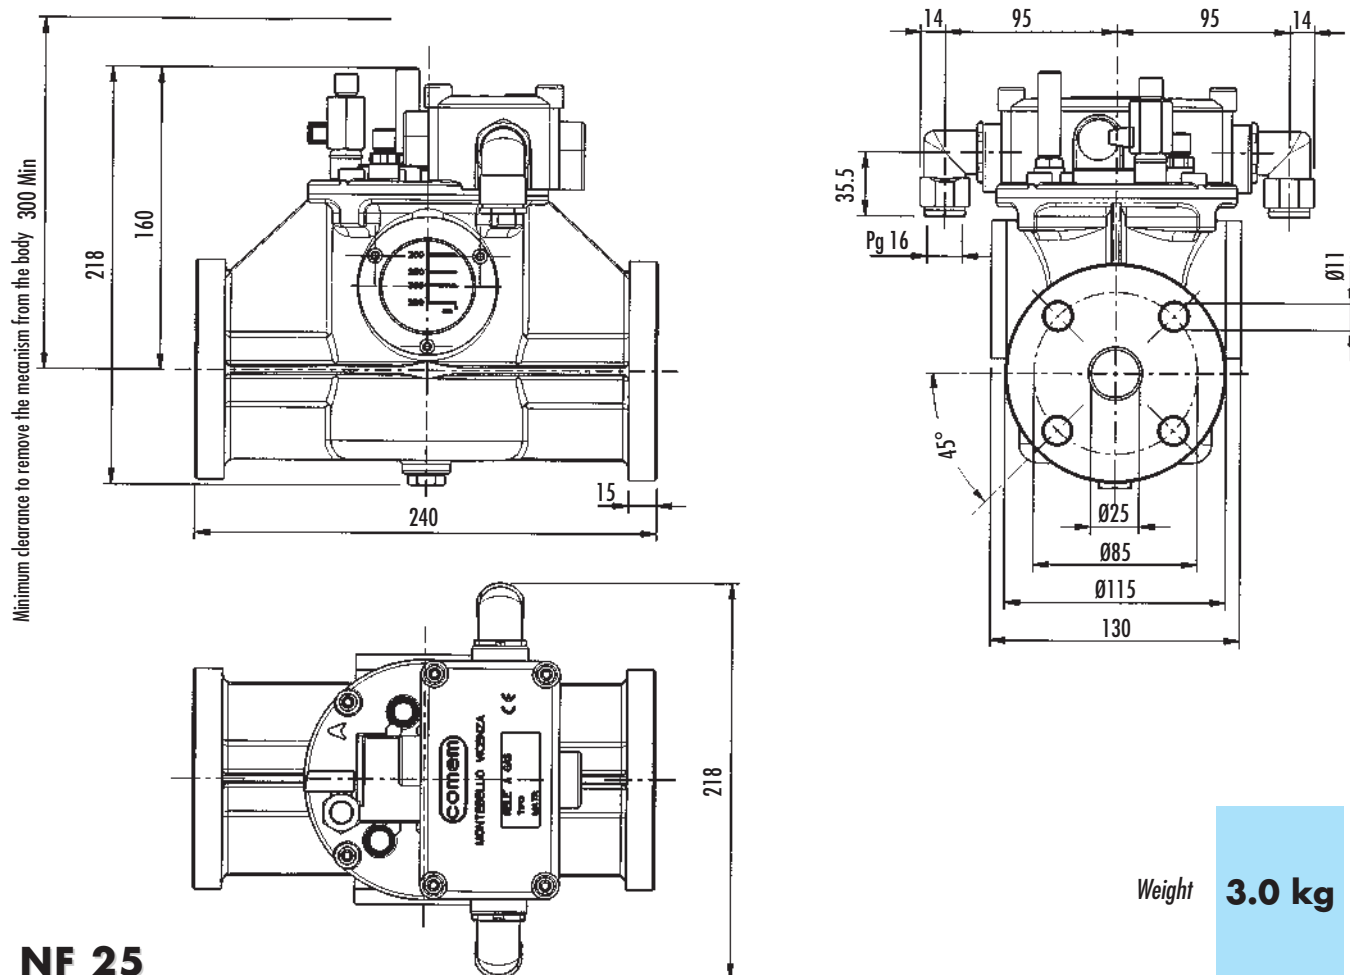


Weight **3.0 kg**



Minimum clearance to remove the mechanism from the body

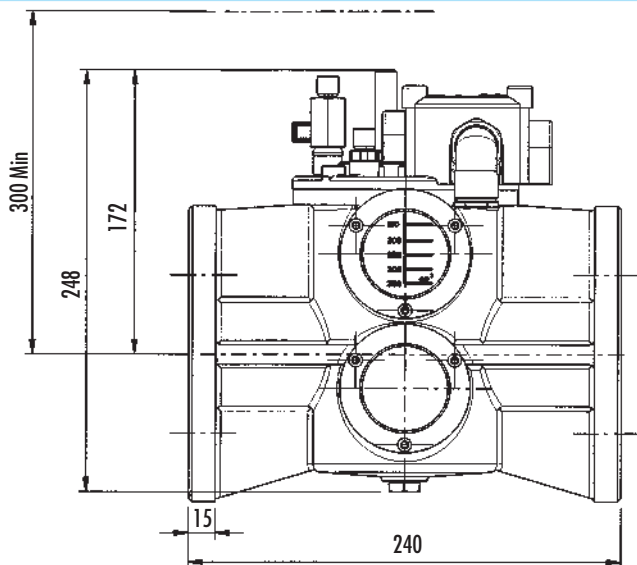


**NF 50**

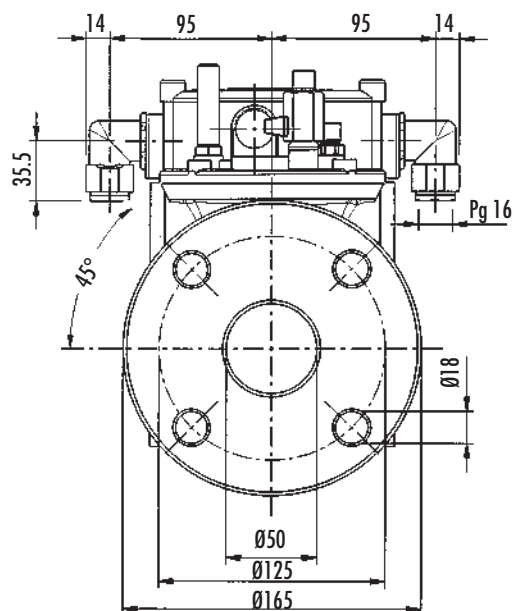


Weight **4.8 kg**



Minimum clearance to remove the mechanism from the body

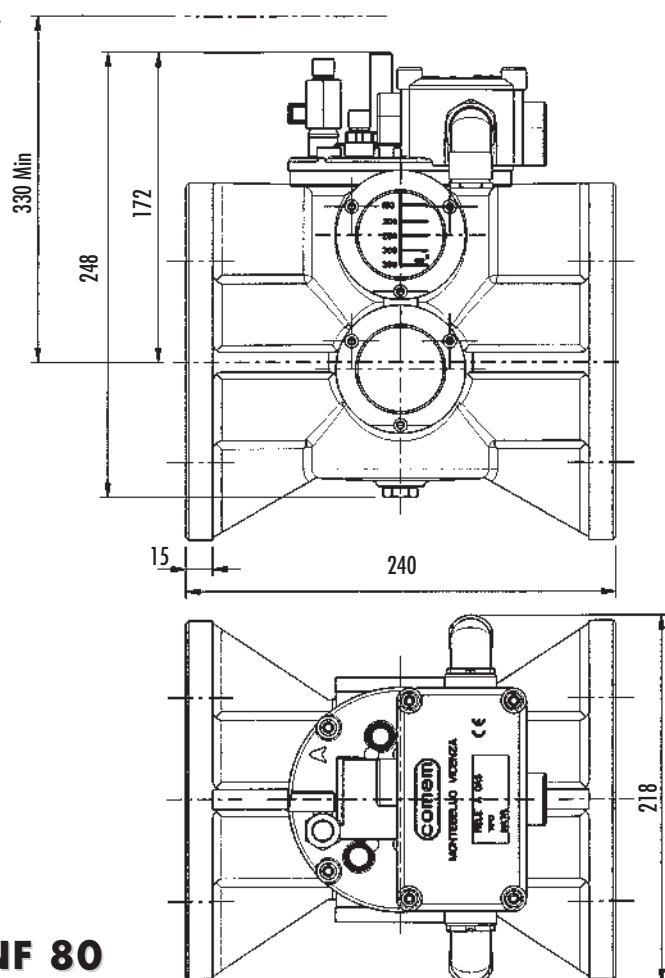



**NF 80**

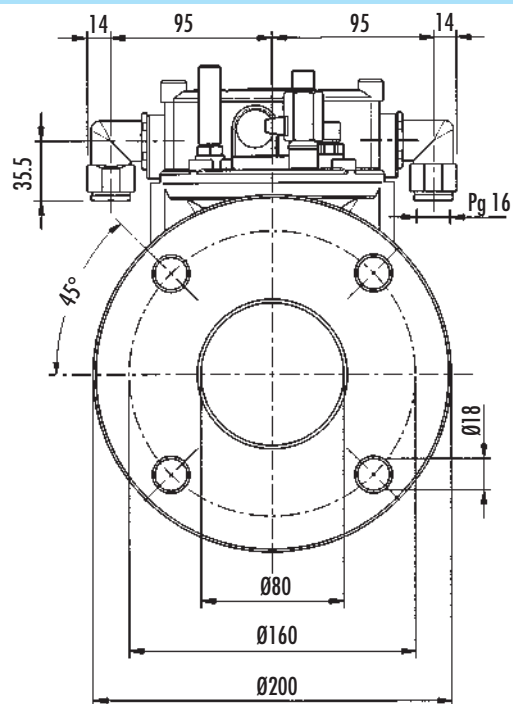

Weight **5.5 kg**

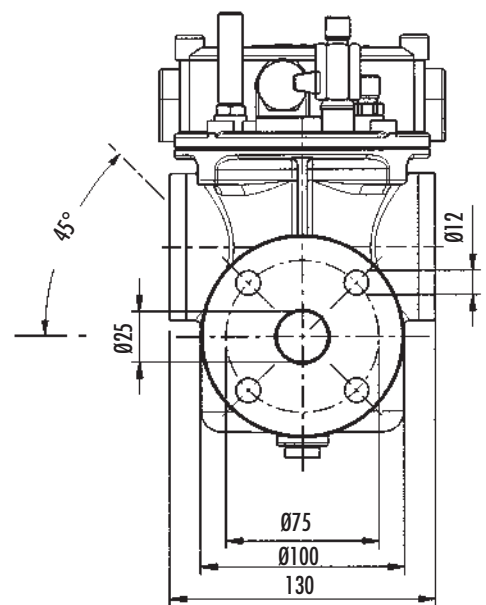
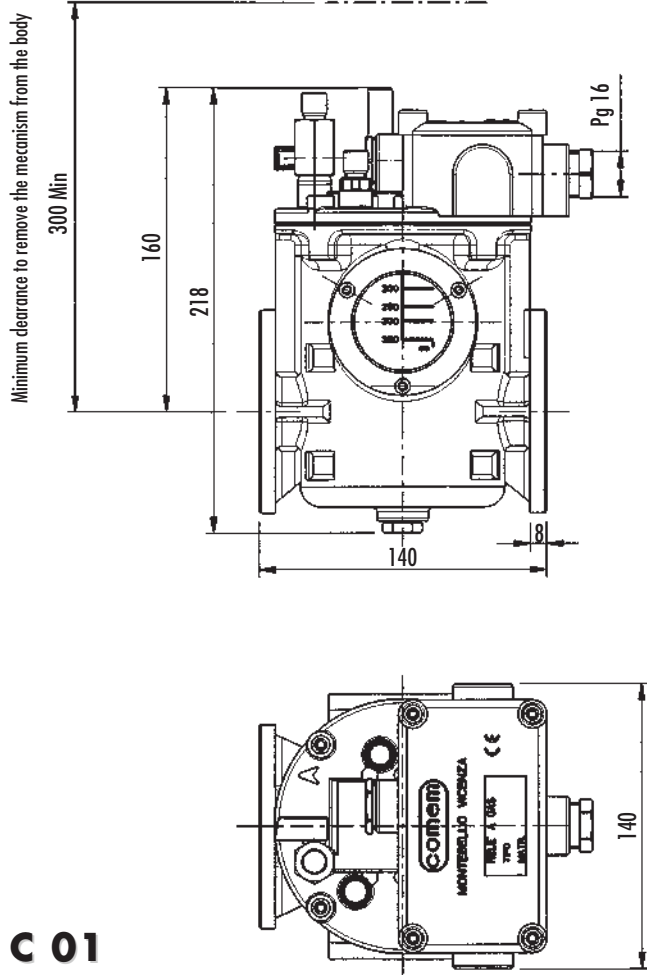


Weight **2.2 kg**

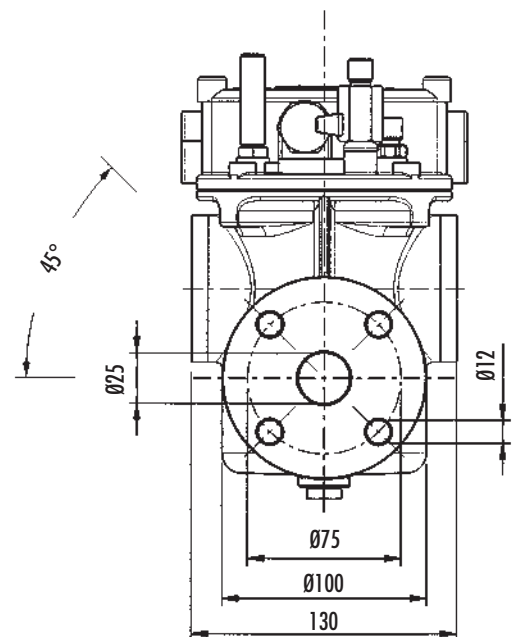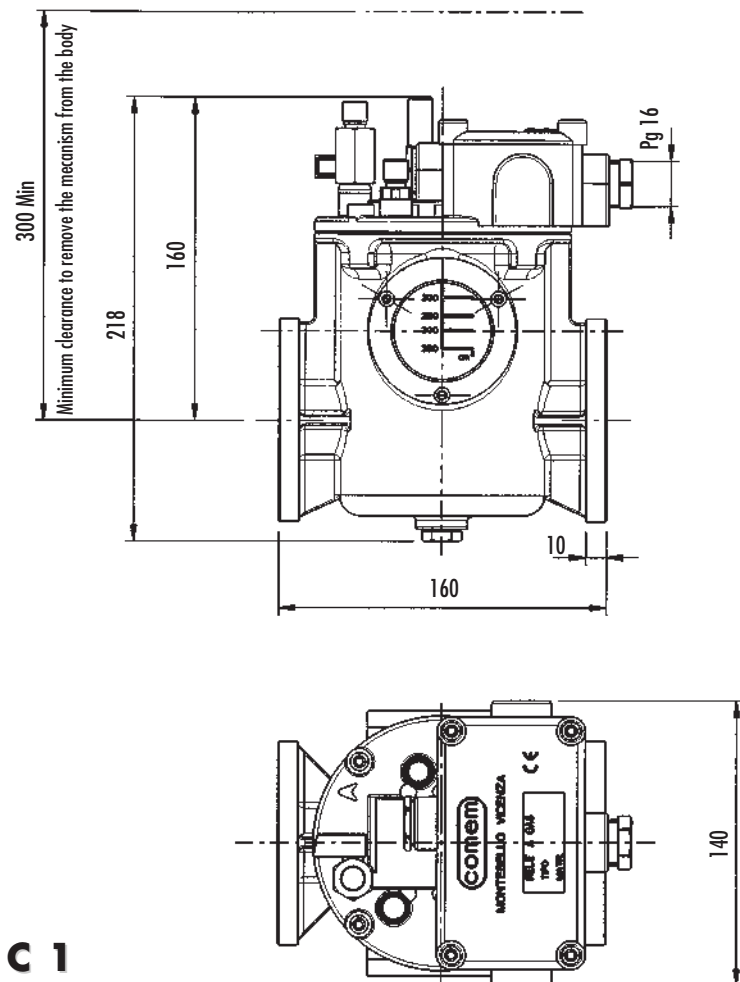

Weight **2.3 kg**

**C 4**

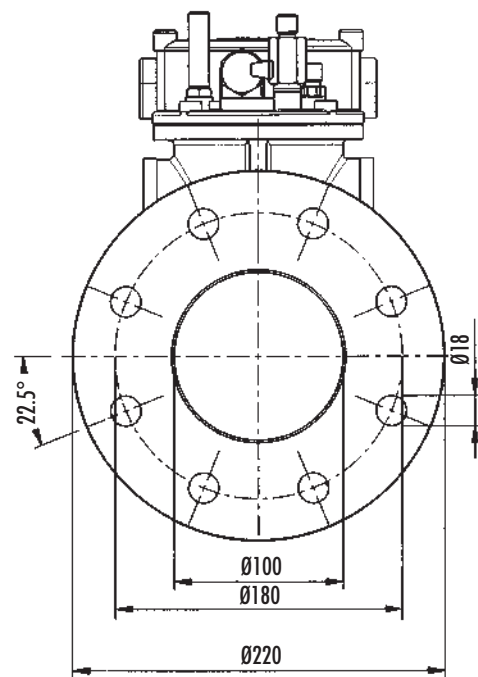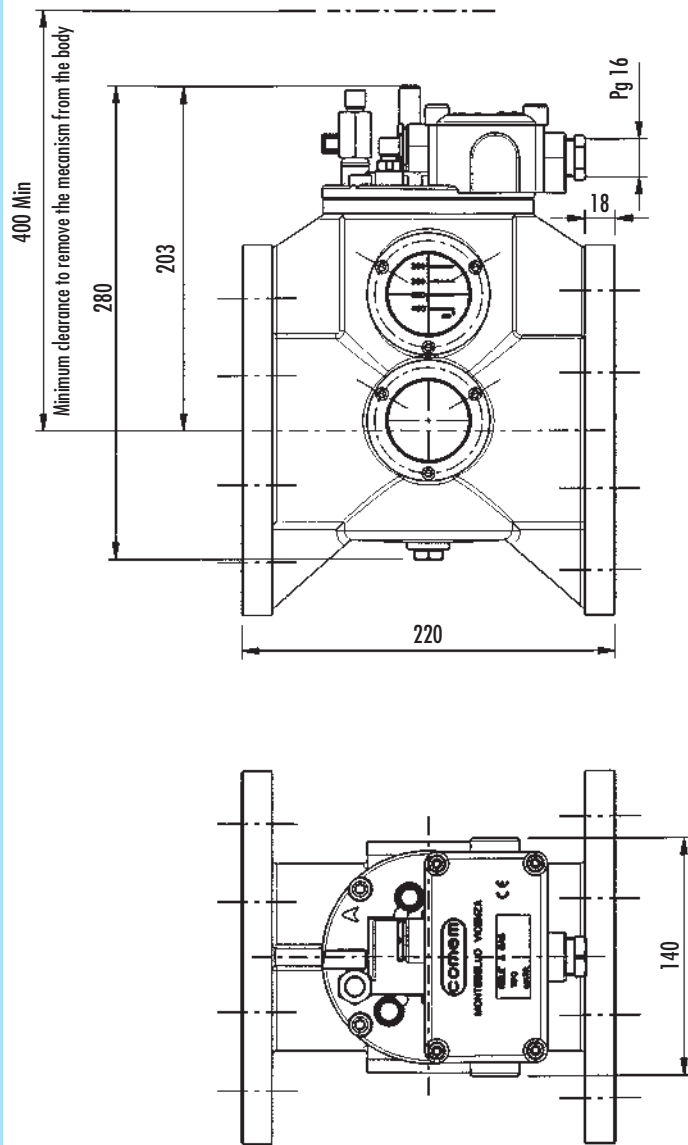

Weight **5.9 kg**

## **BUCHHOLZ GAS-ACTUATED RELAY to CENELEC EN 50216-2 standard**

The generation of gas in an oil filled transformer is a clear indication of a problem. The gas may be a result of the following:

- Decomposition/degradation of solid, or liquid insulation inside the transformer due to overheating, or arcing.
- From the outside towards the pipeline.
- From the oil itself due to unsatisfactory de-gassing prior to filling.

Rapid oil movement in the pipeline towards the conservator is caused by an internal arc, short circuit, or hot spot which must be correctly addressed.

Oil leaks from the transformer are environmentally unacceptable and a fire hazard will lead to transformer failure.

To indicate any of the above malfunctions Comem as the result of 40 years experience with these products has developed a new "Buchholz" relay to comply fully with the latest CENELEC EN 50216-1 and EN 50216-2 standards.

The new relay incorporates the very latest technology in its construction.

### **PRINCIPLE OF OPERATION**

The Buchholz relay is sited in the pipework between the transformer and its conservator and it is filled with oil during normal transformer operation. When gas is generated in the transformer it rises towards the conservator and collects in the upper chamber of the relay.

The oil level drops and the top float triggers alarm switch.

Gas shall not freely pass from the relay body and escape into the pipework before the alarm contact has operated.

The trip contact shall operate at a steady oil flow as indicated in Table 3.

This operation shall not be adversely affected when the alarm contact has already closed and gas is escaping freely.

In the event of an oil leak the Buchholz relay will only operate after the conservator has exhausted all of its oil. In order to check this eventuality it is recommended that an RDR MK II automatic shutter valve is fitted between the Buchholz and the conservator.

Specific information on this product are available on request.

### **CONSTRUCTION**

The new Comem Buchholz relay is an assembly of two machined aluminium alloy castings that effect a perfect oil seal.

1) The main body of the relay is fitted with tempered glass inspection windows with graduated scale markings in cubic centimetres to indicate the internal volume. The oil drain plug is located at the bottom of the main body.

2) The top cover carries the frame which contains the moving parts of the relay. These comprise the two floats and their associated switches encapsulated in glass bulbs, one calibrated flow valve and two permanent magnets.


The cover also carries:

(4) a gas discharge valve with G1/8" in male thread with protective cap.

(5) A valve for pneumatically testing the alarm and insulation circuits, with protective cap.

(2) A push rod for mechanically tripping the alarm and the insulation circuits, with protective cap.

A terminal box which as standard contains 4 numbered M6 terminals and one earth terminal.

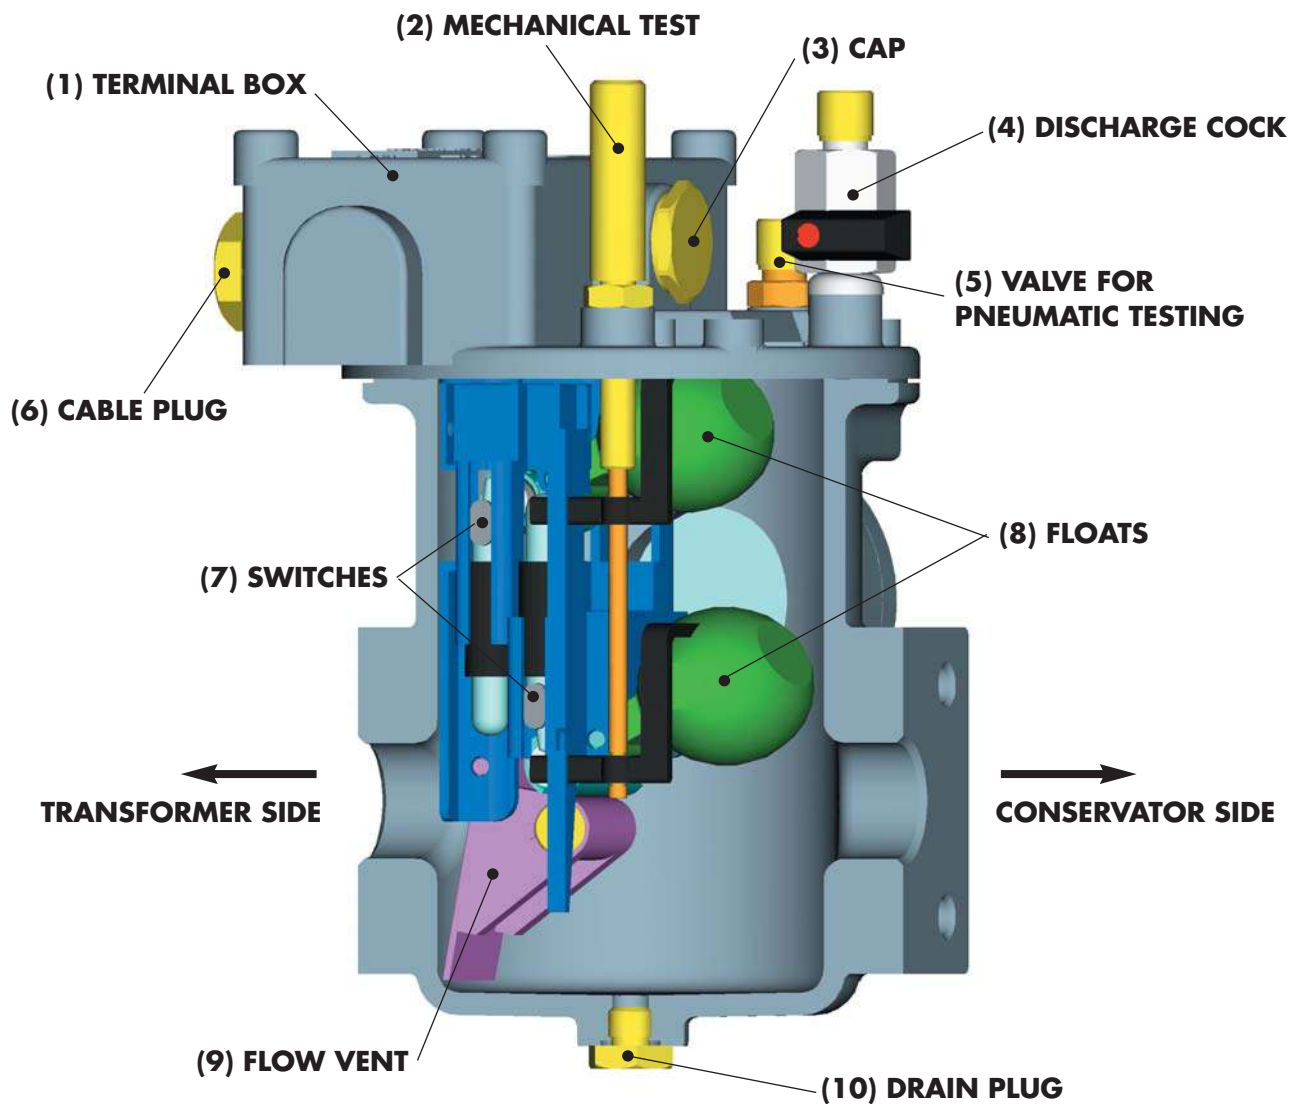

## EXTERNAL COATING AND PROTECTION

To the external aluminium alloy parts is given a phosphate treatment prior to applying one coat of vinyl enamel, colour RAL 7001. This treatment has proved more than satisfactory over the years for the majority of applications including desert and tropical situations. However, in particularly severe applications (>500h salt fog) such as applications in corrosive atmospheres (acids) a suitable epoxy primer is recommended. (This should be discussed at the time of selection).

All external brass fittings are plated and all nuts are made in stainless steel.

## RELAY SELECTION

The size and type of relay to be used will depend on the transformer rating and oil volume. Suggestions are given in the following table but the final choice is often as a result of the transformer manufacturers experience.

MVA TRANSFORMER POWER	NOMINAL DIAMETER
Up to 5	25
From 5 up to 20	50
From 20 up to 50	80
Over 50	100

tab. 1

## TECHNICAL DATA

- The relay pipework is typically mounted at 2,5 degrees to the horizontal. A positive inclination of up to 5 degrees to the horizontal axis is admissible.
- Operating pressure - 1 bar, tested to 2,5 bar for 2 minutes at 100 deg C.
- Gas volume to trip alarm:

BUCHHOLZ RELAY TYPE	GAS VOLUME NECESSARY TO TRIP THE ALARM
BG 25, BR 25, NF 25, C 01, C 1	100÷200
NF 50, NF 80	100÷200
BR 50, BR 80, C 4	150÷250
BS 25	170÷230
BS 50, BS 80	250÷300

tab. 2

- Rate of oil flow in m/s to trip insulation. In the following table standard values are highlighted with an 'O' available, on request with an 'X' and not available with a '//'. +/- 15% tolerance at 20°C with oil viscosity according to IEC296.

INSIDE PIPE DIAMETER	1,0 m/s	1,5 m/s	2,0 m/s
25	O	X	X
50	O	X	X
80	O	X	X
100	//	O	X

tab. 3

- The relay operates within 0,5 seconds.
- Oil temperature between -25 and +115 deg C.
- Ambient temperature between -25 and +60 deg C.
- Degree of Protection IP65 to EN 60529.

## SWITCH ELECTRICAL DATA

Rated switch current is **2 A r.m.s.** with max. **10 A r.m.s.** as short term 30 ms current value.

Breaking power is specified in the following table:

VOLTAGE	CURRENT	BREAKING POWER	
220 V d.c. (min. 12 V)	2 A for 10000 maneuvers	250 W	L/R < 40 ms
230 V a.c. (min. 12 V)	6 A for 1000 maneuvers	400 VA	cos φ > 0,5

tab. 4

Dielectric contact voltage as specified in the following table:


	SHORT TERM INDUSTRIAL FREQUENCY LEAKAGE TEST kV/1 min. (r.m.s)	RESISTANCE VOLTAGE PER PULSE kV (peak)
Between circuits and ground	2,5	5
Across open contacts	1	3

tab. 5

## TESTING

The following Type Tests have been performed on the relay.

- Measurement of the volume of gas necessary to trip the alarm.
- 500 hr salt fog.
- Electromagnetic Field Test. Relay does not trip in field strength up to **25 mT** (ref EN 50216-2).
- Stationary sinusoidal mechanical vibrations. Tests according to EN 60721-3-4 standards have been performed.
  - a) class **4M4** (4M6 on request) vibration test applied in sites where vibrations are transmitted from machinery and vehicles. Not suitable for machines exposed to high vibration and shock levels. Three-axis movement was impressed to the relay using special equipment with stationary sinusoidal vibrations from **2 to 200 Hz**. Movement had a constant **3 mm** (6 mm peak-peak) amplitude in the range from **2 to 9 Hz** whereas above this frequency it had constant **10 m/s<sup>2</sup>** acceleration. The alarm and release switches did not trip.
  - b) non-stationary vibration tests with vertical shock with **100 m/s<sup>2</sup>** acceleration with type I spectrum (duration 11 ms) as shown in the graph below. Alarm and release contacts did not trip. On demand we are able to manufacture Buchholz relays with special features and test values higher than the ones stated above.

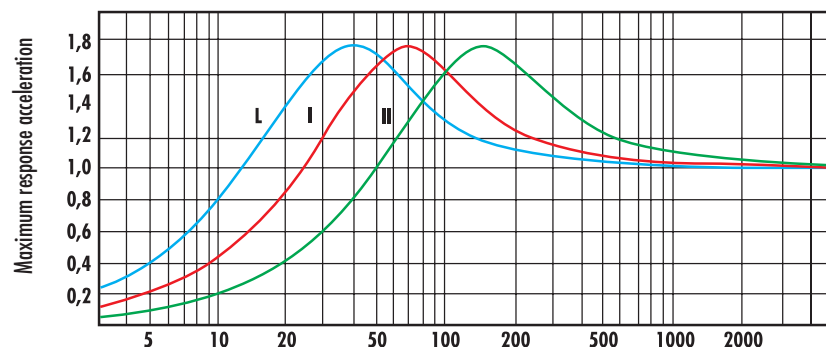

Example duration of a sinusoidal half pulse:

Type L spectrum: 22 ms duration

Type I spectrum: 11 ms duration

Type II spectrum: 6 ms duration

- A seismic test was also performed according to EN 50216-1 standards that refers to EN 60068-3-3 class 0, level 2 standards. The test consists of application of a **9 m/s<sup>2</sup>** horizontal acceleration and a **4.5 m/s<sup>2</sup>** vertical acceleration, increasing frequency one octave per minute. No activation of alarm or release switches was encountered.
- Pressure Withstand Test 2.5 bar for 2 minutes with oil at 100 deg C.
- Vacuum Withstand Test of 2500 Pa for 24 hrs.
- Rate of oil flow test to operate trip contacts, (as shown in table 3).
- Test to show the relay is insensitive to oil flow from conservator to transformer.
- Electrical tests per table 5.

## ROUTINE TESTS

The following Routine Tests are applied to all relays.

- Hydraulic seal test in mineral oil at 90 deg C and 100 kpa pressure for 30 minutes.
- Contact operation via mechanical push rod.
- Contact operation by lowering the oil.
- Rate of oil flow to trip contacts.
- Electrical withstand test between contacts (as table 5).
- Electrical withstand test between contacts and earth (as table 5).

An individual routine Test Report is shipped with each relay

## RELAY OPERATING TEST

The following site Tests can be performed when the relay is installed on the transformer

The Alarm and Trip contacts can be tested manually by the push rod (2) - mechanical test, or (only for alarm contact) by the introduction of air into the relay through valve (5) - pneumatic test.

A bicycle pump can be utilised for this test or a kit article n° **5400806002** is available from Comem.

To effectively test the rate of flow of oil is a complex test requiring specialised equipment. Should this test be required other than as a type test then Comem can perform this on request at the time of the order.

## INSTALLATION INSTRUCTIONS

The following installation procedures must be observed for proper relay operation:







- The red arrow on the relay must point towards the conservator.
- The relay must always be full of oil, which means that the minimum oil level in the conservator must be higher than the relays breather valve.
- The recommended inclination of the relay pipework is 2.5 degrees from the horizontal.
- The pipe from the transformer to the relay must exit the transformer at the highest point.
- The pipeline upstream from the relay has to be straight and with a length equal to **5-10 times** the pipeline diameter, at least. Down stream from the relay, pipeline length has to be **3 times** the pipeline diameter, only. It must rise up towards the conservator.

## RELAY ORDER FORM

Chosen size and model (see drawings and table 1):

BG 25 ☐ BR 25 ☐ BR 50 ☐ BR 80 ☐ BR 80 8 holes ☐ BS 25 ☐ BS 50 ☐ BS 80 ☐ NF 25 ☐ NF 50 ☐ NF 80 ☐ C 01 ☐ C 1 ☐ C 4 ☐

Electric contact layout (meaning with relay filled with oil and operating):

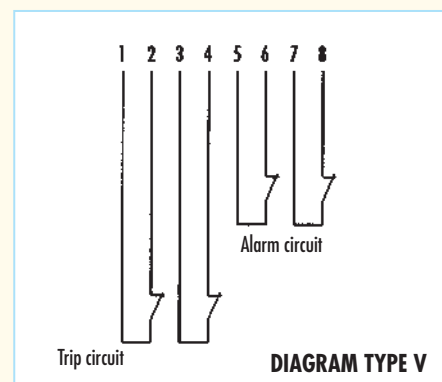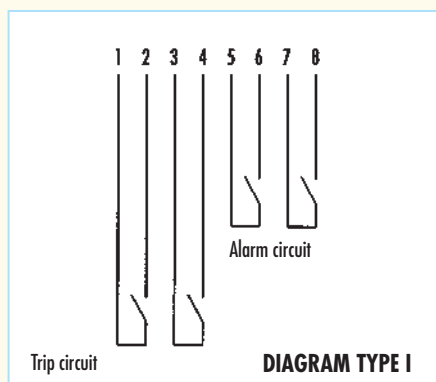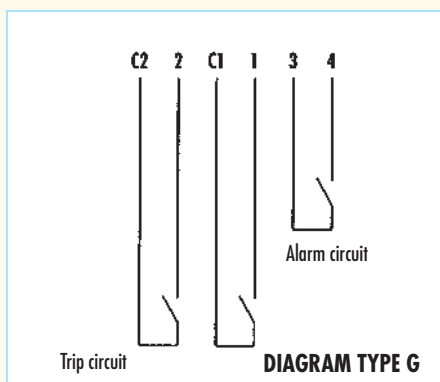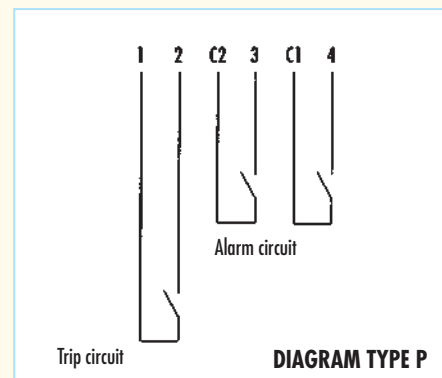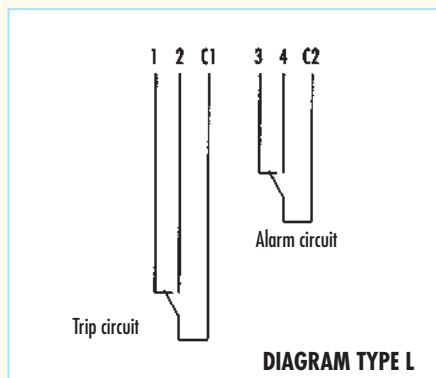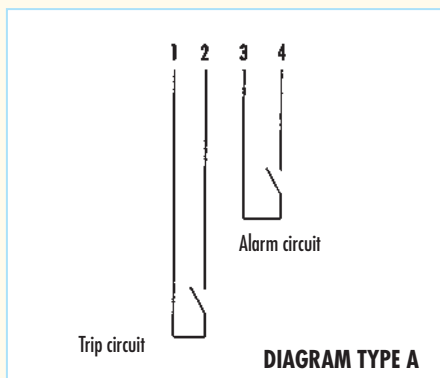

A ☐ L ☐ P ☐ G ☐ I ☐ V ☐ Other ☐ \_\_\_\_\_

Chosen seals:

A ☐ B ☐ C ☐ Other ☐

	TYPE OF DIELECTRIC		MINERAL	SILICONE	ESTERIZED
	AMBIENT TEMPERATURE/OIL				
A	Ambient -25° ÷ 60° C Oil -25° ÷ 115° C	Standard version	NBR	VITON/NBR	//
B	Ambient -10 ÷ 60° C Oil -10° ÷ 115° C	Special version	//	VITON	VITON
C	Ambient -40° ÷ 60° C Oil -40° ÷ 115° C	Special version	NBR/VITON	NBR/VITON	NBR/VITON

(NBR/VITON: meaning: parts in contact with oil in VITON, parts not in contact with oil in NBR)

tab. 6

Paint finish:

Standard ☐ Corrosive environments ☐ Other special finishes ☐ \_\_\_\_\_




# GAS SAMPLING DEVICE WITH APPLICATION OF THE BUCHHOLZ RELAY OIL DRAIN COCK

## PRINCIPLE OF OPERATION

The presence of gas inside an oil filled transformer is always a sign of malfunction and one of the tasks of the Buchholz relay is to signal this presence. Analysis of the evolved gas can often give good indication of the type of malfunction but accessing the Buchholz relay during live operation of the transformer can be hazardous.

The gas sampling device has been designed to overcome this problem by siting the unit remote from the Buchholz and in a readily accessible position typically on the side of the transformer.

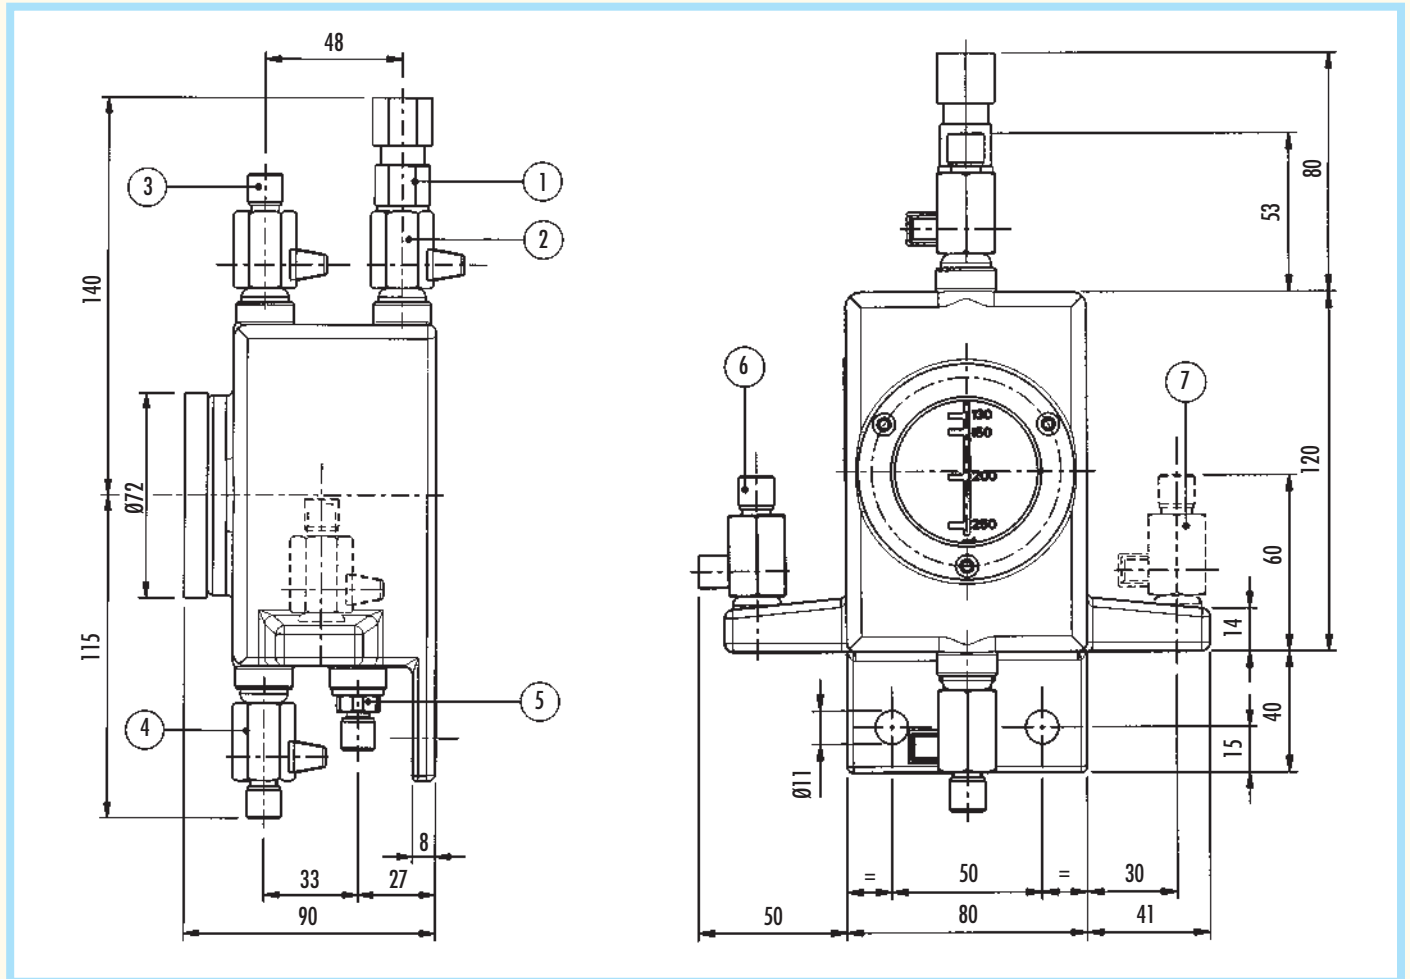

## CONSTRUCTION

The Comem gas sampling device is manufactured from an aluminium alloy casting with the following fittings:

- A tempered glass inspection window with graded markings for volume indication.
- A gas sampling valve (2).
- A bleed valve (3).
- A gas inlet valve for pneumatic testing (5).
- A valve for draining oil from the relay (this can be mounted on the right or left hand side of the body (6) or (7)).


As a routine test all castings are tested by injecting ambient air at 2.5 bar for 2 minutes.

A certificate to this effect is supplied with the unit.

For the sake of standardisation the device is fitted with the left and right hand valve supports but only one valve.

Customer can then choose which side he prefers.

- With fittings for outside dia. 10 tubes, code **1RDPG00005** (standard);
- with fittings for outside dia. 6 tubes, code **1RDPG00006** (on request);
- with fittings for outside dia. 8 tubes, code **1RDPG00007** (on request).

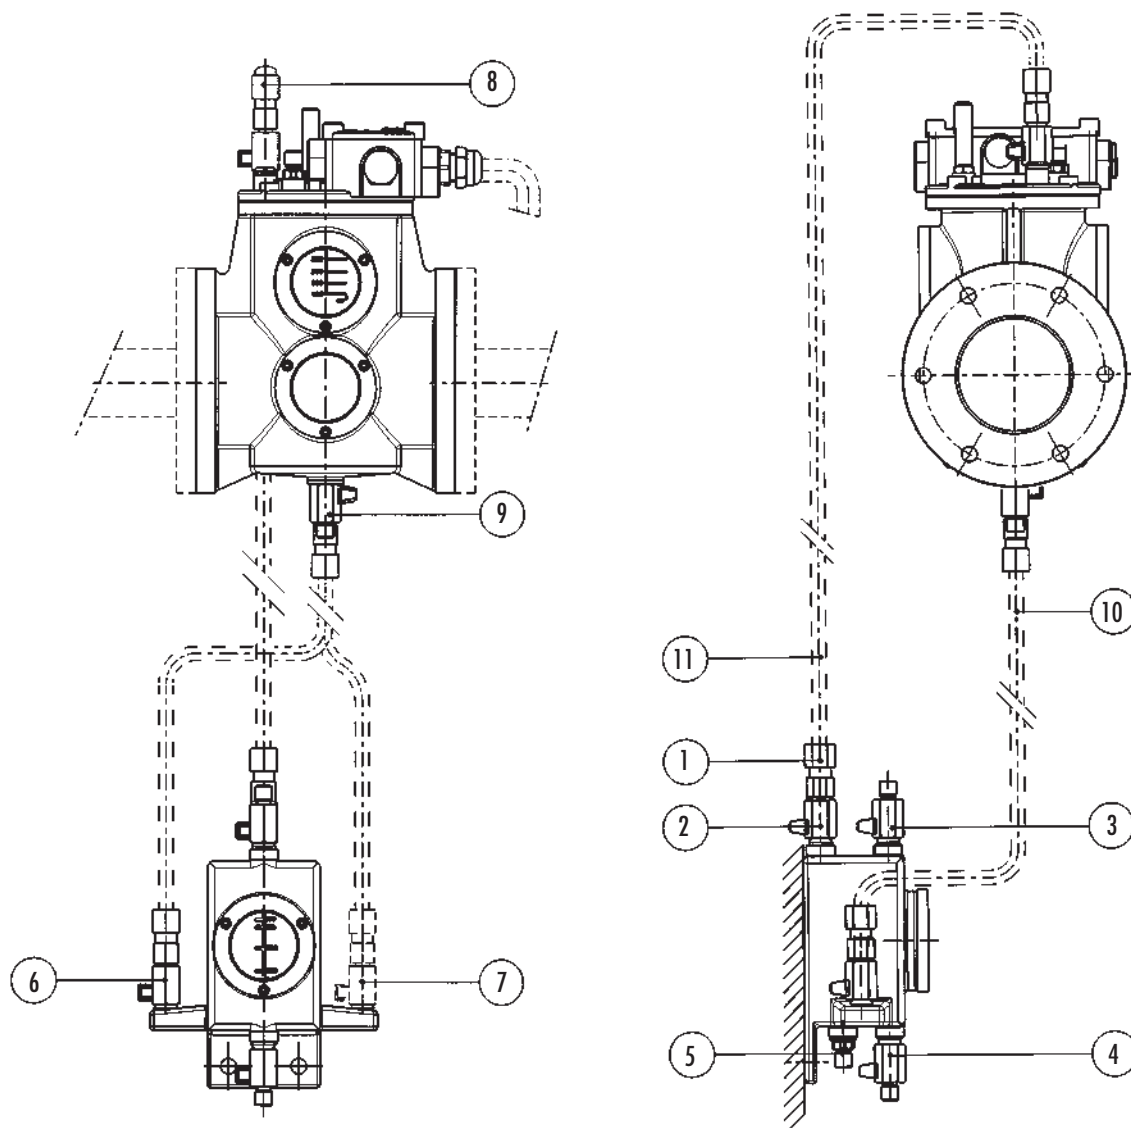

## DESCRIPTION OF OPERATION

During normal operation the Buchholz relay is full of oil and is connected to the gas sampling device via pipelines 10 and 11.

Valves (8), (2) and (9) are open.

Valves (3), (4), (6) or (7) are closed.

The gas sampling device is consequently also full of oil.

Sampling procedures are as follows:

**A-** To sample oil: open valve (6) or (4).

**B-** To sample gas if the relay has signalled alarm or tripped the transformer:

Open valve 4 and let the oil in the device flow out. This draws any gas from the relay via valve (8), tube (11) and valve (2) into the body of the gas. The progress of this operation can be checked through the inspection window. When the desired amount of gas has been collected close valves (2) and (4) and open valve (3) to take the sample.

**C-** To test satisfactory operation of the alarm and trip circuits proceed as follows:

Close valve (2) then drain all the oil from the device by opening valves (3) and (4). Attach an air pump (bicycle pump) or kit from Comem 5400806002) to valve (5). Close valves (3) and (4) and pump fast whilst simultaneously opening valve (2). The air will then pass into the upper chamber of the Buchholz relay via pipeline (11) lowering the floats and consequently closing their contacts. If you wish to test the lower float then first the valve between the relay and the conservator must be closed to prevent air from flowing directly into the conservator.

## OPERATION STARTING

**Caution:** After commissioning ensure the Buchholz relay and the sampling device are both filled with oil.



**comem<sup>®</sup> - S.p.A**

Strada Statale 11, Signolo 22  
36054 MONTEBELLO VIC.NO (VI) ITALY  
Tel. 0444 449 311 • Fax 0444 449 352 - 440 359  
Internet <http://www.comem.com> • e-mail: [comem@comem.com](mailto:comem@comem.com)

Due to technical improvement of our products, the information contained in this catalogue may be subjected to change without notice.

## SECTION 9

## APPENDIX C

# PRESSURE RELIEF DEVICE: ABB/COMEM 50M

(MANUFACTURER DETAILS - 8 PAGES)

# Pressure Relief Device - M

COMEM "M" pressure relief devices are used to control pressures inside tanks. They are used where accidental, instantaneous and uncontrolled increases in pressure may create the danger of explosion. They are designed to discharge the pressure increases that have taken place to the exterior in a very short time period (a few thousandths of a second).

They are widely used in the metal tanks of oil-cooled electric transformers. Sudden and violent short circuits inside these tanks, in fact, instantly generate an enormous amount of gas with a great increase in interior pressures. If the pressure cannot discharge to the exterior there is danger that the transformer may explode, with all the possible harm and damages this may cause. This danger can be prevented by installing one or more pressure relief device with discharge sizes proportional to the volume of oil contained in the transformer. It is always good practice to install these pressure relief devices in all situations where internal pressure values must not exceed specific safety limits.



They are widely used in large distribution transformers and traction transformers.

## Total pressure relief completely opening

Pressure relief device opening is total each time the pressure relief device operates for pressure settings between 20 and 90 kPa. The discharge opening area, for each pressure relief device operation, is equal to that for higher pressure settings even when pressure settings are lower than 20 kPa. If, however, pressures are generated inside the tank that are much higher than the setting then the spring, further compressed, allows the closing disk to create even larger discharge areas when it operates.

## Operating performance

Nominal operating pressure: the pre-fixed overpressure value shall be agreed between supplier and purchaser within the standard range from 20 up to 90 kPa, with 10 kPa steps, with a tolerance of - 5 kPa to + 7 kPa. For model 50M the standard operating pressure range comes up to 200kPa, with 10kPa steps.



## Construction

Our pressure relief devices are totally protected against external corrosion and against penetration of foreign bodies between cover and protective cap. This ensures perfect operating efficiency even for extended periods of time.

### “M” pressure relief device

These consist of a flanged body and a corrosion-proof aluminium alloy disk. A brass rod that holds the spring is applied to the central part of the disk. There are two gaskets in the pressure relief device: a special shaped upper gasket and a lip seal. When the pressure relief device is closed the upper gasket is pressed against the disk. The shape of the gasket permits a perfect seal even if the disk lifts 1-2 mm. The disk also makes a seal against the lip seal gasket as it moves upwards. If, due to interior pressure, the disk rises beyond this amount then the upper seal is no longer maintained while the lip seal remains.

At this instant the surface of the washer invested by internal pressure is multiplied in area as is the total force applied on the spring. This causes total and instantaneous opening of the pressure relief device which consequently discharges excess pressures to the exterior.

When pressure has been discharged the disk, pushed back by the spring, lowers down and closes the valve. As the disk moves downwards it first closes against the side gasket and then against the upper gasket.

This latter gasket, because of its special shape, is pressed down 1- 2 mm. and the disk moves further down, breaking the seal on the lip seal gasket. This releases any pressure that may have been trapped between the two gaskets. Now the pressure relief device is ready to work.

## Routine tests

It is necessary to carry on operational tests, with compressed air:

- to check the correct functioning of the device at operating pressure values
- to check the functioning of the optic signal and of the electric contacts.

## Installation guidelines

Our “M” pressure relief devices come in 2 sizes and have different discharge areas. This allows users to select the type that is best suited for the volume of oil contained in the tank. The following table gives guideline values:

Volume of oil tank:	Type of pressure relief device
up to 3000 dm <sup>3</sup>	50 M*
up to 25000 dm <sup>3</sup>	125 M*

\* These guideline sizes are based on experience.

We recommend using multiple pressure relief devices when oil volumes exceed these levels. It is always good practice to use multiple pressure relief device with smaller discharge areas rather than a single pressure relief device with a large area. The reason for this, in the case of transformers, is that it is better to install one pressure relief device above each winding column since these are the points where maximum interior pressures are generated in case of a short circuit. Instantaneous pressure relief device opening implies direct contact between the closing disk and oil. For this reason the pressure relief device are equipped with a screw to bleed out air that may accumulate during oil tank filling procedures.

## Oil tightness duct

It is a good practice to prevent harm to persons or property from violent jets of hot oil evacuating from the pressure relief device, for pressure relief device discharges to be ducted towards points properly designed to receive the hot oil. The protection of the environment is also another important target which has to be pursued by everybody. Our protection duct allows to drain the oil evacuated by the pressure relief device. The perfect hydraulic tightness of the system guarantees that not any drop of oil is dispersed in the environment, but collected through a pipe in a tank (pipe and tank are not supplied). The sealing oil duct is made of die-casted aluminium; a terminal flanged tube made of steel is also provided if someone wants to weld the pipeline. O-ring gaskets have been adopted for the duct sealing. Detailed assembling instructions are supplied with the equipment.

# Pressure Relief Device - M



## Visual signal that the pressure relief device is open

Pressure relief devices are equipped with a visual signal that shows when they have opened. This signal consists of a red knob that protrudes from the central part of the duct when the pressure relief device has opened. Just press it down in order to make it go back to its normal position and reset the switches, too.

## Electrical signalling switch

Maximum 3 "pressure relief device open signal" contacts can be mounted on request. These are a fast tripping limit switch with switching contact contained inside a watertight room IP 65. The contacts simultaneously act with the visual signal.

## Contact diagram

- FIRST SWITCH (terminals 12-14-11)  
change-over contact:
  - 14-11 normally open
  - 11-12 normally closed
- SECOND SWITCH (terminals 22-24-21)  
change-over contact:
  - 23-21 normally open
  - 21-22 normally closed
- THIRD SWITCH (terminals 32-34-31)  
change-over contact:
  - 34-31 normally open
  - 31-32 normally closed

The switches have the following characteristics:

## Specifications:


Breaking and making capacity (NO and NC contacts)		
Voltage	Uninterrupted current (making capacity)	Interrupted current (breaking capacity)
24 VDC to 220 VDC	2 A	100 mA L/R < 40 ms
230 VAC	2 A	2 A cos $\varphi$ > 0.5

## Other characteristics:

- The pressure relief device is supplied with a "locking system" which allows the pressure relief device to be blocked during the transformer oil leakage test. The locking system has been tested to withstand max 2 bar pressure and can also be used during the transformer transport.
- WARNING!:** the locking system must be removed before powering-up the transformer.
- The pressure relief device is supplied with a M25x1.5 cable gland.
- Colour: RAL 7001.

## Outer surface protection

External surfaces are protected against weather corrosion. Aluminum alloy components are non-corroding and their surfaces are protected with a double layer of paint offering high level protection against all atmospheric agents and resisting temperature variations between -40 °C and +100 °C. Special painting for severe climate applications is also available on request.

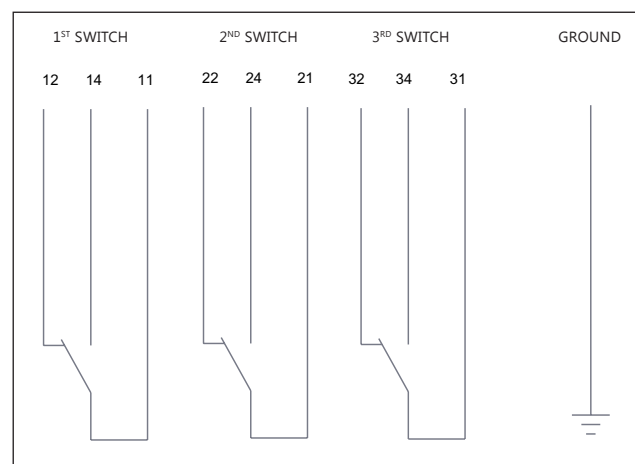








# Pressure Relief Device - M

## Overall dimensions

Type 50M




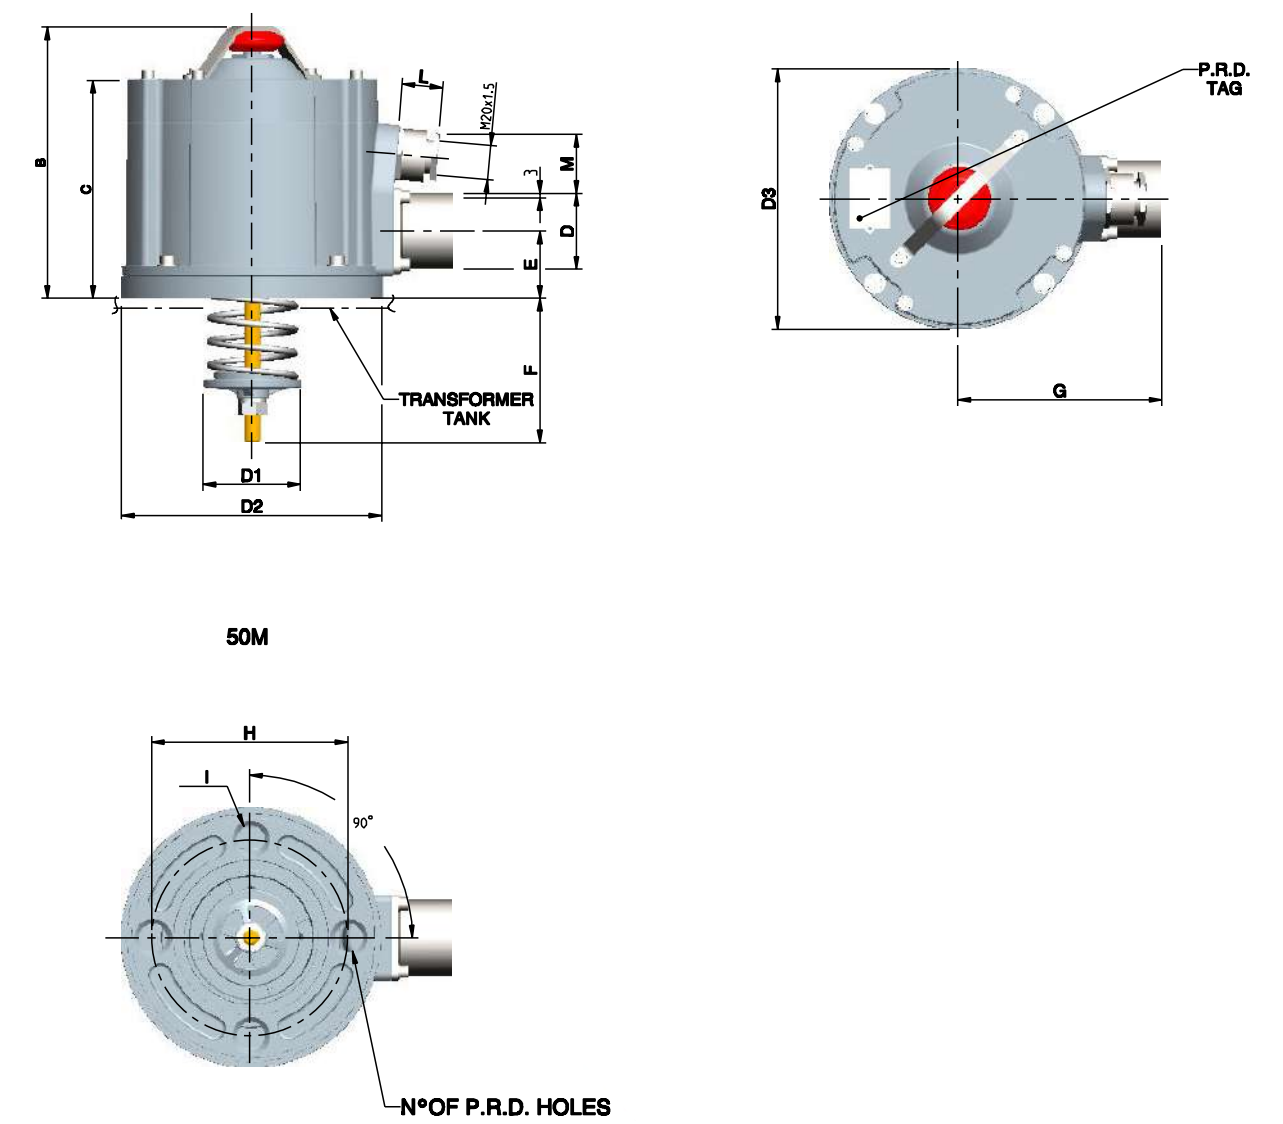


Type	B	C	D	D1	D2	D3	E	F20KPA *	F70KPA *	G	H	I	L	M	kg
50 M	170	139	Ø48.3	Ø62	Ø165	Ø166	41.5	95	60	130	Ø125	Ø18	23	38	2.1

\* F = the dimension varies with set pressure

## Overall dimensions


### Type 125 M8 and 125 M6

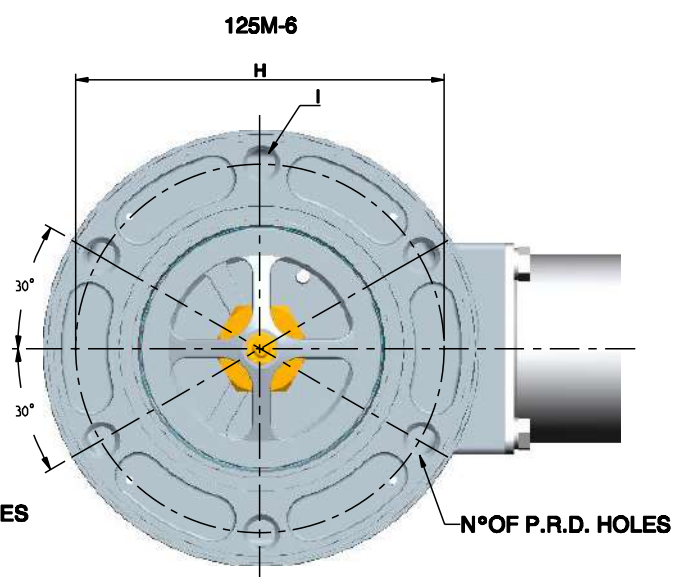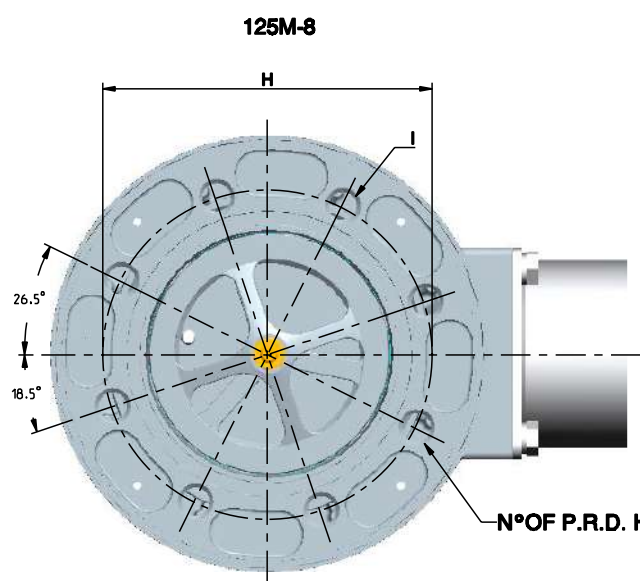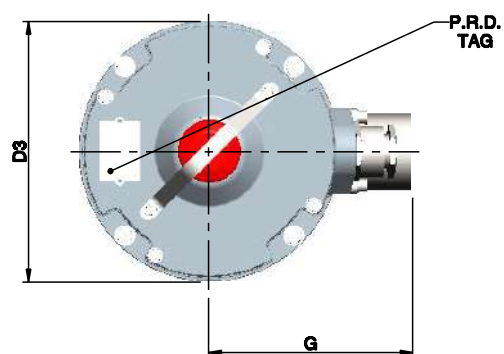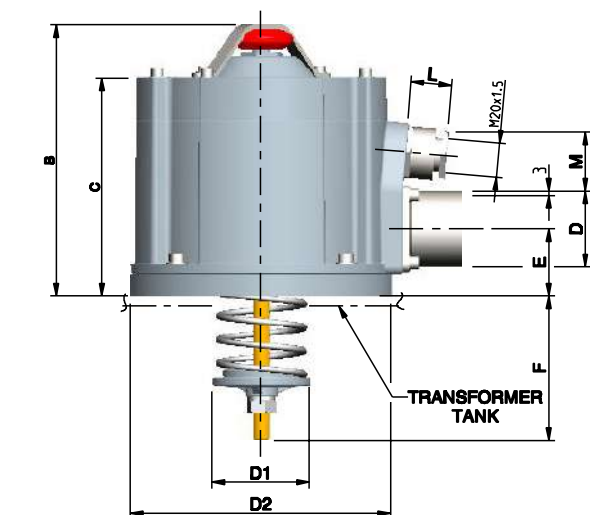

Type	B	C	D	D1	D2	D3	E	F20KPA	F70KPA	G	H	I	No. of holes
125 M-8	278	228	Ø120	Ø153	Ø278	Ø278	86	175	80	230	Ø210	Ø18	8
125 M-6	278	228	Ø120	Ø153	Ø278	Ø278	86	175	80	230	Ø235	Ø18	8

# Pressure Relief Device - M

## Assembling sequence

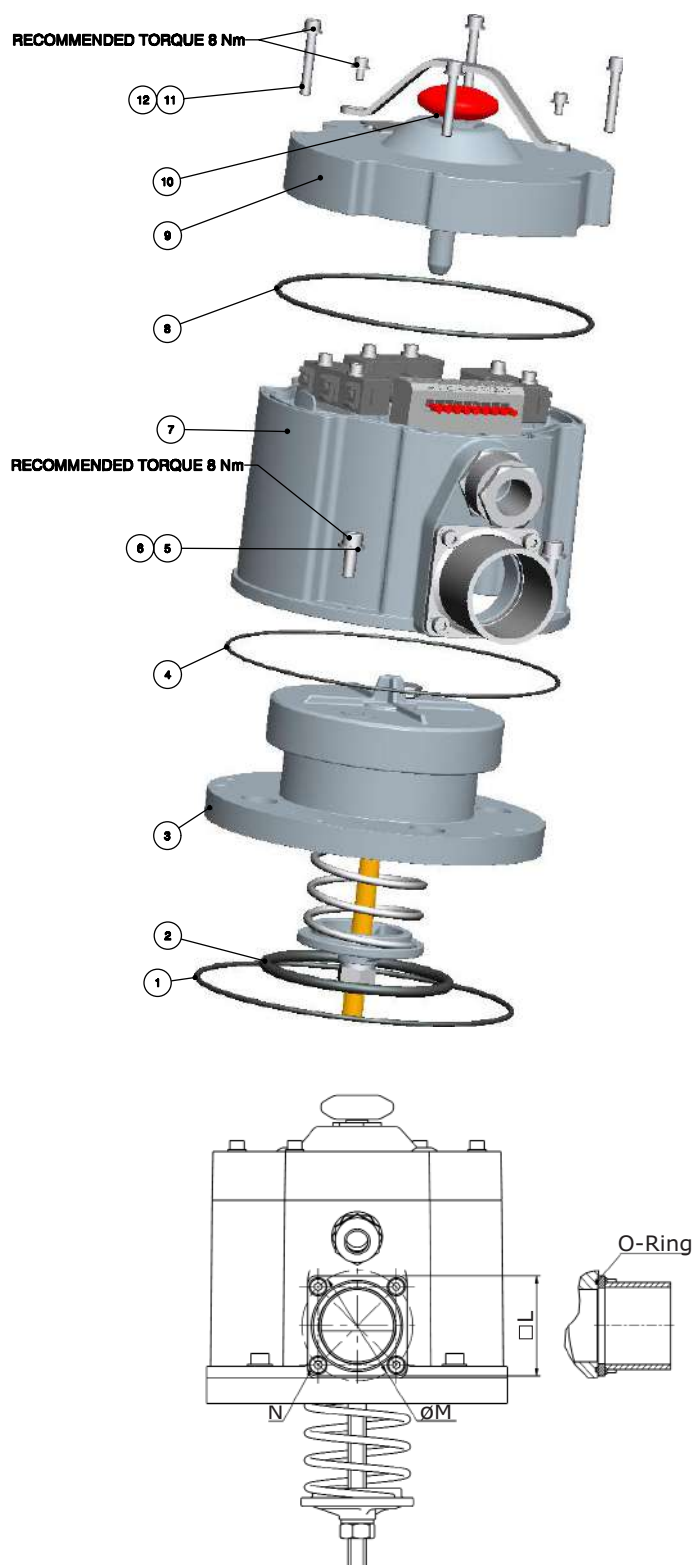

### Type 50 M

Ref.	Q.ty	Code	Description
1	1	5G0D003600*	GASKET O.R. 3600
2	1	5G0D000183*	GASKET O.R. 6337
3	1	-	50M SAFETY VALVE
4	1	5G0D002637	GASKET O.R. 2637
5	1	5V51106012	UNI 5931 M6X12 FIXING SCREW
6	1	5400800861	WASHER
7	1	-	OIL DUCT 50M
8	1	5G0D003600	GASKET O.R. 3600
9	1	-	OIL DUCT COVER 50M
10	1	-	VISUAL SIGNAL
11	1	5V50605035	UNI 5931 M5X35 FIXING SCREW
12	1	5RG0600050	WASHER

### Type 125 M-8

Ref.	Q.ty	Code	Description
1	1	5G0D041050**	GASKET O.R. 41050
2	1	5G0L000227**	GASKET O.R. 8650
3	1	-	125M-8 SAFETY VALVE
4	1	5G0D041050**	GASKET O.R. 41050
5	1	5V50606060	UNI 5931 M6X60 FIXING SCREW
6	1	5400800861	WASHER
7	1	-	OIL DUCT 125M
8	1	5G0D041100	GASKET O.R. 41100
9	1	-	OIL DUCT COVER 125M
10	1	-	VISUAL SIGNAL
11	1	5V50605035	UNI 5931 M5X35 FIXING SCREW
12	1	5RG0600050	WASHER

### Type 125 M-6

Ref.	Q.ty	Code	Description
1	1	5G0D041050**	GASKET O.R. 41050
2	1	5G0L000227**	GASKET O.R. 8650
3	1	-	125M-6 SAFETY VALVE
4	1	5G0D041050**	GASKET O.R. 41050
5	1	5V50606060	UNI 5931 M6X60 FIXING SCREW
6	1	5400800861	WASHER
7	1	-	OIL DUCT 125M
8	1	5G0D041100	GASKET O.R. 41100
9	1	-	OIL DUCT COVER 125M
10	1	-	VISUAL SIGNAL
11	1	5V50605035	UNI 5931 M5X35 FIXING SCREW
12	1	5RG0600050	WASHER

\* ALTERNATIVE PLANE GASKET CODE 5C0V412501

\*\* ALTERNATIVE PLANE GASKET CODE 5C0V452900

Type	□L	ØM	N	O-Ring
50 M	55	61	4 Screws M5x12	5G0D002187
125 M-8	135	152	4 Screws M12x25	5G0D004475
125 M-6	135	152	4 Screws M12x25	5G0D004475

## Order sheet

Number of pieces			
Model	50 M <input type="checkbox"/>	125 M-8 <input type="checkbox"/>	125 M-6 <input type="checkbox"/>
Contacts	<input type="checkbox"/> <b>1</b>	<input type="checkbox"/> <b>2</b>	<input type="checkbox"/> <b>3</b>
Pressure setting 20÷90 kPa Up to 200kPa for 50M only	Value ..... kPa		
For use in:	Moderate salinity areas acc. to ISO 12944		<input type="checkbox"/>
	Off-shore areas acc. to ISO 12944		<input type="checkbox"/>
Gaskets type	Viton <input type="checkbox"/>	silicone oils and/or high temperature -10°C up to + 150°C	
	NBR -40°C <input type="checkbox"/>	mineral oils and low temperature -40°C up to + 120°C	

## SECTION 10


# DEHYDRATING BREATHER: BROWNELL TYPE R1

(MANUFACTURER DETAILS - 5 PAGES)  
(FITTING INSTRUCTIONS - 2 PAGES)  
(SAFETY DATA SHEETS - 11 PAGES)

## APPENDIX D



# Transformer Breathers

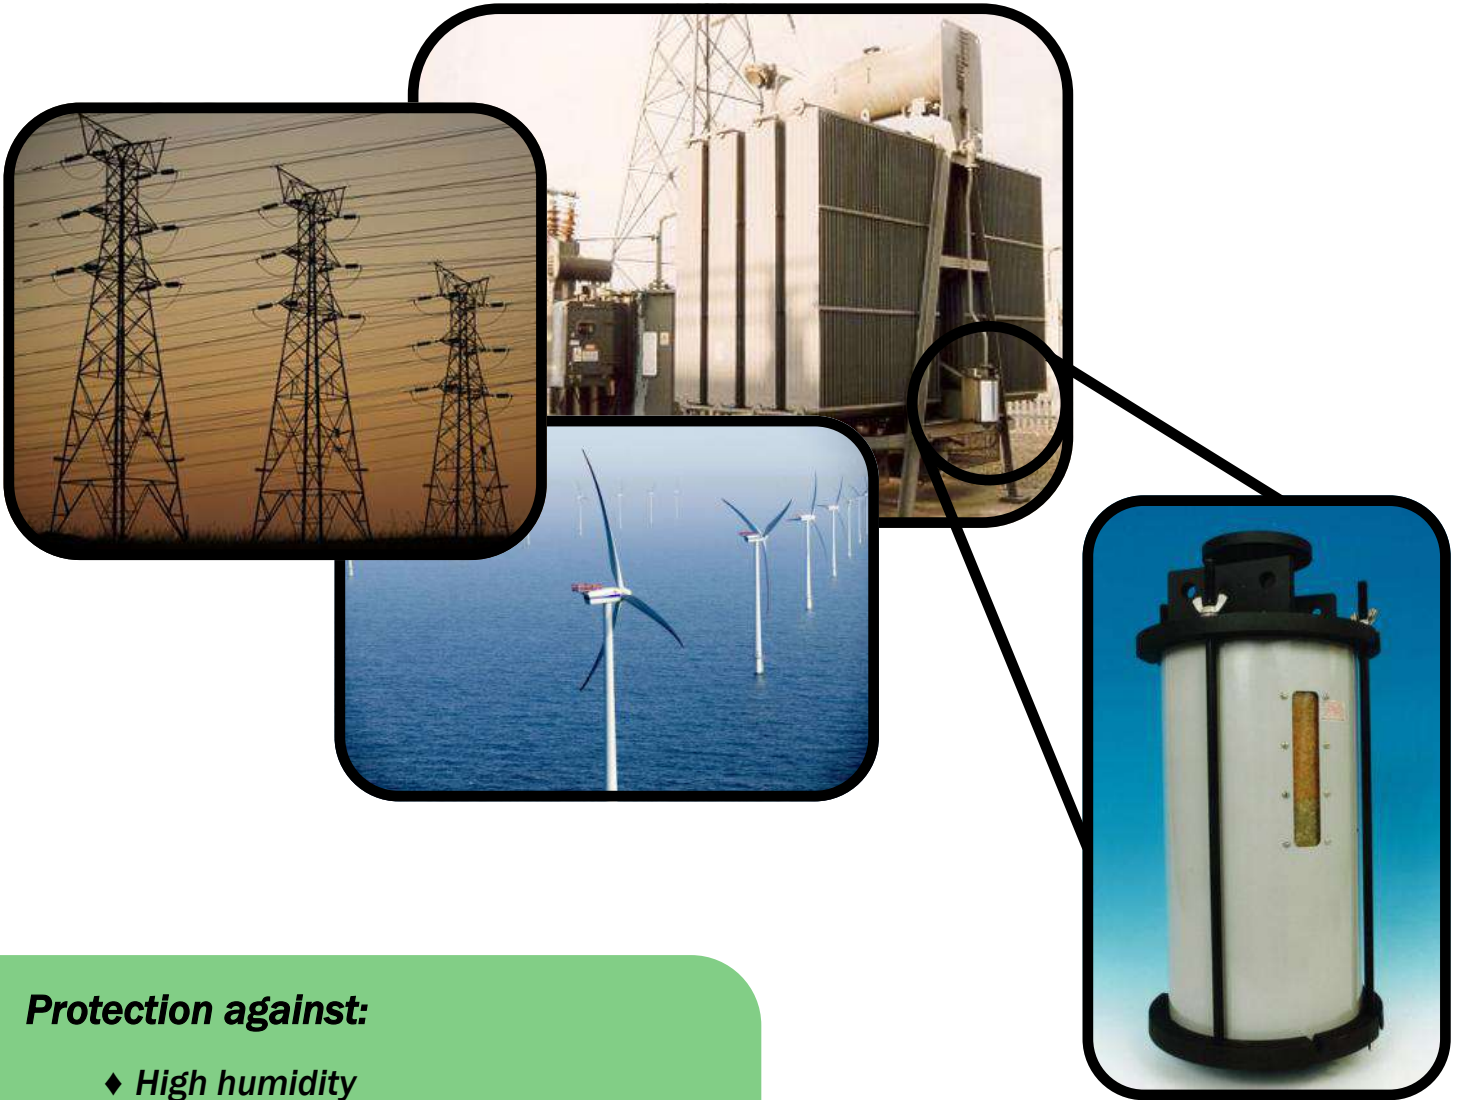

## **Protection against:**

- ◆ High humidity
  - ◆ Water condensation
  - ◆ Pressure variations
  - ◆ Dielectric loss
  - ◆ Mould growth
  - ◆ Outgassing




## Key Technical Features

- High performance plastic or metal construction
- Simple installation
- ISO9001/2008 design approved
- Suitable for 1250 kVA to 750 mVA Transformers
- Low dusting beaded ENVIROGEL adsorbent
- Up to 25% adsorption capacity
- Definitive colour change saturation indication
- IP 65 rating
- Operating temperature range  $-50^{\circ}\text{C}$  to  $+70^{\circ}\text{C}$
- Vandal proof
- Weather resistant
- All round visual saturation indicator




Size R Transformer Breather

## Typical Electrical Breakdown in Transformers

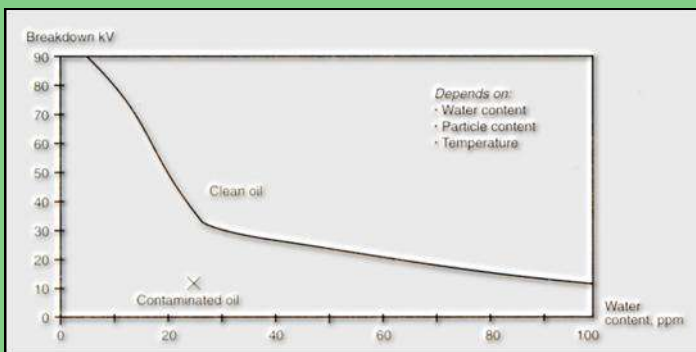

The insulation value of oil can deteriorate dramatically as it becomes contaminated with water.

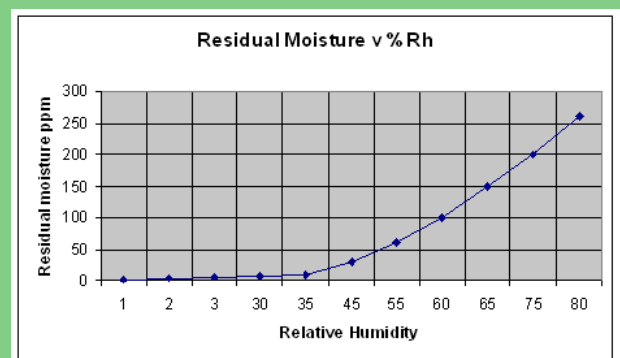

Water content of oil increases as it is exposed to high relative humidity

# Rechargeable Transformer Breathers



V, W Transformer Breathers

BROWNELL Transformer Breathers provide clear visibility of the ENVIROGEL through a shatter-proof, UV stabilised polycarbonate cylinder or window.

Two-way, low pressure valves are fitted in the base of the breather, to ensure that atmospheric air enters the desiccant charge when a negative pressure differential occurs within the transformer being protected.


BROWNELL Transformer Breathers are filled with ENVIROGEL, self-indicating desiccant.

The ENVIROGEL is orange in colour when active, turning green when saturated. This allows a visible assessment of the condition of the ENVIROGEL. Various sizes and packs of ENVIROGEL are available for refilling the Transformer Breathers.

BROWNELL have more than 40 years experience in the design, manufacture and testing of types of humidity control equipment and moisture measuring instruments. Please contact our Technical Services Division for further information.



Robust construction Transformer Breathers

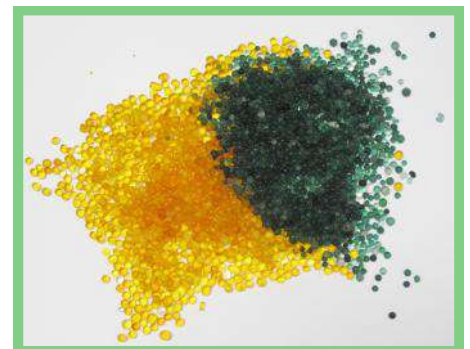



The ENVIROGEL: orange in colour when active, turning green when saturated



## Sizes R, R1, R2, S, T & U

The top pipe connector (3/4" Female Pipe Thread) is also the filling and emptying point. The beaded, self-indicating ENVIROGEL should be replaced once the colour has changed from orange to green, as indicated on the label attached to the breather. All threads conform to BS21 and ISO7-1. Full installation and maintenance instructions are supplied with each BROWNELL Transformer Breather.

Size	Max. Oil Contents	Weight of Desiccant	Overall Length (A)	Overall Diameter (B)
R	1500 Litres	0.60 Kg	158mm	108mm
R1	3000 Litres	1.20 Kg	260mm	108mm
R2	4750 Litres	1.90 Kg	362mm	108mm
S	1130 Litres	0.45 Kg	170mm	127mm
T	2250 Litres	0.90 Kg	270mm	127mm
U	4500 Litres	1.80 Kg	470mm	127mm

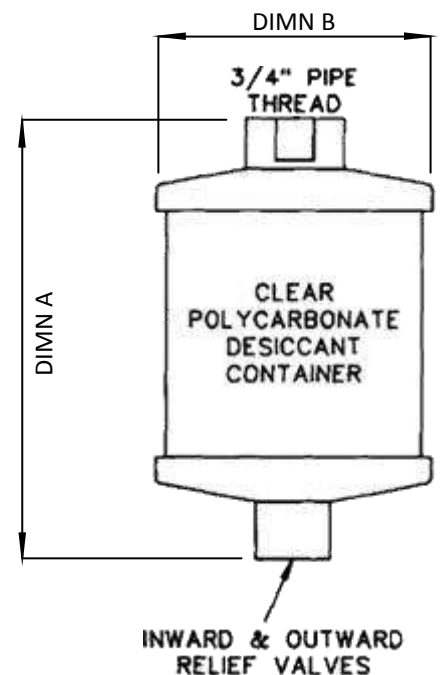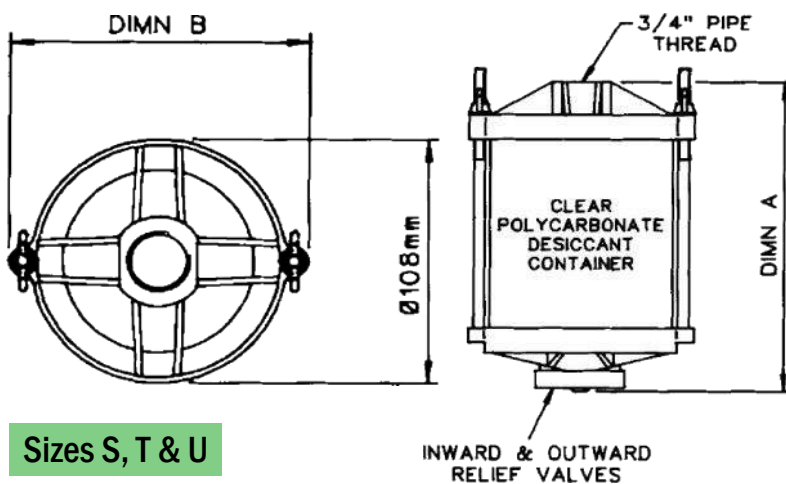

## Quick Change

- ◆ ENVIROGEL cartridges can be refilled, replaced or reactivated
- ◆ Rapid cartridge replacement
- ◆ No special tools required
- ◆ Minimum downtime and maintenance
- ◆ Ideal for planned maintenance cycles



Transformer Breathers can be changed in a matter of minutes with Brownell's replacement cartridges. (Size W illustrated)

## FAQs

**Q: Can I fit a Transformer Breather, which has a larger ENVIROGEL capacity than my existing Transformer Breather?**

A: Yes, for example you can use a Size R1 Transformer Breather to replace an R type which will significantly increase the time between ENVIROGEL maintenance.

**Q: Are there any specific safety considerations when handling Transformer Breathers and ENVIROGEL?**

A: We recommend when handling ENVIROGEL, suitable precautions are taken (as with any potentiality dust generating material) an approved respiratory mask is used.

**Q: What is the recommended method for disposing of used ENVIROGEL?**

A: We suggest that used ENVIROGEL is disposed of at a registered landfill site in accordance with local authority regulations.

**Q: How can I reactive saturated ENVIROGEL?**

A: Following the safety procedures for handling ENVIROGEL. Heating the ENVIROGEL for 3-4 hours at 95°C will recover 95% of the adsorption capacity.



## INSTALLATION, OPERATING & MAINTENANCE INSTRUCTIONS

### FOR BLD9662/01-3 TRANSFORMER BREATHERS

#### Description

The S, T & U Transformer Breathers consist of a top moulding with metal adaptor, a refillable desiccant container with stainless steel guard and a bottom moulded assembly which houses the inlet and outlet relief valve. All items are clamped together by two-threaded tie rods.



#### Installation

The Breather is supplied with a threaded sealing plug, which is fitted into the atmosphere air inlet on the top moulding. This is to prevent any water vapour ingress whilst in store. This plug should be removed immediately prior to the top moulding (with adaptor) being screwed to the air vent pipe of the equipment. The thread size of the metal adaptor on the top moulding of the breather is  $\frac{3}{4}$  inch BSPP Female. When fitting the breather to the transformers pipe it should only be fitted by the metal adaptor, the transformer breather must not be twisted from the body or the supporting tie rods as this will damage the end mouldings.



The breather is now ready to use.

**Since the change from oil seal bowls to relief valves no other work is involved in the installation as the valves prevent any water vapour ingress from the atmosphere.**

#### Operation

Periodic inspection should be carried out to monitor the condition of the desiccant charge. The breathers are charged with ENVIROGEL desiccant. This material changes in colour from orange to green as it becomes saturated with water vapour. When the colour change reaches the indicator line on the label on the desiccant container, it should be re-charged with fresh ENVIROGEL.

#### Desiccant

All Brownell transformer breathers are filled with non carcinogenic silica gel called ENVIROGEL. For more information about ENVIROGEL go to [www.envirogel.co.uk](http://www.envirogel.co.uk)

#### Maintenance

The only maintenance necessary to keep the breather in a fully active condition is the replacement of the spent desiccant as follows:

1. Loosen the wing nuts on the tie rods until the desiccant container and guard can be removed from between the top and bottom mouldings.
2. Remove the top perforated cover and empty the spent desiccant from the container. This material may be disposed of in a normal landfill site.

3. Fill the container with active Envirogel desiccant (Refills of the correct grade and quantity are available from Brownell Limited). Lightly tap the container to settle the desiccant and top up if necessary.
4. Replace the perforated cover and refit the container between the top and bottom mouldings and guard ensuring that it is correctly fitted between the sealing gaskets.
5. Screw the wing nuts home, being careful not to over tighten as this can distort the moulding.

NOTE: If it is necessary to replace the complete desiccant container, instead of re-charging the existing unit, ensure that the self-adhesive aluminum foil vapour barriers are removed from the top and bottom of the container before installation.

### **DESICCANT REFILLS**

	Size S	Size T	Size U
<b>Refill Part No.</b>	BL/D6750/01	BL/D6750/02	BL/D6750/03
<b>Complete Desiccant Container Part No.</b>	BL/D6437/01	BL/D6437/02	BL/D6437/03

As indicated above, individual refills containing sufficient Envirogel desiccant of the correct grade and volume are available. This method of supply is recommended to users who have a limited requirement.

As an alternative to individual refills for users who have a regular requirement, 25, 50 & 125kg sealed drums of the correct grade and size of desiccant are available.

It must be emphasised, however, that careful housekeeping is necessary when dispensing desiccant from bulk containers.

Ensure that the container is open for the minimum time necessary to remove the required quantity and that is properly sealed immediately after use.

Please contact our technical Support Division on 020 838 8408 or 020 8965 9281 for further information and guidance if required.

**BROWNELL**  
L I M I T E D

Unit 2, Abbey Rd Industrial Park  
Commercial Way, Park Royal  
London, NW10 7XF

Tel: **020 8965 9281** Fax: **020 8965 3239**

E-Mail: [info@brownell.co.uk](mailto:info@brownell.co.uk)  
Website: [www.envirogel.co.uk](http://www.envirogel.co.uk)  
Website: [www.tankventdryer.com](http://www.tankventdryer.com)



# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

---

## SECTION 1: Identification of the substance/mixture and of the company/undertaking

### 1.1 Product identifier

<b>Trade name or designation of the mixture</b>	Self-Indicating Silica Gel, Orange to Green
<b>Registered number</b>	Not available
<b>Synonyms Issue</b>	Silica, amorphous, silica, precipitated and gel
<b>Date Version</b>	12 <sup>th</sup> May 2014
<b>Number Revision</b>	06
<b>Date Supersedes</b>	03 <sup>rd</sup> January 2017

### 1.2 Relevant identified uses of the substance or mixture and uses advised against

<b>Identified uses</b>	Desiccant. For adsorption of moisture and prevention of corrosion and mould growth
<b>Uses advised against</b>	No other uses are advised

### 1.3 Details of the supplier of the safety data sheet

<b>Supplier Name</b>	Brownell Limited
<b>Address</b>	Unit 2, Abbey Road Industrial Park, Commercial Way Park Royal London NW10 7XF
<b>Country</b>	UK
<b>Telephone</b>	+44 (0) 208 965 9281
<b>Fax</b>	+44 (0) 208 965 3239
<b>Email</b>	info@brownell.co.uk
<b>Contact</b>	Robert Beasley
<b>Website</b>	www.brownell.co.uk

**1.4 Emergency telephone number** +44 (0) 20 8838 8408 – (08:00 – 17:00) office hours

## SECTION 2: Hazards identification

### 2.1 Classification of the substance or mixture

The mixture has been assessed and/or tested for its physical, health and environmental hazards and the following classification applies.

#### Classification according to Regulation (EC) No. 1272/2008 as amended

This substance does not meet the criteria for classification according to the Regulation (EC) 1272/2008 as amended.

<b>Physical hazard</b>	Not classified as a physical hazard.
<b>Human health hazard</b>	Not classified as a health hazard.
<b>Environmental hazard</b>	Not classified as an environmental hazard.



# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

## Addition information

Repeated exposure may cause skin dryness or cracking.

Exposure to powder or dusts may be irritating to eyes, nose and throat.

## 2.2 Label elements

### Labelling according to Regulation (EC) No 1272/2008 [CLP/GHS]

**Product identifier** Not applicable

**Hazard statements** Not applicable

**Precautionary statements** Not applicable

**Supplemental hazard information** Not applicable

**Special rules for supplemental label elements for certain mixtures** Not applicable

**Additional labeling** Not applicable

## 2.3 Other hazards

Not applicable

## SECTION 3: Composition/information on ingredients

### 3.1 Substances

Substance name	Silica Gel (Silicon Dioxide) >98%	Methyl Violet <0.2%	Water <2%
Index No	-	-	-
EC No	231-545-4	208-953-6	231-791-2
REACH No	JT211170-39	-	-
CAS No	(12926-00-8) 7631-86-9	548-62-9	7732-18-5

**Purity** Not Applicable

**Synonyms** Silica, amorphous; silica, precipitated and gel.

**Stabilisers** Not Applicable

**Hazard Impurities** Not Applicable

### 3.2 Mixtures

Not applicable

#### Additional information

This mixture does not contain further substances fulfilling the criteria of hazard class "acute toxicity" according to CLP regulation.

## SECTION 4: First Aid measures

### General information

If exposed or concerned, get medical advice/attention. Show this safety data sheet to the doctor in attendance.

### 4.1 Description of first aid measures

#### Inhalation

If dust from the material is inhaled, remove the affected person immediately from the source of exposure to fresh air, seek medical attention if symptoms develop or persist.

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

---

<b>Skin contact</b>	Wash spillage from skin with soap and water, seek medical attention if irritation develops and persists.
<b>Eye Contact</b>	Do not rub eyes. Rinse with water, seek medical attention if irritation develops and persists.
<b>Ingestion</b>	Rinse out mouth with water thoroughly; seek medical attention if symptoms occur. If ingestion of a large amount does occur, seek medical attention.

## 4.2 Most important symptoms and effects, both acute and delayed

<b>Symptoms</b>	Dust may irritate the respiratory tract, skin and eyes.
-----------------	---

## 4.3 Indication of any immediate medical attention and special treatment needed

<b>Notes for the doctor</b>	Provide general supportive measures and treat symptomatically. Keep victim under observation. Symptoms may be delayed.
-----------------------------	---

## SECTION 5: Firefighting measures

### 5.1 Extinguishing media

<b>Suitable extinguishing media</b>	Any media suitable for the surrounding fire.
<b>Unsuitable extinguishing media</b>	Not applicable and unused material will not burn.

### 5.2 Special hazards arising from the substance or mixture

<b>Hazardous combustion products</b>	Inorganic compound, not combustible and is not considered to be a fire hazard.
--------------------------------------	--

### 5.3 Advice for firefighters

<b>Additional information</b>	Special protective equipment for fire-fighters - Full protective clothing must be worn in case of fire and appropriate breathing equipment for surrounding fire.
-------------------------------	--

## SECTION 6: Accidental release measure

### 6.1 Personal precautions, protective equipment and emergency procedures.

<b>For non-emergency personnel</b>	
<b>Protective equipment</b>	Avoid inhalation of dust from the spilled material. Wear a dust mask if dust is generated above exposure limits. Wear appropriate protective equipment and clothing during clean-up. Ensure adequate ventilation.
<b>Emergency procedures</b>	Keep unnecessary personnel away.

<b>6.2 Environmental precautions</b>	No special precautions.
--------------------------------------	-------------------------

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

## 6.3 Methods and materials for containment and cleaning up

<b>For containment</b>	Contain spillage, collect material using a vacuum cleaner equipped with HEPA filter and collect in suitable container for disposal.
<b>For cleaning up</b>	Large Spills: Wet down with water and pile for later disposal. Shovel the material into waste container. Following product recovery, flush area with water.  Small Spills: Sweep up or vacuum up spillage to avoid the generation of dust during clean-up and collect in suitable container for disposal.

## 6.4 Reference of other sections

<b>Additional information</b>	For personal protection, see section 8 of the SDS. For waste disposal, see section 13.
-------------------------------	--

## SECTION 7: Handling and Storage

### 7.1 Precautions for safe handling

<b>Protective measures</b>	
<b>Advice on safe handling</b>	Wear appropriate personal protective equipment. Do not breathe dust from this material, avoid creating any dust and contact with skin and eyes as this may cause irritation.
<b>Fire preventions</b>	During handling electrostatic charges can accumulate, therefore static electricity and formation of sparks must be prevented, use proper bonding and/or grounding procedures.
<b>Aerosol and dust generation preventions</b>	Keep formation of airborne dusts to a minimum. Provide appropriate exhaust ventilation at places where dust is formed.
<b>Environment precautions</b>	No special environmental precautions required.
<b>Advice on general occupational hygiene</b>	Observe good industrial hygiene practices.

### 7.2 Conditions for safe storage, including any incompatibilities

<b>Technical measures and storage conditions</b>	Suitable for any general chemical storage area. Provide appropriate exhaust ventilation at places where dust is formed.
<b>Packaging materials</b>	Keep all material in an air-tight container, material is hygroscopic.
<b>Requirements for storage rooms and vessels</b>	All containers must be kept in a dry, cool place. Store in a well-ventilated place.
<b>Hints on storage assembly:</b>	
<b>Storage class</b>	Not Available
<b>Materials to avoid</b>	Not Applicable

### 7.3 Specific end uses

<b>Recommendations</b>	Not applicable
<b>Specific end uses</b>	The specified uses for this material are shown in section 1 of the document.



# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

## SECTION 8: Exposure controls/personal protection

### 8.1 Control Parameters

#### 8.1.1 Occupational exposure limits:

UK. EH40 Workplace Exposure Limits (WELs)

Substance Name	EC-No.	CAS-No.	Type	Value	Occupational exposure limit value	
					Long Term	Short Term
Silica, Amorphous – Inhalable dust	231-545-4	(12926-00-8) 7631-86-9	TWA	OES 6mg/m <sup>3</sup>	8 Hours	-
Silica, Amorphous – Respirable dust	231-545-4	(12926-00-8) 7631-86-9	TWA	OES 2.4mg/m <sup>3</sup>	8 Hours	-
Silica gel	231-545-4	(12926-00-8) 7631-86-9	TWA	ACGIH: TLV 10mg/m <sup>3</sup>	8 Hours	-
Methyl Violet	208-953-6	548-62-9	TWA	ACGIH: 0.5mg/m <sup>3</sup>	8 Hours	-

**8.1.2 Biological limits values** No biological exposure limits noted for the ingredient(s).

**8.1.3 Exposure limits at intended use** Not applicable

**8.1.4 DNEL/PNEC-values** DNEL / PNEC < 1 = No immediate concern

**8.1.5 Risk management measures according to used control banding approach** Not applicable

### 8.2 Exposure controls

**8.2.1 Appropriate engineering controls:** Engineering methods to prevent or control exposure are preferred. Methods include process or personnel enclosure, mechanical ventilation (dilution and local exhaust) and control of process conditions.

#### 8.2.2 Personal protective equipment

**Eye / Face protection:**

**Suitable eye protection** Wear suitable eye protection (safety glasses with side shields).

**Skin protection:**

**Hand protection**

Suitable gloves can be recommended by the glove supplier.

**Body protection**

Wear lab coat over normal work clothing (long sleeved shirts and long pants) is recommended.

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

## Respiratory protection

Avoid inhalation of dust. Wear suitable respiratory protection equipment if working in confined spaces with inadequate ventilation or whenever there is any risk of the exposure limits being exceeded.

## Thermal hazards

None known

## 8.2.3 Environmental exposure controls

None known

## SECTION 9: Physical and chemical properties

### 9.1 Information on basic physical and chemical properties

#### Appearance:

**Physical state:** Solid beads

**Colour:** Dry: Yellow/Orange Saturated: Green

**Odour:** Odourless

**pH**

2-10 (5% Aqueous Solution)

**Melting Point**

>1000°C

**Boiling Point**

Not Applicable

**Flash Point**

Not Applicable

**Evaporation rate**

Not available

**Flammability (solid, gas)**

Non-flammable

**Upper/lower flammability or explosive limits**

**Upper explosive limits** Not Applicable

**Lower explosive limits** Not Applicable

**Vapour pressure**

Not available

**Vapour density**

Not available

**Relative density**

2.1 (water = 1)

**Solubility(ies)**

Less 1.0% in weight

**Partition coefficient:**

Not available

**n-octanol/water**

**Auto-ignition temperature**

Not available

**Decomposition**

Not available

**temperature**

**Viscosity**

Not available

**Viscosity, dynamic**

Not available

**Viscosity, cinematic**

Not available

**Explosive properties**

Not available

**Oxidising properties**

Not available

### 9.2 Other information:

**Physical hazards**

**Explosives:**

Not available

**Flammable gases:**

Not applicable

**Flammable aerosols:**

Not applicable

**Oxidising gases:**

Not available

**Gases under pressure:**

Not available

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

<b>Flammable liquids:</b>	Not applicable
<b>Flammable solids:</b>	Not applicable
<b>Self-reactive substances and mixtures</b>	Not available
<b>Pyrophoric liquids</b>	Not available
<b>Pyrophoric solids</b>	Not available
<b>Self-heating substances and mixtures</b>	Not available
<b>Substances or mixtures which, in contact with water emit flammable gases</b>	Not available
<b>Oxidising liquids</b>	Not available
<b>Oxidising solids</b>	Not available
<b>Organic peroxides</b>	Not available
<b>Metal corrosion</b>	Not available

## SECTION 10: Stability and reactivity

<b>10.1 Reactivity</b>	The product is stable and non-reactive under normal conditions of use, storage and transport
<b>10.2 Chemical stability</b>	Material is stable under normal conditions and hygroscopic
<b>10.3 Possibility of hazardous reactions</b>	No dangerous reaction known under conditions of normal use
<b>10.4 Conditions to avoid</b>	Not available
<b>10.5 Incompatible materials</b>	Not available
<b>10.6 Hazardous decomposition products</b>	No hazardous decomposition products are known

## SECTION 11: Toxicological information

### 11.1 Information on toxicological effects

#### 11.1.1 Substances

##### Acute toxicity: Animal data

Substance	Effect dose / concentration	Value	Species
Acute oral toxicity	LD50	>15,000mg/kg	Rat
Acute dermal toxicity	LD50	>5,000mg/kg	Rabbit
Acute inhalation	LC50	>0.139mg/1/14h	Rat

<b>Skin corrosion/irritation</b>	No data available
<b>Eye damage/irritation</b>	No data available

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

---

<b>Sensitisation to the respiratory tract/skin</b>	No data available
<b>Germ cell mutagenicity</b>	No data available
<b>Carcinogenicity</b>	Amorphous silica is not classifiable as to its carcinogenicity to humans (Group 3).
<b>Reproductive toxicity</b>	No data available
<b>Specific target organ toxicity (single exposure)</b>	No data available
<b>Specific target organ toxicity (repeated exposure)</b>	No data available
<b>Aspiration hazard</b>	Dust may irritate lungs. Amorphous silica is not known to cause silicosis.
<b>Physical, chemical and toxicological characteristics</b>	
<b>In case of ingestion</b>	No data available
<b>In case of skin contact</b>	Dust may have a drying effect on the skin.
<b>In case of inhalation</b>	Synthetic amorphous silica gel has little adverse effect on lungs and does not produce significant disease or toxic effect when exposure is kept below the permitted limits. However existing medical conditions (eg asthma, bronchitis) may be aggravated by exposure to dust. Effects of dust may be greater and occur at lower levels of exposure in smokers compared to non-smokers.
<b>In case of eye contact</b>	Dust may cause discomfort and mild irritation.

**11.1.2 Mixtures** No data available

## SECTION 12: Ecological information

<b>12.1 Toxicity</b>	Synthetic amorphous silica is virtually inert and has no known adverse effect on the environment and not toxic to aquatic life
<b>12.2 Persistence and degradability</b>	The product solely consists of inorganic compounds which are not biodegradable. The methods for determining the biological degradability are not applicable to inorganic substances.
<b>12.3 Bioaccumulative potential</b>	Does not bioaccumulate.
<b>12.4 Mobility in soil</b>	Insoluble and thus presents a low mobility in most soils.
<b>12.5 Results of PBT and vPvB assessment</b>	This substance is not classified as PBT or vPvB according to current EU criteria.
<b>12.6 Other adverse effects</b>	No data available

## SECTION 13: Disposal considerations

<b>13.1 Waste treatment methods</b>	
<b>Product / packaging disposal</b>	Product can be reactivated in an oven for re-use.

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

## **Waste codes / waste designations according to EWC/AVV**

The Waste code should be assigned in discussion between the user, the producer and the waste disposal company. This material is not classified as hazardous waste under EEC Directive 91/689/EEC.

## **Packaging**

No data available

## **Waste treatment options**

Disposal of in accordance with all applicable local and national regulations. This material is not classified as special waste under UK Special Waste Regulations 1996 and can be disposed of by landfill at an approved site.

## **Other disposal recommendations**

Dispose in accordance with all applicable regulations.

## **SECTION 14: Transport information**

### **14.1 UN No.**

Not classified as dangerous goods under the United Nations Transport Recommendations.

### **14.2 UN Proper Shipping name**

Not applicable.

### **14.3 Transport hazard class(es)**

Not applicable.

#### **Hazard label(s)**

### **14.4 Packing group**

Not applicable.

### **14.5 Environmental hazards**

Not applicable.

### **14.6 Special precautions for user**

Not applicable.

### **14.7 Transport in bulk**

Not applicable.

**according to Annex II of  
MARPOL 73/78 and the IBC  
Code**

**Land transport (ADR/RID)**

Not regarded as dangerous goods

**Inland Waterway transport  
(ADN)**

Not regarded as dangerous goods

**Sea transport (IMDG)**

Not regarded as dangerous goods

**Air transport (ICAO-TI / IATA-  
DGR)**

Not regarded as dangerous goods

## **SECTION 15: Regulatory information**

### **15.1 Safety, health and environmental regulations/legislation specific for the substance or mixture**

#### **15.1.1 EU regulations**

**Authorisations:**

Not applicable

**Restrictions on use:**

Not applicable

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

---

## Other EU Regulations:

### Directive 2010/75/EC on industrial emissions

Not listed

### Directive 2004/42/CE on the limitation of emissions of volatile organic compounds

Not listed

### Regulation (EC) No. 842/2006 on certain fluorinated greenhouse gases

Not listed

### Regulation (EC) No. 1005/2009 on substances that deplete the ozone layer, Annex I

Not Listed

### Regulation (EC) No. 1005/2009 on substances that deplete the ozone layer, Annex II

Not Listed

### Regulation (EC) No. 649/2012 concerning the export and import of dangerous chemicals, Annex I, Part 1 as amended

Not Listed

### Regulation (EC) No. 649/2012 concerning the export and import of dangerous chemicals, Annex I, Part 2 as amended

Not Listed

### Regulation (EC) No. 649/2012 concerning the export and import of dangerous chemicals, Annex I, Part 3 as amended

Not Listed

### Regulation (EC) No. 649/2012 concerning the export and import of dangerous chemicals, Annex V as amended

Not Listed

## 15.1.2 National regulations

Not Available

## 15.2 Chemical safety assessment

No Chemical Safety Assessment has been carried out.

### International Inventories

Country(s) or region

Australia

Inventory name

Australian Inventory of Chemical  
Substances (AICS)

On inventory (yes/no)\*

Yes

Canada

Domestic Substances List (DSL)

Yes

Canada

Non-Domestic Substances List (NDSL)

No

China

Inventory of Existing Chemical  
Substances in China (IECSC)

Yes

Europe

European Inventory of New and Existing  
Chemicals (EINECS)

Yes

# Safety Data Sheet

According to Regulation (EC) No 1907/2006 (REACH)

**BROWNELL**  
L I M I T E D

**Trade Name:** Brownell Limited

**Product:** Self-Indicating Silica Gel, Orange to Green

**Version No:** MCS/101/01/MSDS - 06 / EN

**Revision Date:** 03.01.2017

**Print Date:** 03.01.2017

Europe	European List of Notified Chemical Substances (ELINCS)	No
Japan	Inventory of Existing and New Chemical Substances (ENCS)	Yes
Korea	Existing Chemicals List (ECL)	Yes
New Zealand	New Zealand Inventory	Yes
Philippines	Philippine Inventory of Chemicals and Chemical Substances (PICCS)	Yes
United States & Puerto Rico	Toxic Substances Control Act (TSCA) Inventory	Yes

A "Yes" indicates that all components of this product comply with the inventory requirements administered by the governing country(s)

## SECTION 16: Other information

<b>16.1 Indication of changes</b>	MSDS first issued MSDS revision MSDS Revised MSDS Revised MSDS Revised	18 <sup>th</sup> April 2000 20 <sup>th</sup> November 2002 10 <sup>th</sup> December 2008 11 <sup>th</sup> October 2011 12 <sup>th</sup> May 2014
<b>16.2 Abbreviations and acronyms</b>	Not applicable	
<b>16.3 Key literature references and sources for data</b>	ECHA European Chemicals agency	
<b>16.4 Classification for mixtures and used evaluation method according to regulation (EC) 1272/2008 [CLP]</b>	Regulation (EU) No. 1272/2008. Classification, labelling and packaging of substances and mixtures. The product does not need to be labelled in accordance with Directive 67/548/EEC. Not classified as a hazardous substance or mixture according to Directive 1999/45/EC.	
<b>16.5 Relevant R-, H- and EUH-phrases (number and full text)</b>	Not applicable	
<b>16.6 Training advice</b>	Follow training instructions when handling this material.	
<b>16.7 Further information</b>	Not available.	
<b>Disclaimer</b>	The information provided in the SDS is correct to the best of our knowledge at the date of publication. This document is intended as a guide for safe handling, storage and use in known industrial applications. The manufacturer makes no representation, warranty or guarantee as to its accuracy, reliability or completeness nor assumes any liability for its use. It is the users responsibility to confirm in advance that the information is current, applicable and suitable to their circumstances for each particular use. No representative of ours has authority to waive this provision.	



SECTION  
11

APPENDIX E

L.V. FUSE SWITCH:  
SOCOMEK 400A

(PRODUCT CATALOGUE - 30 PAGES)







# FUSERBLOC

Fuse combination switches  
for industrial fuses up to 1250 A



FUSERBLOC  
630 to 1250 A



FUSERBLOC  
32 to 400 A



FUSERBLOC  
20 to 32 A

## Function

FUSERBLOC are manually operated multipolar fuse combination switches. They make and break on load and provide safety isolation and protection against overcurrent for any low voltage electrical circuit.

## Advantages

### Improved safety

- Complete isolation of the fuse with double breaking per pole (top and bottom of fuse).
- Positive break indication.
- IP2X protection with terminal shrouds front panel.

### High breaking capacity

Protection against overloads and short-circuits thanks to high breaking capacity fuses (100 kA rms).

### Specific functionalities for simplified use

- TEST position for testing control circuits without power using U-type auxiliary contacts. In TEST position, the enclosure door can be opened.
- Mechanical or electronic fuse melting detection system (see DDMM or FMD).

## The solution for

- > Motor load break
- > Protection of industrial cabinet



## Strong points

- > Improved safety
- > High breaking capacity
- > Specific functionalities for simplified use

## A complete range.

- > Centred or left side operation, rear connections, plug-in connections. Please consult us.

## Conformity to standards

- > IEC 60947-3
- > EN 60947-3
- > BS EN 60947-3
- > NBN EN 60947-3
- > IEC 60269-1
- > DIN EN 60269-1
- > NF EN 60269-1
- > IEC 60269-2
- > VDE 0636-1
- > VDE 0660-107
- > Standards UL: see FUSERBLOC UL




## Approvals and certifications<sup>(1)</sup>



<sup>(1)</sup> Product reference on request.

## Customised solutions

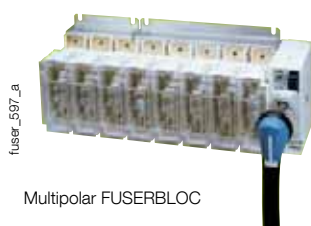

Multipolar FUSERBLOC



Centred operation


## What you need to know

- In addition to the FUSERBLOC rating, product selection also depends on the fuse characteristics and functional specifications, which need to be in accordance with the application. SOCOMEC FUSERBLOC are available for utilisation with **NFC, DIN or BS88 fuses**.

- Whether it is 3 pole + switched neutral or 3 pole + solid neutral, the **FUSERBLOC 20 to 32 A** with **direct front operation** and **external operation** is the best suited solution in compact design.




- From 32 to 400 A, the FUSERBLOC is available in 2, 3 or 4 poles with **direct right side operation**.



- From 630 to 1250 A, the FUSERBLOC allows **direct** and **external front left or right side operation** in 2, 3 or 4 poles.



- With external operation, it is possible to operate the device in 3 ways:
  - **Front operation**
  - **Right side operation**
  - **Left side operation**.

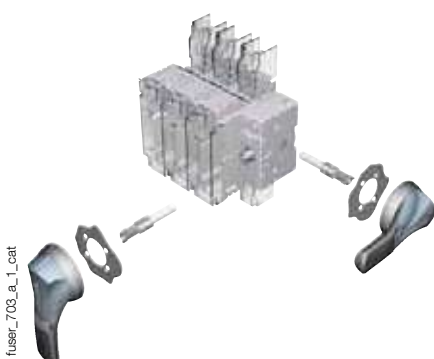

- For ratings 20 to 400 A, the **flat mounting kit** provides a compact solution ideally suited to withdrawable applications.



- Maintenance of outputs from the DC common bus. The **FUSERBLOC LMDC** is the most compact solution and the most economical for your maintenance requirements (please consult us).



# FUSERBLOC

Fuse combination switches

for industrial fuses up to 1250 A

## References

### BS 88 - External front and side operation - 20 to 160 A

Rating (A) Fuse size Frame size	Number of poles	Reference Switch I-O	Reference Changeover I - O - II	External front handle I-O	TEST External front handle I-O TEST	External right side handle I -O	Changeover external front handle I - O - II	Shaft extensions for handle	Terminal shrouds <sup>(3)</sup>	U type A/C <sup>(2)</sup>	Integrated solid neutral link						
20 A A1 0	3 P	3641 3000	3680 3000					320 mm 1401 0532									
	3 P + switched neutral	3641 4000	3680 4000														
	3 P+solid neutral	3641 5000															
CD 32 A A1 0	3 P	3641 3001	3680 3001														
	3 P + switched neutral	3641 4001	3680 4001														
	3 P + solid neutral	3641 5001															
32 A A1 11	2 P	3841 2003		Black S1 type IP55 1411 2111 <sup>(1)</sup>	Black S1 type IP65 1413 2115 <sup>(1)</sup>	Black S1 type IP55 1415 2111 <sup>(1)</sup>	Black S1 type IP55 1411 2113 <sup>(1)</sup>										
	3 P	3841 3003	3880 3003														
	4 P	3841 6003	3880 6003														
63 A A2-A3 12	2 P	3841 2006															
	3 P	3841 3006	3880 3006														
	4 P	3841 6006	3880 6006														
100 A A4 <sup>(4)</sup> 13	2 P	3841 2010		Red/Yellow S1 type 1414 2111	Red/Yellow S1 type IP65 1414 2115	Red/Yellow S1 type IP65 1418 2111	Red/Yellow S1 type IP65 1414 2113	Standard	1 contact NO 3999 0701								
	3 P	3841 3010	3880 3010														
	4 P	3841 6010	3880 6010														
CD 160 A A3-A4 <sup>(4)</sup> 13 A	2 P	3841 2014								Red/Yellow S2 type IP65 1424 2111	Red/Yellow S2 type IP65 1424 2115	Red/Yellow S2 type IP65 1428 2111	Red/Yellow S2 type IP65 1424 2113		1 contact NC 3999 0702	3829 9310	
	3 P	3841 3014	3880 3014														
	4 P	3841 6014	3880 6014														
160 A A4 14	2 P	3841 2015		Black S2 type IP55 1421 2111 <sup>(1)</sup>	Black S2 type IP65 1423 2115 <sup>(1)</sup>	Black S2 type IP55 1425 2111 <sup>(1)</sup>	Black S2 type IP55 1421 2113 <sup>(1)</sup>		2 P 3998 2016 3 P 3998 3016 4 P 3998 4016							3829 9320	
	3 P	3841 3015	3880 3015														
	4 P	3841 6015	3880 6015														
160 A B1-B2 14	2 P	3841 2016															
	3 P	3841 3016	3880 3016														
	4 P	3841 6016	3880 6016														

(1) Standard.

(2) 4 auxiliary contacts as standard without additional contact holder.

(3) Top/bottom.

(4) For fuse size A4: max diameter 31 mm.

## BS 88 - External front and side operation - 200 to 1250 A

Rating (A) Fuse size Frame size	Number of poles	Reference Switch I-O	Reference Changeover I - O - II	External front handle I-O	TEST External front handle I-O TEST	External right side handle I - O	Changeover external front handle I - O - II	Shaft extensions for handle	Terminal shrouds <sup>(3)</sup>	U type A/C <sup>(2)</sup>	Integrated solid neutral link
CD 200 A A3-A4 (5) 13 A	2 P	3841 2019		Black S2 type IP55 1421 2111 <sup>(1)</sup> Red/Yellow S2 type IP65 1424 2111	Black S2 type IP65 1423 2115 <sup>(1)</sup> Red/Yellow S2 type IP65 1424 2115	Black S2 type IP55 1425 2111 <sup>(1)</sup> Red/Yellow S2 type IP65 1428 2111	Black S2 type IP55 1421 2113 <sup>(1)</sup> Red/Yellow S2 type IP65 1424 2113	320 mm 1400 1032	2 P 3998 2016		3829 9320
	3 P	3841 3019	3880 3019						3 P 3998 3016		
	4 P	3841 6019	3880 6019						4 P 3998 4016		
200 A B1-B2 15	2 P	3841 2021									3829 9325
	3 P	3841 3021	3880 3021						2 P 3998 2025		
	4 P	3841 6021	3880 6021						3 P 3998 3025		
250 A B1-B2-B3 15	2 P	3841 2024							4 P 3998 4025		
	3 P	3841 3024	3880 3024								
	4 P	3841 6024	3880 6024								
315 A B1-B2-B3 16	2 P	3841 2031								1 contact NO 3999 0701 1 contact NC 3999 0702	3829 9339
	3 P	3841 3031	3880 3032 <sup>(6)</sup>						2 P 3898 2040		
	4 P	3841 6031	3880 6032 <sup>(6)</sup>						3 P 3898 3040		
400 A B1-B2- B3-B4 16	2 P	3841 2038							4 P 3898 4040		
	3 P	3841 3038									
	4 P	3841 6038									
630 A C1-C2 17	2 P	3821 2063		Black S3 type IP65 1433 3111 <sup>(1)</sup> Red/Yellow S3 type IP65 1434 3111		Black S3 type IP65 1437 3111 <sup>(1)</sup> Red/Yellow S3 type IP65 1438 3111		320 mm 1400 1232			3829 9308
	3 P	3821 3063							2 P 3898 2080		
	4 P	3821 6063							3 P 3898 3080		
800 A C1-C2-C3 17	2 P	3821 2080							4 P 3898 4080		
	3 P	3821 3080									
	4 P	3821 6080									
1250 A D1 18	2 P	3821 2120							3898 2120	3829 9312	
	3 P	3821 3120							3898 3120		
	4 P	3821 6120							3898 4120		

(1) Standard.

(2) 4 auxiliary contacts as standard without additional contact holder.

(3) Top/bottom.

(4) 8 AC as standard without support (the support is for 8 additional auxiliary contacts).

(5) For fuse size A4: max diameter 31 mm.

(6) Terminal shrouds: 3 P - 3998 3025, 4 P - 3998 4025.

# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## References (continued)

### BS 88 - Direct operation - 20 to 160 A

Rating (A) Fuse size Frame size	Number of poles	Reference Side direct operation	Reference Direct front operation	Side direct handle	Direct front handle	Auxiliary contacts	Terminal shrouds <sup>(3)</sup>	Cage terminals	Handle key interlocking accessories <sup>(2)</sup>						
20 A A1 0	3 P		3641 3000		Black 3629 4012	1 contact NO/NC A-type 3999 0001 <sup>(1)</sup>  2 contacts NO/NC A-type 3999 0002 <sup>(1)</sup>									
	3 P + switched neutral		3641 4000												
	3 P + solid neutral		3641 5000												
CD 32 A A1 0	3 P		3641 3001								Black 3629 7900	1 contact NO/NC A-type 3999 0021 <sup>(1)</sup>  2 contacts NO/NC A-type 3999 0022 <sup>(1)</sup>	Standard	Standard	3629 7903
	3 P + switched neutral		3641 4001												
	3 P + solid neutral		3641 5001												
32 A A1 1	2 P	3625 2003	consult us		Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913							
	3 P	3625 3003	consult us												
	4 P	3625 6003	consult us												
63 A A2-A3 2	2 P	3625 2006	consult us							Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913		
	3 P	3625 3006	consult us												
	4 P	3625 6006	consult us												
100 A A4 <sup>(4)</sup> 3	2 P	3625 2010	consult us		Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913							
	3 P	3625 3010	consult us												
	4 P	3625 6010	consult us												
CD 160 A A3-A4 <sup>(4)</sup> 3 A	2 P	3625 2014	consult us							Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913		
	3 P	3625 3014	consult us												
	4 P	3625 6014	consult us												
160 A A4 4	2 P	3625 2015	consult us		Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913							
	3 P	3625 3015	consult us												
	4 P	3625 6015	consult us												
160 A B1-B2 4	2 P	3625 2016	consult us							Black 3629 7901	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913		
	3 P	3625 3016	consult us												
	4 P	3625 6016	consult us												

(1) Max. 2 contacts.

(2) Lock not included.

(3) Top/bottom.

(4) For fuse size A4: max diameter 31 mm.

## BS 88 - Direct operation - 200 to 400 A

Rating (A) Fuse size Frame size	Number of poles	Reference Side direct operation	Reference Direct front operation	Side direct handle	Direct front handle	Auxiliary contacts	Terminal shrouds <sup>(3)</sup>	Cage terminals	Handle key interlocking accessories <sup>(2)</sup>
CD 200 A A3-A4 <sup>(4)</sup> 13 A	2 P	3625 2019	consult us	Black 3629 7901	consult us	1 contact NO/NC A-type 3999 0021 <sup>(1)</sup>  2 contacts NO/NC A-type 3999 0022 <sup>(1)</sup>	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3 P 5400 3016 4 P 5400 4016	3629 7913
	3 P	3625 3019	consult us						
	4 P	3625 6019	consult us						
200 A B1-B2 5	2 P	3625 2021	consult us				2 P 3998 2025 3 P 3998 3025 4 P 3998 4025	3 P 5400 3025 4 P 5400 4025	
	3 P	3625 3021	consult us						
	4 P	3625 6021	consult us						
250 A B1-B2-B3 5	2 P	3625 2024	consult us				2 P 3998 2025 3 P 3998 3025 4 P 3998 4025	3 P 5400 3025 4 P 5400 4025	
	3 P	3625 3024	consult us						
	4 P	3625 6024	consult us						
315 A B1-B2-B3 6	2 P	3625 2032	consult us				2 P 3998 2025 3 P 3998 3025 4 P 3998 4025	3 P 5400 3040 4 P 5400 4040	
	3 P	3625 3032	consult us						
	4 P	3625 6032	consult us						
400 A B1-B2-B3-B4 6	2 P	3625 2039	consult us				2 P 3998 2025 3 P 3998 3025 4 P 3998 4025	3 P 5400 3040 4 P 5400 4040	
	3 P	3625 3039	consult us						
	4 P	3625 6039	consult us						

(1) Max. 2 contacts.

(2) Lock not included.

(3) Top/bottom.

(4) For fuse size A4: max diameter 31 mm.

## BS 88 - Direct operation - 630 to 1250 A

Rating (A) Fuse size Frame size	Number of poles	Reference Side direct operation	Reference Direct front operation	Side direct handle	Direct front handle	Auxiliary contacts	Terminal shrouds <sup>(3)</sup>	Cage terminals	Handle key interlocking accessories <sup>(2)</sup>					
630 A C1-C2 17	2 P	3821 2063	3821 2063	Black 3899 7911	Black 3899 6011	1 contact NO U-type 3999 0701 <sup>(1)</sup>	2 P 3898 2080							
	3 P	3821 3063	3821 3063				3 P 3898 3080							
	4 P	3821 6063	3821 6063				4 P 3898 4080							
800 A C1-C2-C3 17	2 P	3821 2080	3821 2080		Black 3899 7011	1 contact NC U-type 3999 0702 <sup>(1)</sup>	3898 2120							
	3 P	3821 3080	3821 3080				3898 3120							
	4 P	3821 6080	3821 6080				3898 4120							
1250 A D1 18	2 P	3821 2120	3821 2120			Black 3899 7011						3898 2120		
	3 P	3821 3120	3821 3120									3898 3120		
	4 P	3821 6120	3821 6120									3898 4120		

(1) Max. number of U-type auxiliary contacts is 8.

(2) Lock not included.

(3) Top/bottom.

# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## References

### NFC and DIN - External front and right side operation - 25 to 125 A

Rating (A) / Fuse / Frame size	No. of poles	Switch I-O-TEST	Changeover switch I-O-II	External front handle	TEST external front handle	External right side handle	Changeover external front handle	Shaft for external handle	Auxiliary contacts <sup>(2)</sup>	Terminal shrouds <sup>(1)</sup>	Integrated solid neutral link
25 A 10 x 38 0	3 P	3631 3002 <sup>(1)</sup>	3670 3002	S1 type	S1 type						
	3 P + switched neutral	3631 4002 <sup>(1)</sup>	3670 4002								
	3 P + solid neutral	3631 5002 <sup>(1)</sup>									
CD 32 A 10 x 38 0	3 P	3631 3003	3670 3003	Black IP55 1411 2111	Black IP65 1413 2115			320 mm 1401 0532	U-type 1 contact 3999 0710		
	3 P + switched neutral	3631 4003	3670 4003								
	3 P + solid neutral	3631 5003									
32 A 14 x 51 0	3 P	3631 3004 <sup>(1)</sup>	3670 3004	Red/Yellow IP65 1414 2111	Red/Yellow IP65 1414 2115	Black IP55 1415 2111	Black IP55 1411 2113				
	3 P + switched neutral	3631 4004 <sup>(1)</sup>	3670 4004								
	3 P + solid neutral	3631 5004 <sup>(1)</sup>									
50 A 14 x 51 11	2 P	3831 2005		S1 type	S1 type						
	3 P	3831 3005 <sup>(1)</sup>	3870 3005								
	4 P	3831 6005 <sup>(1)</sup>	3870 6005								
63 A 00C 12	2 P	3831 2006		Black IP65 1411 2111	Black IP65 1413 2115					Standard	
	3 P	3831 3006 <sup>(1)</sup>	3870 3006								
	4 P	3831 6006 <sup>(1)</sup>	3870 6006								
100 A 22 x 58 13	2 P	3831 2010		Red/Yellow IP65 1414 2111	Red/Yellow IP65 1414 2115						
	3 P	3831 3010 <sup>(1)</sup>	3870 3010								
	4 P	3831 6010 <sup>(1)</sup>	3870 6010								
125 A 22 x 58 13	2 P	3831 2011		S2 type	S2 type	S2 type	S2 type	320 mm 1400 1032 <sup>(2)</sup>	U-type 1 contact 3999 0600		
	3 P	3831 3011	3870 3011								
	4 P	3831 6011	3870 6011								
125 A 00 13	2 P	3831 2012		Black IP65 1421 2111	Black IP55 1423 2115	Black IP55 1425 2111	Black IP55 1421 2113				
	3 P	3831 3012	3870 3012								
	4 P	3831 6012	3870 6012								

(1) Available enclosed (see page "Enclosed fuse switches" page XXX).

(2) Top/bottom.

(3) Maximum 4 contacts.



## NFC and DIN - External front and right side operation - 160 to 1250 A

Rating (A) / Fuse / Frame size	No. of poles	Switch I-O	Changeover switch I-O-II	External front handle	TEST external front handle	External right side handle	Changeover external front handle	Shaft for external handle	Auxiliary contacts	Terminal shrouds <sup>(2)</sup>	Integrated solid neutral link
160 A 00 13	2 P	3831 2015							U-type	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3829 9320
	3 P	3831 3015	3870 3015								
	4 P	3831 6015	3870 6015								
160 A 0 14	2 P	3831 2016		S2 type	S2 type	S2 type	S2 type	320 mm 1400 1032	1 contact 3999 0600 <sup>(3)</sup>	2 P 3998 2016 3 P 3998 3016 4 P 3998 4016	3829 9320
	3 P	3831 3016 <sup>(1)</sup>	3870 3016								
	4 P	3831 6016 <sup>(1)</sup>	3870 6016								
250 A 1 15	2 P	3831 2024		Black IP65 1421 2111	Black IP65 1423 2115	Black IP65 1425 2111	Black IP65 1421 2113		U-type	2 P 3998 2025 3 P 3998 3025 4 P 3998 4025	3829 9325
	3 P	3831 3024 <sup>(1)</sup>	3870 3024								
	4 P	3831 6024 <sup>(1)</sup>	3870 6024								
400 A 2 16	2 P	3831 2038		Red/Yellow IP65 1424 2111	Red/Yellow IP65 1424 2115	Red/Yellow IP65 1428 2111	Red/Yellow IP65 1424 2113		1 contact 3999 0600 <sup>(4)</sup>	2 P 3898 2040 3 P 3898 3040 4 P 3898 4040	3829 9339
	3 P	3831 3038 <sup>(1)</sup>	3870 3039 <sup>(5)</sup>								
	4 P	3831 6038 <sup>(1)</sup>	3870 6039 <sup>(5)</sup>								
630 A 3 17	2 P	3811 2063		S3 type						2 P 3898 2080 3 P 3898 3080 4 P 3898 4080	3829 9308
	3 P	3811 3063 <sup>(1)</sup>									
	4 P	3811 6063 <sup>(1)</sup>									
800 A 3 17	2 P	3811 2080		Red/Yellow IP65 1434 3111		S3 type					
	3 P	3811 3080									
	4 P	3811 6080									
800 A 4 18	2 P	3811 2081		S4 type				320 mm 1400 1232		2 P 3898 2120 3 P 3898 3120 4 P 3898 4120	3829 9312
	3 P	3811 3081									
	4 P	3811 6081									
1250 A 4 18	2 P	3811 2120		Red/Yellow IP65 1444 3111							
	3 P	3811 3120									
	4 P	3811 6120									

(1) Available enclosed (see "Enclosed fuse switches" page XXX).

(2) Top/bottom.

(3) Maximum 4 contacts.

(4) Maximum 8 contacts.

(5) Terminal shrouds: 3 P - 3998 3025, 4 P - 3998 4025.

# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## References (continued)

### NFC and DIN - Direct operation - 25 to 125 A

Rating (A) Fuse size Frame size	No. of poles	Direct side operation	Direct front operation	Direct handle	Auxiliary contacts	Terminal shrouds	Cage terminals	Lock for fuse protection cover	Handle key interlocking accessories <sup>(6)</sup>										
25 A 10 x 38 0	3 P		3631 3002	Black 3629 4012 <sup>(1)(2)</sup>	A-type 1 contact NO/NC 3999 0001 <sup>(3)</sup>  A-type 2 contacts NO/NC 3999 0002 <sup>(3)</sup>	Standard	Standard	Standard											
	3 P + switched neutral		3631 4002																
	3 P + solid neutral		3631 5002																
CD 32 A 10 x 38 0	3 P		3631 3003							A-type 1 contact NO/NC 3999 0001 <sup>(3)</sup>  A-type 2 contacts NO/NC 3999 0002 <sup>(3)</sup>	Standard	Standard	Standard						
	3 P + switched neutral		3631 4003																
	3 P + solid neutral		3631 5003																
32 A 14 x 51 0	3 P		3631 3004												A-type 1 contact NO/NC 3999 0001 <sup>(3)</sup>  A-type 2 contacts NO/NC 3999 0002 <sup>(3)</sup>	Standard	Standard	Standard	
	3 P + switched neutral		3631 4004																
	3 P + solid neutral		3631 5004																
50 A 14 x 51 1	2 P	3615 2005	consult us	Black 3629 7900 <sup>(5)(2)</sup>	A-type 1 contact NO/NC 3999 0021 <sup>(3)</sup>  A-type 2 contacts NO/NC 3999 0022 <sup>(3)</sup>			3999 8906	3629 7903										
	3 P	3615 3005	consult us																
	4 P	3615 6005	consult us																
63 A 00C 2	2 P	3615 2006	consult us							A-type 1 contact NO/NC 3999 0021 <sup>(3)</sup>  A-type 2 contacts NO/NC 3999 0022 <sup>(3)</sup>			3999 8912	3629 7913					
	3 P	3615 3006	consult us																
	4 P	3615 6006	consult us																
100 A 22 x 58 3	2 P	3615 2010	consult us	Black 3629 7901 <sup>(5)(2)</sup>		2 P 3998 2016 <sup>(4)</sup> 3 P 3998 3016 <sup>(4)</sup> 4 P 3998 4016 <sup>(4)</sup>	3 P 5400 3016 4 P 5400 4016	3999 8912	3629 7913										
	3 P	3615 3010	consult us																
	4 P	3615 6010	consult us																
125 A 22 x 58 3	2 P	3615 2011	consult us							Black 3629 7901 <sup>(5)(2)</sup>	2 P 3998 2016 <sup>(4)</sup> 3 P 3998 3016 <sup>(4)</sup> 4 P 3998 4016 <sup>(4)</sup>	3 P 5400 3016 4 P 5400 4016	3999 8912	3629 7913					
	3 P	3615 3011	consult us																
	4 P	3615 6011	consult us																
125 A 00 3	2 P	3615 2012	consult us												Black 3629 7901 <sup>(5)(2)</sup>	2 P 3998 2016 <sup>(4)</sup> 3 P 3998 3016 <sup>(4)</sup> 4 P 3998 4016 <sup>(4)</sup>	3 P 5400 3016 4 P 5400 4016	3999 8912	3629 7913
	3 P	3615 3012	consult us																
	4 P	3615 6012	consult us																

(1) Direct front operation.

(2) Standard.

(3) Maximum 2 contacts.

(4) Top or bottom.

(5) Direct right side operation.

(6) Locking using RONIS EL11AP lock (lock not included).

## NFC and DIN - Direct operation - 160 to 400 A

Rating (A) Fuse size Frame size	No. of poles	Direct side operation	Direct front operation	Direct handle	Auxiliary contacts	Terminal shrouds	Cage terminals	Lock for fuse protection cover	Handle key interlocking accessories <sup>(5)</sup>
160 A 00 3	2 P	3615 2015	consult us	Black 3629 7901 <sup>(4)(1)</sup>	A-type 1 contact NO/NC 3999 0021 <sup>(2)</sup>	2 P 3998 2016 <sup>(3)</sup>	3 P 5400 3016 4 P 5400 4016	3999 8912	3629 7913
	3 P	3615 3015	consult us			3 P 3998 3016 <sup>(3)</sup>			
	4 P	3615 6015	consult us			4 P 3998 4016 <sup>(3)</sup>			
160 A 0 4	2 P	3615 2016	consult us	Black 3629 7901 <sup>(4)(1)</sup>	A-type 1 contact NO/NC 3999 0021 <sup>(2)</sup>	2 P 3998 2025 <sup>(3)</sup>	3 P 5400 3025 4 P 5400 4025	3999 8216	
	3 P	3615 3016	consult us					3999 8316	
	4 P	3615 6016	consult us					3999 8416	
250 A 1 5	2 P	3615 2024	consult us		A-type 2 contacts NO/NC 3999 0022 <sup>(2)</sup>	2 P 3998 2025 <sup>(3)</sup>	3 P 5400 3025 4 P 5400 4025	3999 8225	
	3 P	3615 3024	consult us					3999 8325	
	4 P	3615 6024	consult us					3999 8425	
400 A 2 6	2 P	3615 2039	consult us		A-type 2 contacts NO/NC 3999 0022 <sup>(2)</sup>	3 P 3998 3025 <sup>(3)</sup>	3 P 5400 3040 4 P 5400 4040	3999 8240	
	3 P	3615 3039	consult us					3999 8340	
	4 P	3615 6039	consult us					3999 8440	

(1) Standard.

(2) Maximum 2 contacts.

(3) Top/bottom.

(4) Direct right side operation.

(5) Locking using RONIS EL11AP lock (lock not included).

## NFC and DIN - Direct operation - 630 to 1250 A

Rating (A) Fuse size Frame size	No. of poles	Direct side and front operation	Direct front handle	Direct side handle	Auxiliary contacts	Terminal shrouds
630 A 3 17	2 P	3811 2063	Black 3899 6011 <sup>(1)(2)</sup>	Black 3899 7911	U-type 1 contact NO 3999 0701 <sup>(4)</sup> 1 contact NC 3999 0702 <sup>(4)</sup>	2 P 3898 2080 <sup>(3)</sup>
	3 P	3811 3063				3 P 3898 3080 <sup>(3)</sup>
	4 P	3811 6063				4 P 3898 4080 <sup>(3)</sup>
800 A 3 17	2 P	3811 2080	Black 3899 6011 <sup>(1)(2)</sup>	Black 3899 7911	U-type 1 contact NO 3999 0701 <sup>(4)</sup> 1 contact NC 3999 0702 <sup>(4)</sup>	2 P 3898 2120 <sup>(3)</sup>
	3 P	3811 3080				3 P 3898 3120 <sup>(3)</sup>
	4 P	3811 6080				4 P 3898 4120 <sup>(3)</sup>
800 A 4 18	2 P	3811 2081	Black 3899 7011 <sup>(1)(2)</sup>	Black 3899 7911	U-type 1 contact NO 3999 0701 <sup>(4)</sup> 1 contact NC 3999 0702 <sup>(4)</sup>	2 P 3898 2120 <sup>(3)</sup>
	3 P	3811 3081				3 P 3898 3120 <sup>(3)</sup>
	4 P	3811 6081				4 P 3898 4120 <sup>(3)</sup>
1250 A 4 18	2 P	3811 2120	Black 3899 7011 <sup>(1)(2)</sup>	Black 3899 7911	U-type 1 contact NO 3999 0701 <sup>(4)</sup> 1 contact NC 3999 0702 <sup>(4)</sup>	2 P 3898 2120 <sup>(3)</sup>
	3 P	3811 3120				3 P 3898 3120 <sup>(3)</sup>
	4 P	3811 6120				4 P 3898 4120 <sup>(3)</sup>

(1) Direct front operation.

(2) Standard.

(3) Top/bottom.

(4) Maximum 8 contacts.

## Accessories

### Direct operation handle

For front operation				
Rating (A)	Frame size	Figure no.	Handle colour	Reference
20 ... 32	0	1	Black	3629 4012
20 ... 32	0	1	Red	3629 4013
32 ... 400	11 ... 16	2	Black	3629 7910
630 ... 800	17	2	Black	3899 6011
800 ... 1250	18	3	Black	3899 7011

For right side operation				
Rating (A)	Frame size	Figure no.	Handle colour	Reference
32 ... 63	1/2	4	Black	3629 7900
100 ... 400	3 ... 6	4	Black	3629 7901
630 ... 1250	17 ... 18	5	Black	1437 7911



### External front operation handle

Padlockable handle in position 0							
Rating (A)	Frame size	Handle type	Handle colour	Operation	External IP <sup>(1)</sup>	Defeatable handle	Reference
CD 25 ... 63	0/11/12	S1	Black	I - 0	IP55	Yes	1411 2111
CD 25 ... 63	0/11/12	S1	Black	I - 0	IP65	Yes	1413 2111
CD 25 ... 63	0/11/12	S1	Red/Yellow	I - 0	IP65	Yes	1414 2111
CD 25 ... 63	0/11/12	S1	Black	I - 0 - Test	IP65	Yes	1413 2115
CD 25 ... 63	0/11/12	S1	Red/Yellow	I - 0 - Test	IP65	Yes	1414 2115
100 ... 400	13 ... 16	S2	Black	I - 0	IP55	Yes	1421 2111
100 ... 400	13 ... 16	S2	Black	I - 0	IP65	Yes	1423 2111
100 ... 400	13 ... 16	S2	Red/Yellow	I - 0	IP65	Yes	1424 2111
100 ... 400	13 ... 16	S2	Black	I - 0 - Test	IP55	Yes	1423 2115
100 ... 400	13 ... 16	S2	Red/Yellow	I - 0 - Test	IP65	Yes	1424 2115
630 ... 800	17	S3	Black	I - 0	IP65	Yes	1433 3111
630 ... 800	17	S3	Red/Yellow	I - 0	IP65	Yes	1434 3111
800 ... 1250	18	S4	Black	I - 0	IP65	Yes	1443 3111
800 ... 1250	18	S4	Red/Yellow	I - 0	IP65	Yes	1444 3111

(1) IP: protection degree according to IEC 60529 standard.

Padlockable handle in position 0 and I					
Rating (A)	Frame size	Handle type	Handle colour	External IP <sup>(1)</sup>	Reference
CD 25 ... 63	0/11/12	S1	Black	IP65	1413 2311
100 ... 400	13 ... 16	S2	Black	IP65	1423 2311

(1) IP: protection degree according to IEC 60529 standard.



### External right side operation handle

Rating (A)	Frame size	Handle type	Handle colour	External IP <sup>(1)</sup>	Reference
CD 25 ... 63	0/11/12	S1	Black	IP55	1415 2111
CD 25 ... 63	0/11/12	S1	Black	IP65	1417 2111
CD 25 ... 63	0/11/12	S1	Red/Yellow	IP65	1418 2111
100 ... 400	13 ... 16	S2	Black	IP55	1425 2111
100 ... 400	13 ... 16	S2	Black	IP65	1427 2111
100 ... 400	13 ... 16	S2	Red/Yellow	IP65	1428 2111
630 ... 1250	17/18	S3	Black	IP65	1437 3111
630 ... 1250	17/18	S3	Red/Yellow	IP65	1438 3111

(1) IP: protection degree according to IEC 60529 standard.



## External front operation handle with metal padlocking lever

Rating (A)	Frame size	Handle type	Handle colour	External IP <sup>(1)</sup>	Defeatable handle	Reference
CD 25 ... 63	0/11/12	S1	Black	IP65	Yes	141D 2911
CD 25 ... 63	0/11/12	S1	Red/Yellow	IP65	Yes	141E 2911
100 ... 400	13 ... 16	S2	Black	IP65	Yes	142D 2911
100 ... 400	13 ... 16	S2	Red/Yellow	IP65	Yes	142E 2911
600 ... 800	17	S3	Black	IP65	Yes	143D 3911
600 ... 800	17	S3	Red/Yellow	IP65	Yes	143E 3911
800 ... 1250	18	S4	Black	IP65	Yes	144D 3911
800 ... 1250	18	S4	Red/Yellow	IP65	Yes	144E 3911

(1) IP: protection degree according to IEC 60529 standard.



## S-type handle adapter

### Use

Enables S-type handles to be fitted in place of existing older style Socomec handles.  
Adapter can be utilised as a spacer to increase the distance between the panel door and the handle lever.

### Dimensions

Adds 12 mm to the depth.

Handle colour	To be ordered in multiples of	External IP <sup>(1)</sup>	Reference
Black	1	IP65	1493 0000

(1) IP: protection degree according to IEC 60529 standard.



## Alternative S-type handle cover colours

### Use

For single lever handles S1, S2, S3 types and double lever handle, S4 type.  
Other colours: please consult us.

Handle colour	To be ordered in multiples of	Handle	Reference
Light grey	50	Type S1, S2	1401 0001
Dark grey	50	Type S1, S2	1401 0011
Light grey	50	S4 type	1401 0031
Dark grey	50	S4 type	1401 0041



## Flat mounting kit

### Use

The flat mounting providing compact solution ideally suited to withdrawable applications.  
Kit to be used with a handle for flat mounting.

Rating (A)	Frame size	Type	Reference
CD 25 ... CD 32	0	Kit + Shaft 200 mm	1429 7709
50 ... 400	11 ... 16	Kit + Shaft 200 mm	1429 7710



## Handle for flat mounting kit

Padlockable handle in position 0					
Rating (A)	Frame size	Handle type	Handle colour	External IP <sup>(1)</sup>	Reference
CD 25 ... 63	0/11/12	S1	Black	IP55	1411 2111 <sup>(2)</sup>
CD 25 ... 63	0/11/12	S1	Red/Yellow	IP65	1414 2111 <sup>(2)</sup>
100 ... 400	13 ... 16	S2	Black	IP55	1421 2111 <sup>(2)</sup>
100 ... 400	13 ... 16	S2	Red/Yellow	IP65	1424 2111 <sup>(2)</sup>

(1) IP: protection degree according to IEC 60529 standard.

(2) Defeatable handle in position I.



# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## Accessories (continued)

### Front operation shaft support accessory

#### Use

This support maintains shaft position for extension shafts greater than 320 mm in length.



fuser\_698\_a\_2\_cat

Rating (A)	Frame size	Reference
50 ... 400	11 ... 16	3899 0400

### Shaft guide for external operation

#### Use

To guide the shaft extension into the external handle.

This accessory enables the handle to engage the extension shaft with a misalignment of up to 15 mm.

Required for a shaft lengths over 320 mm.



access\_260\_a\_2\_cat

Description	Reference
Shaft guide	1429 0000

### Shaft for external front operation handle

#### Use

Standard lengths:

- 200 mm
- 320 mm
- 400 mm
- 500 mm.

Other lengths: consult us.

Rating (A)	Frame size	Shaft length (mm)	Reference
CD 20 ... CD 32	0	200	1401 0520
CD 20 ... CD 32	0	320	1401 0532
CD 20 ... CD 32	0	400	1401 0540 <sup>(1)</sup>
32 ... 400	11 ... 16	200	1400 1020
32 ... 400	11 ... 16	320	1400 1032
32 ... 400	11 ... 16	500	1400 1050 <sup>(2)</sup>
630 ... 800	17	200	1400 1220
630 ... 1250	17/18	320	1400 1232
630 ... 1250	17/18	500	1400 1250 <sup>(1)</sup>

<sup>(1)</sup> Use the shaft guide accessory for external operation.


<sup>(2)</sup> Use the front operation shaft support accessory.

access\_145\_b\_1\_cat



access\_369\_a\_1\_cat

access\_202\_a\_1\_x\_cat



#### Dimension X (mm) for FUSERBLOC BS88

Rating (A)	CD 20 ... CD 32	32	63 ... 160	CD160 ... CD200	160 ... 200	250 ... 315	630 ... 800	1250
Fuse size	A1	A1	A2-A3/A4	A3-A4	B1-B2	B1-B2-B3	C1-C2-C3	D1
Frame size	0	11	12/13/14	13 A	14/15	15/16	17	18
Shaft length (mm)								
200	102 ... 245	100 ... 230	125 ... 230	150 ... 230	135 ... 230	160 ... 230	270 ... 304	
320	102 ... 365	100 ... 350	125 ... 350	150 ... 350	135 ... 350	160 ... 350	270 ... 424	304 ... 424
400	102 ... 445							
500		100 ... 530	125 ... 530	150 ... 530	135 ... 530	160 ... 530	270 ... 600	304 ... 600

#### Dimension X (mm) for FUSERBLOC NFC and DIN


Rating (A)	CD 25 ... CD 32	50	63	100 ... 160	160	250 ... 400	630 ... 800	800 ... 1250
Fuse size	10x38/14x51	14x51	00C	22x58/00	0	1/2	3	4
Frame size	0	11	12	13	14	15/16	17	18
Shaft length (mm)								
200	102 ... 245	100 ... 230	125 ... 230	135 ... 230	145 ... 230	160 ... 230	270 ... 304	
320	102 ... 365	100 ... 350	125 ... 350	135 ... 350	145 ... 350	160 ... 350	270 ... 424	304 ... 424
400	102 ... 445	100 ... 430	125 ... 430	135 ... 430	145 ... 430	160 ... 430	270 ... 504	304 ... 504
500		100 ... 530	125 ... 530	135 ... 530	145 ... 530	160 ... 530	270 ... 604	304 ... 604

## Shaft extensions for external side operation

### Use

Standard lengths, 200 mm.

Rating (A)	Frame size	Handle type	Dimension Y (mm)	Shaft length (mm)	Reference
CD 25 ... CD 32	0	S	36 ... 159	200	1401 0520
50 ... 400	11 ... 16	S	36 ... 172	200	1400 1020
630 ... 1250	17/18	S	15 ... 150	200	1400 1220

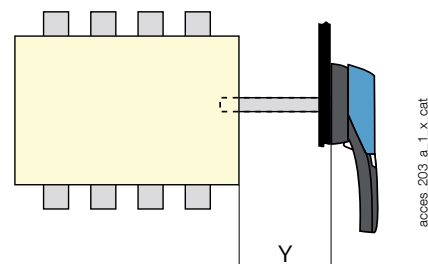

## Integrated solid neutral link

### Use

Fixing the solid neutral onto the mechanism produces a device with a solid neutral of the same size as a standard three-pole device (+ 6 mm).

BS88 for external front operation			
Rating (A)	Switch body size	Bar rating (A)	Reference
100	13	125	3829 9310
CD 160 ... CD 200	13a	200	3829 9320
160	14	200	3829 9320
200 ... 250	15	250	3829 9325
315 ... 400	16	400	3829 9339
630 ... 800	17	800	3829 9308
1250	18	1250	3829 9312

NFC and DIN For external front operation			
Rating (A)	Frame size	Bar rating (A)	Reference
100 ... 125	13	125	3829 9310
160	13	160	3829 9320
160	14	200	3829 9320
250	15	250	3829 9325
400	16	400	3829 9339
630 ... 800	17	800	3829 9308
800 ... 1250	18	1250	3829 9312



## Solid neutral module

BS88 for external front operation				
Rating (A)	Switch body size	I <sub>max</sub> (A)	Distance (mm)	Reference
32	11	32	27	3629 9227
63	12	63	32	3629 9232
100	13	100	36	3629 9236
CD 160 ... CD 200	13 a	200	36	3629 9237
160	14	160	50	3629 9250
200 ... 250	15	250	60	3629 9260
315 ... 400	16	400	66	3629 9266
630 ... 800	17	800	94	3629 9294
1250	18	1250	120	3629 9212


NFC and DIN For external front operation				
Rating (A)	Frame size	I <sub>max</sub> (A)	Distance (mm)	Reference
50	1/11	50	27	3629 9227
63	2/12	63	32	3629 9232
100 ... 160	3/13	160	36	3629 9236
160	4/14	160	50	3629 9250
250	5/15	250	60	3629 9260
400	6/16	400	60	3629 9266
630 ... 800	17	800	94	3629 9294
800 ... 1250	18	1250	120	3629 9212



## Solid links

BS88 switches				
Rating (A)	Frame size	Fuse size	I <sub>max</sub> (A)	Reference
32	11	A1	32	3629 9003
63	12	A2-A3	63	3629 9006
100	13	A4	160	3629 9010
CD 160	13a	A3-A4	160	3629 9010
160	14	A4	160	3629 9010
160	14	B1-B2	200	3629 9016
CD 200	13a	A3-A4	160	3629 9010
200	15	B1-B2	200	3629 9016
250	15	B1-B2-B3	315	3629 9025
315	16	B1-B2-B3	315	3629 9025
400	16	B1-B2-B3-B4	400	3629 9040
630 ... 800	17	C1-C3	800	3629 9063
1250	18	D1	1250	3629 9120

NFC and DIN switches				
Rating (A)	Frame size	Fuse size	I <sub>max</sub> (A)	Reference
50	1/11	14 x 51	50	6029 0000
63	2/12	00C	160	6420 0000
100 ... 125	3/13	22 x 58	125	6039 0000
125 ... 160	3/13	00	160	6420 0000
160	4/14	0	160	6421 0000
250	5/15	1	250	6421 0001
400	6/16	2	400	6421 0002
630 ... 800	17	3	800	6421 0003
800 ... 1250	18	4	1250	6441 0005

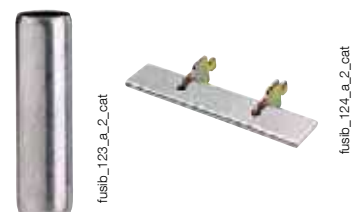



# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## Accessories (continued)

### A-type auxiliary contacts

#### Use

Pre-break and position 0 and I signalling by 1 or 2 NO / NC auxiliary contacts.  
For low level use, specific auxiliary contacts: please consult us.

#### Connection to the control circuit

By 6.35 mm fast-on terminal.

#### Electrical characteristics

30 000 operations.

#### References

NO / NC auxiliary contacts			
Rating (A)	Frame size	Contact(s)	Reference
CD 20 ... CD 32	0	1	3999 0001
CD 20 ... CD 32	0	2	3999 0002
32 ... 400 <sup>(1)</sup>	1 ... 6	1	3999 0021 <sup>(2)</sup>
32 ... 400 <sup>(1)</sup>	1 ... 6	2	3999 0022 <sup>(2)</sup>

(1) Side direct operation switch only.

(2) A type auxiliary contacts cannot be mounted in conjunction with integrated solid neutral.

#### Characteristics

Rating (A)	Current nominal (A)	Operating current I <sub>e</sub> (A)			
		250 VAC AC-13	400 VAC AC-13	24 VDC DC-13	48 VDC DC-13
CD 20 ... 400	16	4	2	12	2



access\_046\_a\_1\_cat



access\_047\_a\_2\_cat

### U-type auxiliary contacts<sup>(1)</sup>

#### Use

Compact universal type auxiliary contacts which can be configured for operation in either, or both, ON and TEST positions for CD 20 to 1250 A FUSERBLOC. Each slot can accommodate up to two interlocked A/Cs.

#### Connection to the control circuit

By terminals with max. section 2 x 2.5 mm<sup>2</sup>.

For FUSERBLOC CD 20 to 400 A: Pre-break and signalling of positions 0, I and TEST.

For FUSERBLOC ≥ 630 A: Pre-break and position 0 and I signalling.

#### References

NC auxiliary contacts			
Rating (A)	Frame size	Contact(s)	Reference
CD 20 ... 1250	0 ... 18	1	3999 0702

NO auxiliary contacts			
Rating (A)	Frame size	Contact(s)	Reference
CD 20 ... 1250	0 ... 18	1	3999 0701

Contact holder for auxiliary contacts			
Rating (A)	Frame size	Contact(s)	Reference <sup>(1)</sup>
CD 20 ... 160	0 ... 14	4 (2 x 2 max)	included
250 ... 400	15/16	8 (4 x 2 max)	included
630 ... 1250	17/18	8 (4 x 2 max)	included

(1) Cannot be mounted in direct operation.


Contact holder for additional auxiliary contacts			
Rating (A)	Frame size	Contact(s)	Reference
CD 20 ... CD 32	0	4 (2 x 2 max)	3999 0710
32 ... 400	11 ... 16	4 (2 x 2 max)	3999 0600

#### Characteristics

Rating (A)	Operating current I <sub>e</sub> (A)			
	250 VAC AC-15	400 VAC AC-15	24 VDC DC-13	48 VDC DC-13
CD 20 ... 1250	3	1.8	2.8	1.4



access\_056\_a\_1\_cat

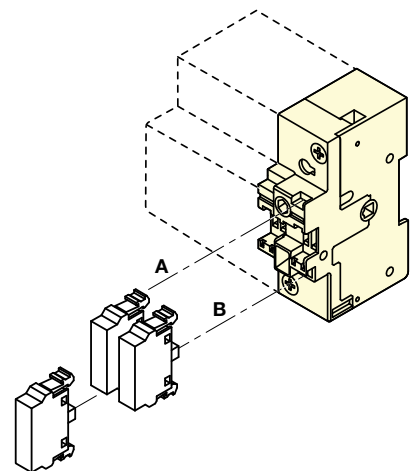

access\_043\_a\_1\_x\_cat

(1) U-type auxiliary contacts cannot be mounted with an integrated solid neutral.

## S and ST-type auxiliary contacts

### Use

For FUSERBLOCs 32 to 1250 A, position 0 and I signalling by 1 to 4 NO + NC auxiliary contacts.

### Electrical principle

The NO + NC S-type auxiliary contacts can be configured as 2 NC or 2 NO.

### References

**S-type auxiliary contacts 0-I**  
for external front and right-side operation (Standard operation)

Rating (A)	Frame size	Contact type	Reference	Drive shaft (optional) Reference
32 ... 1250	11 ... 18	NC+NO	3999 0041 <sup>(1)</sup>	3999 0003

**ST-type auxiliary contacts I-0-TEST**  
for external front and right-side operation (TEST operation)

Rating (A)	Frame size	Contact type	Description	Reference	Drive shaft Reference
32 ... 400	11 ... 16	NC+NO	TEST + ON	3999 0141 <sup>(2)</sup>	3999 0003
32 ... 400	11 ... 16	2 O	TEST + ON	3999 0241 <sup>(2)</sup>	3999 0003

(1) Drive shaft included with Auxiliary Contact

(2) Drive shaft to be ordered separately

### Characteristics

Rating (A)	Current nominal (A)	Operating current I <sub>e</sub> (A)	
		250 VAC AC-13	400 VAC AC-13
32 ... 1250	20	10	8

### Connection

By terminals with max. cross-section 10 mm<sup>2</sup>.

### Mechanical characteristics

30 000 operations.



access\_051\_a\_2\_cat



access\_063\_a\_1\_cat

### Important:

- > For the 400 A frame size 16, an adaptation kit reference 3999 0000 must be ordered in addition to the auxiliary contact kit.

## Fuse cover interlocking

### Use

On NFC and DIN, side direct operation, locking of the opening of the fuse protection cover when FUSERBLOC is engaged (position I).

Rating (A)	Frame size	Fuse size	No. of poles	Reference
CD 20 ... 50	0 ... 11	10 x 38 / 14 x 51	2 / 3 / 4	included
63	12	00C	2 / 3 / 4	3999 8906
100 ... 125	13	22 x 58	2 / 3 / 4	3999 8912
125 ... 160	13	00	2 / 3 / 4	3999 8912
160	14	0	2 P	3999 8216
160	14	0	3 P	3999 8316
160	14	0	4 P	3999 8416
250	15	1	2 P	3999 8225
250	15	1	3 P	3999 8325
250	15	1	4 P	3999 8425
400	16	2	2 P	3999 8240
400	16	2	3 P	3999 8340
400	16	2	4 P	3999 8440

## Terminal shrouds

### Use

Top or bottom IP20 protection (on the front) against direct contact with terminals or connection parts.

Two sets required to fully shroud both incoming and outgoing terminals.

Rating (A)	Frame size	Position	No. of poles	Reference
CD 20 ... 63	0/1/2/12	top / bottom	2 / 3 / 4 P	integrated
100 ... CD 200	3/4/13/14	top / bottom	2 P	3998 2016
100 ... CD 200	3/4/13/14	top / bottom	3 P	3998 3016
100 ... CD 200	3/4/13/14	top / bottom	4 P	3998 4016
200 ... 400	5/6/15	top / bottom	2 P	3998 2025
200 ... 400	5/6/15	top / bottom	3 P	3998 3025
200 ... 400	5/6/15	top / bottom	4 P	3998 4025
315 ... 400	16	top / bottom	2 P	3898 2040
315 ... 400	16	top / bottom	3 P	3898 3040
315 ... 400	16	top / bottom	4 P	3898 4040
630 ... 800	17	top / bottom	2 P	3898 2080
630 ... 800	17	top / bottom	3 P	3898 3080
630 ... 800	17	top / bottom	4 P	3898 4080
800 ... 1250	18	top / bottom	2 P	3898 2120
800 ... 1250	18	top / bottom	3 P	3898 3120
800 ... 1250	18	top / bottom	4 P	3898 4120



fuser\_314\_a\_1\_cat

# FUSERBLOC

## Fuse combination switches

for industrial fuses up to 1250 A

## Accessories (continued)

### NFC and DIN fuse blown indication

#### Use

For fuse cartridge with striker  
(size 14 x 51 22 x 58; 0; 1; 2; 3 and 4).

#### Electrical principle

A NO/NC auxiliary contact detects that the fuse has blown.

#### References

##### NO/NC type auxiliary contacts for 2 pole

Rating (A)	Frame size	Fuses	Contact(s)	Reference
50	11	14 x 51	1 <sup>st</sup>	3994 0405
100 ... 125	13	22 x 58	1 <sup>st</sup>	3994 0210
160	14	0	1 <sup>st</sup>	3994 0216
250	15/16	1-2	1 <sup>st</sup>	3994 0225
400 <sup>(1)</sup>	16	2	1 <sup>st</sup>	3894 0440
630	17	3	1 <sup>st</sup>	3894 1206
800 ... 1250	18	4	1 <sup>st</sup>	3894 1212

##### NO/NC type auxiliary contacts for 3 pole

Rating (A)	Frame size	Fuses	Contact(s)	Reference
CD 32	0	14 x 51	1 <sup>st</sup>	3994 0303
50	11	14 x 51	1 <sup>st</sup>	3994 0405
100 ... 125	13	22 x 58	1 <sup>st</sup>	3994 0310
160	14	0	1 <sup>st</sup>	3994 0316
250	15/16	1-2	1 <sup>st</sup>	3994 0325
400 <sup>(1)</sup>	16	2	1 <sup>st</sup>	3894 0440
630	17	3	1 <sup>st</sup>	3894 1306
800 ... 1250	18	4	1 <sup>st</sup>	3894 1312
50 ... 250	11	-	2 <sup>nd</sup>	3994 1901
400	16	2	2 <sup>nd</sup>	3994 1902
630 ... 1250	16	-	2	3994 1901

##### NO/NC type auxiliary contacts for 4 pole or 3 pole + neutral

Rating (A)	Frame size	Fuses	Contact(s)	Reference
50	11	14 x 51	1 <sup>st</sup>	3994 0405
100 ... 125	13	22 x 58	1 <sup>st</sup>	3994 0410
160	14	0	1 <sup>st</sup>	3994 0416
250	15/16	1-2	1 <sup>st</sup>	3994 0425
400 <sup>(1)</sup>	16	2	1 <sup>st</sup>	3894 0440
630	17	3	1 <sup>st</sup>	3894 1406
800 ... 1250	18	4	1 <sup>st</sup>	3894 1412
50 ... 250	11	-	2 <sup>nd</sup>	3994 1901
400	16	2	2 <sup>nd</sup>	3994 1902
630 ... 1250	16	-	2	3994 1901

(1) For front direct and external left side operation handles,  
please order references 39940225 (2P), 39940325 (3P), 39940425 (4P)

#### Characteristics

Rating (A)	Current nominal (A)	Operating current I <sub>e</sub> (A)			
		250 VAC AC-13	400 VAC AC-13	24 VDC DC-13	48 VDC DC-13
CD 32 ... 1250	16	4	3	12	2

### Electronic fuse blown indication (FMD)

#### Use

Provides fuse blown indication with fuse links without fuse blown indication strikers. Suitable for use with BS88, DIN and UL type fuses.

#### Principle

The Fuse Melting Device (FMD) detects the operation of a fuse and provides a signal via: a relay and 1 LED (FMD10) or a bi-stable relay and 3 LEDs (FMD30).

The FMD can be DIN rail or back plate mounted close to the Fuserbloc, directly mounted on the FUSERBLOC, or it can be door mounted to provide information directly on the front of a panel.

#### References

##### For FUSERBLOC 63 to 1250A - size 000 to 4

Nb of LEDs	Operating voltage	Reference
1 (FMD10)	120 - 260 VAC	3899 1120
1 (FMD10)	380 - 690 VAC	3899 1380
3 (FMD30)	120 - 260 VAC	3899 3120
3 (FMD30)	380 - 690 VAC	3899 3380
Accessories		Reference
Kit for connection accessories	Standard	3819 9120
Kit for connection accessories	Door mounted	3829 9120

#### Relay characteristics

Rating (A)	Relay operating current I <sub>e</sub> (A)	
	AC-15	DC-13
63 ... 1250	2.5 A	0.2



DDMM for cylindrical fuses



DDMM for NH fuses



1 LED version (FMD10)



3 LED version (FMD30)

## Cage terminals

### Use

Connection of bare copper cables onto the terminals (without lugs).

### References


Rating max (A)	Frame size	No. of poles	Reference
CD 20 ... 63	0 ... 12	2 / 3 / 4 P	integrated
100 ... 160	13/14	3 P	5400 3016
100 ... 160	13/14	4 P	5400 4016
250	15	3 P	5400 3025
250	15	4 P	5400 4025
400	16	3 P	5400 3040
400	16	4 P	5400 4040

### Connections

Rating (A)	Flexible cable cross-section (mm²)	Rigid cable cross-section (mm²)	Flexible bar width (mm)	Stripped over (mm)
100 ... 160	16 ... 95	16 ... 95	13	22
250	16 ... 185	16 ... 185	18	27
400	50 ... 240	50 ... 300	20	34

### Dimensions

Rating (A)	A	A1	C	R	ØX	X1	Z
100 ... 160	47.5	22.5	25	20	8.5	M12	10
250	62	31.5	31.5	25	10.5	M16	14
400	71.5	32	38	32	10.5	M20	15

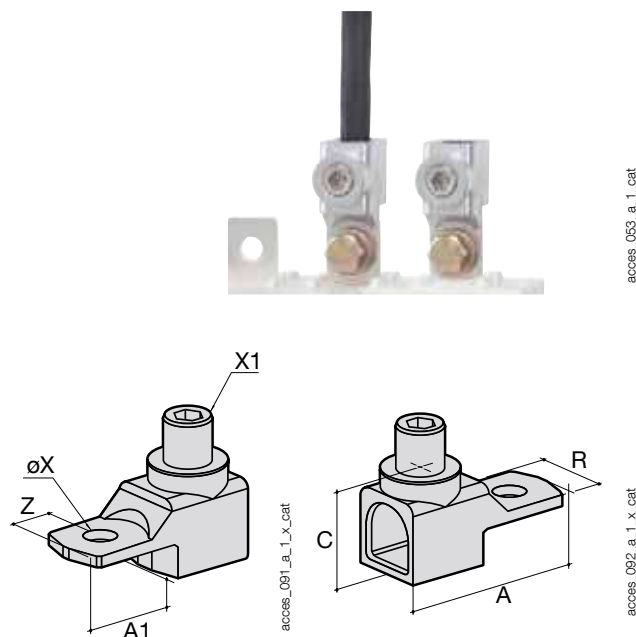

## Handle key interlocking accessories

### Use

Locking in position 0 of the direct, front or right side operation:

- using a padlock (not supplied) in direct right side operation: integrated into the handle,

- using a padlock (not supplied): right-side or front operation switch from 32 to 1250 A, factory integrated

- using a padlock (not supplied) in external operation.

### Locking using RONIS EL 11 AP lock (not supplied)

Rating (A)	Frame size	Operation	Figure n°	Reference
CD 20 ... 1250	0 ... 18	external front	2	1499 7701
32 ... 63	1/2	direct	1	3629 7903
100 ... 400	3 ... 6	direct	1	3629 7913
630 ... 1250	17 ... 18	direct		3829 7923

### Locking using K-type CASTELL lock (not supplied)


Rating (A)	Frame size	Operation	Figure n°	Reference
CD 20 ... 1250	0 ... 18	external front	3	1499 7702

### Locking using FS-type CASTELL lock (not supplied)

Rating (A)	Frame size	Operation	Figure n°	Reference
CD 20 ... 1250	0 ... 18	external front	3	1499 7703

### Locking using XOP (not supplied)

Rating (A)	Frame size	Operation	Reference
CD 20 ... 1250	0 18	external front	1499 7702

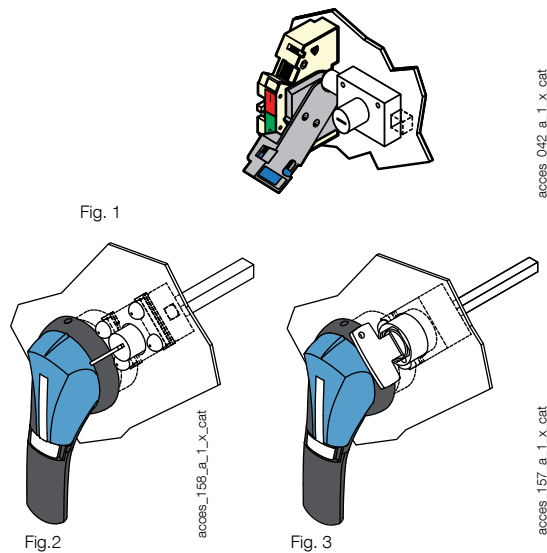

## Label holder

### Use

Recognisable self-adhesive label allowing identification of the devices.

Dimensions W x H (mm)	Nb of pieces in KIT	Reference
18 x 13	5	7769 9999



### Characteristics according to IEC 60947-3

#### 20 to 100 A

Thermal current $I_{th}$ (40°C)	20 A	25 A	CD 32 A	CD 32 A	32 A	50 A	63 A	100 A
BS88/DIN fuse size	A1/-	-/10 x 38	-/10 x 38	A1/14 x 51	A1/-	-/14 x 51	A2-A3/00C	A4*/22 x 58
Frame size for direct operation	0	0	0	0	1	1	2	3
Switch body size for front and side operation	0	0	0	0	11	11	12	13
Rated insulation voltage $U_i$ (V)	800	800	800	800	750	750	750	750
Rated impulse withstand voltage $U_{imp}$ (kV)	8	8	8	8	8	8	8	8

#### Rated operational currents $I_e$ (A)

Rated voltage	Utilisation category	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>
400 VAC	AC-22 A / AC-22 B	20/20	25/25	32/32	32/32	32/32	50/50	63/63	100/100
400 VAC	AC-23 A / AC-23 B	20/20	25/25	32/32	32/32	32/32	50/50	63/63	100/100
690 VAC	AC-22 A / AC-22 B	20/20	25/25	32/32	32/32	32/32	50/50	63/63	100 <sup>(2)</sup> /100 <sup>(2)</sup>
690 VAC	AC-23 A / AC-23 B	20/20	25/25	32/32	32/32	32/32	50/50	63/63	100 <sup>(2)</sup> /100 <sup>(2)</sup>
220 VDC	DC-20 A / DC-20 B			-/32		32/32	50/50	63/63	100/100
220 VDC	DC-21 A / DC-21 B		-/25 <sup>(4)</sup>			32/32	40/40	40/40	100/100
440 VDC	DC-20 A / DC-20 B					32 <sup>(3)</sup> /32 <sup>(3)</sup>	50 <sup>(3)</sup> /50 <sup>(3)</sup>	63 <sup>(3)</sup> /63 <sup>(3)</sup>	100 <sup>(3)</sup> /100 <sup>(3)</sup>
440 VDC	DC-21 A / DC-21 B					32 <sup>(3)</sup> /32 <sup>(3)</sup>	40 <sup>(3)</sup> /40 <sup>(3)</sup>	40 <sup>(3)</sup> /40 <sup>(3)</sup>	100 <sup>(3)</sup> / 100 <sup>(3)</sup>

#### Operational power in AC-23 (kW)

At 400 VAC without pre-break in AC <sup>(1)(5)</sup>	9/9	11/11	15/15	15/15	15/15	25/25	30/30	51/51
At 690 VAC without pre-break in AC <sup>(1)(5)</sup>	15/15	22/22	25/25	25/25	25/25	45/45	55/55	90/90

#### Reactive power (kvar)

At 400 VAC <sup>(5)</sup>	8	11	15	15	15	23	28	45
---------------------------	---	----	----	----	----	----	----	----

#### Fuse protected short-circuit withstand BS88/DIN (kA rms prospective)

Prospective short-circuit (kA rms) <sup>(6)</sup>	80/-	-/100	-/100	80/100	80/100	-/100	80/100	80/100
Associated fuse rating (A) <sup>(6)</sup>	20/-	-/25	-/32	32/32	32/32	-/50	63/63	100/100

#### Short-circuit capacity

Rated peak withstand current (kA peak) <sup>(6)</sup>	5.5	5.5	5.5	5.5	9	7.6	10.6	20
---	-----	-----	-----	-----	---	-----	------	----

#### Fuse selection (maximum fuse size)\*\*

SOCOMECS BS88 - Standard max	6A10 0020	6012 0025	6012 0032	6A10 0032	6A10 0032		6A30 0063	6A40 0100
SOCOMECS BS88 - Motor max	6A1M 0032	6013 0025	6013 0032	6A1M 0063	6A1M 0032		6A3M 0080	6A4M 0125
SOCOMECS DIN - Distribution (gl - gG)						6022 0050	6600 0063	6032 0100
SOCOMECS DIN - Motor (aM)						6023 0050	6601 0063	6033 0100
BUSSMANN - Standard max	NITD 20			NITD 32	NITD 32		BAO 63	CEO 100
BUSSMANN - Motor max	NITD 20M32			NITD 32M63	NITD 32M63		BAO 63M80	CEO 100M125
LAWSON - Standard max	NIT 20			NIT 32	NIT 32		TIS 63	TCP 100
LAWSON - Motor max	NIT 20M32				NIT 20M32		TIS 63M80	CTFP 100M125
GE - Standard max	NIT 20			NET 32	NET 32		TIS 63	TCP 100
GE - Motor max	NIT 20M32			NET 32M63	NET 32M63		TIS 63M80	OCP 100M125

#### Connection

Minimum Cu cable cross-section (mm <sup>2</sup> )	2.5	2.5	2.5	2.5	6	6	10	25
Maximum Cu cable cross-section (mm <sup>2</sup> )	16	16	16	16	25	25	25	95
Maximum busbar width (mm)								20
Min. / Max. tightening torque min (Nm)	2/-	2/-	2/3	2	2.5/3	2.5/3	2.5/3	8.3/13

#### Mechanical characteristics

Durability (number of operating cycles)	20 000	20 000	20 000	20 000	10 000	10 000	10 000	10 000
Weight of 3 P switch (kg)	0.48	0.48	0.48	0.50	0.80	0.80	1	1.5
Weight of 4 P switch (kg)	0.50	0.50	0.50	0.52	1	1	1.3	2
Weight of 1 P extra (kg)					0.2	0.2	0.3	0.5
Frame pitch (mm)					32	27	32	36

(1) Category with index A = frequent operation - Category with index B = infrequent operation.

(2) With terminal shrouds or terminal screen.

(3) 4-pole device with 2 pole in series by polarity.

(4) 3-pole device with 2 poles "+" in series and 1 pole "-".

(5) The power value is given for information only, the current values vary from one manufacturer to another.

(6) For a rated operational voltage  $U_o = 400$  VAC.

\* For fuse size A4: max diameter 31 mm.

\*\* Please ensure that fuse let through current does not exceed short-circuit capacity of the switch (kA peak).

## 125 to 200 A

Thermal current $I_{th}$ (40°C)	125 A	125 A	160 A	CD 160 A	160 A	160 A	CD 200 A	200 A
NFC/DIN fuse size	-/22 x 58	-/00	-/00	A3-A4*/-	A4/0	B1-B2/-	A3-A4*/-	B1-B2/-
Frame size for direct operation	3	3	3		4	4		5
Switch body size for front and side operation	13	13	13	13	14	14	13	15
Rated insulation voltage $U_i$ (V)	750	750	750	750	750	750	750	750
Rated impulse withstand voltage $U_{imp}$ (kV)	8	8	8	8	8	8	8	8

### Rated operational currents $I_e$ (A)

Rated voltage	Utilisation category	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>
400 VAC	AC-22 A / AC-22 B	125/125	125/125	160/160	160/160	160/160	160/160	200/200	200/200
400 VAC	AC-23 A / AC-23 B	125/125	125/125	160/160	160/160	160/160	160/160	200/200	200/200
690 VAC	AC-22 A / AC-22 B	125 <sup>(2)</sup> /125 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	160 <sup>(2)</sup> /160 <sup>(2)</sup>	160 <sup>(2)</sup> /160 <sup>(2)</sup>	160 <sup>(2)</sup> /160 <sup>(2)</sup>	160 <sup>(2)</sup> /160 <sup>(2)</sup>	160 <sup>(2)</sup> /160 <sup>(2)</sup>	200 <sup>(2)</sup> /200 <sup>(2)</sup>
690 VAC	AC-23 A / AC-23 B	100 <sup>(2)</sup> /100 <sup>(2)</sup>	100 <sup>(2)</sup> /100 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	125 <sup>(2)</sup> /125 <sup>(2)</sup>	160 <sup>(2)</sup> /200 <sup>(3)</sup>
220 VDC	DC-20 A / DC-20 B	125/125	125/125	160/160	160/160	160/160	160/160	160/160	200/200
220 VDC	DC-21 A / DC-21 B	100/100	100/100	125/125	125/125	125/125	125/125	125/125	200/200
440 VDC	DC-22 A / DC-22 B	125 <sup>(3)</sup> /125 <sup>(3)</sup>	125 <sup>(3)</sup> /125 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	200 <sup>(3)</sup> /200 <sup>(3)</sup>
440 VDC	DC-23 A / DC-23 B	100 <sup>(3)</sup> /100 <sup>(3)</sup>	100 <sup>(3)</sup> /100 <sup>(3)</sup>	125 <sup>(3)</sup> /125 <sup>(3)</sup>	160 <sup>(3)</sup> /160 <sup>(3)</sup>	125 <sup>(3)</sup> /125 <sup>(3)</sup>	125 <sup>(3)</sup> /125 <sup>(3)</sup>	125 <sup>(3)</sup> /125 <sup>(3)</sup>	200 <sup>(3)</sup> /200 <sup>(3)</sup>

### Operational power in AC-23 (kW)

At 400 VAC without pre-break in AC <sup>(1)(4)</sup>	63/63	63/63	80/80	80/80	80/80	80/80	80/80	100/100
At 690 VAC without pre-break in AC <sup>(1)(4)</sup>	90/90	90/90	110/110	110/110	110/110	110/110	110/110	150/185

### Reactive power (kvar)

At 400 VAC <sup>(4)</sup>	55	55	75	70	75	75	90	90
---------------------------	----	----	----	----	----	----	----	----

### Fuse protected short-circuit withstand (kA rms prospective)

Prospective short-circuit (kA rms) <sup>(5)</sup>	-/100	-/100	-/100 (50)	50/-	80/100	80/100	50/-	80/-
Associated fuse rating (A) <sup>(5)</sup>	-/125	-/125	-/125 (160)	160/-	160/160	160/160	200/-	200/-

### Short-circuit capacity

Rated peak withstand current (kA peak) <sup>(5)</sup>	20	20	20	20	22.7	22.7	20	32.5
---	----	----	----	----	------	------	----	------

### Fuse selection (maximum fuse size)\*\*

SOCOMECS BS88 - Standard max				6A40 0160	6A40 0160	6B20 0160	6A40 0200	6B20 0200
SOCOMECS BS88 - Motor max				6A4M 0160	6A4M 0160	6B1M 0200	6A4M 0315	6B2M 0315
SOCOMECS DIN - Distribution (gl - gG)	6032 0125	6692 0125	6692 0160		6702 0160			
SOCOMECS DIN - Motor (aM)	6033 0125	6693 0125	6693 0160		6703 0160			
BUSSMANN - Standard max				DEO 160	DEO 160	DD 160	DEO 200	DD 200
BUSSMANN - Motor max				CEO 100M160	DEO 100M200	CD 100M200	DEO 200M315	DD 200M315
LAWSON - Standard max				CTFP 160	TFP 160	TF 160	TF 200	TF 200
LAWSON - Motor max				CTCP 100M160	TCP 100M200	TCP 100M200	TC 200M315	TC 200M315
GE - Standard max				TCP 100	TFP 160	TF 160	TF 200	TF 200
GE - Motor max				OCP 100M160	TCP 100M201	TC 100M200	TF 200M315	TF 200M315

### Connection

Minimum Cu cable cross-section (mm <sup>2</sup> )	35	35	35	35	50	50	35	95
Maximum Cu cable cross-section (mm <sup>2</sup> )	95	95	95	95	95	95	95	240
Maximum busbar width (mm)	20	20	20	20	20	20	20	32
Tightening torque min (Nm)	8.3/13	8.3/13	8.3/13	8.3/13	8.3/13	8.3/13	8.3/13	20/26

### Mechanical characteristics

Durability (number of operating cycles)	10 000	10 000	10 000	10 000	10 000	10 000	10 000	10 000
Weight of 3 P switch (kg)	1.5	1.5	1.8	1.8	1.8	1.8	1.8	3.2
Weight of 4 P switch (kg)	2	2	2.3	2.3	2.3	2.3	2.3	4.5
Weight of 1 P extra (kg)	0.5	0.5	0.5	0.5	0.5	0.5	0.5	1.3
Frame pitch (mm)	36	36	36	36	50	50	36	60

(1) Category with index A = frequent operation - Category with index B = infrequent operation.

(2) With terminal shrouds or phase barrier.

(3) 4-pole device with 2 poles in series per polarity.

(4) The power value is given for information only, the current values vary from one manufacturer to another.

(5) For a rated operational voltage  $U_n = 400$  VAC.

\*\* Please ensure that fuse let through current does not exceed short-circuit capacity of the switch (kA peak).



## Characteristics according to IEC 60947-3 (continued)

### 250 to 1250 A

Thermal current $I_{th}$ (40°C)	250 A	315 A	400 A	630 A	800 A	800 A	1250 A
NFC/DIN fuse size	B1-B2-B3/1	B1-B2-B3/-	B1-B2-B3-B4/2	C1-C2/3	C1-C2-C3/3	-/4	D1/4
Frame size for direct operation	5	6	6	17	17	18	18
Switch body size for front and side operation	15	16	16	17	17	18	18
Rated insulation voltage $U_i$ (V)	750	800	1000(800*)	1000	1000	1000	1000
Rated impulse withstand voltage $U_{imp}$ (kV)	8	8	12(8*)	12	12	12	12

### Rated operational currents $I_e$ (A)

Rated voltage	Utilisation category	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>	A/B <sup>(1)</sup>
400 VAC	AC-22 A / AC-22 B	250/250	315/315	400/400	630/630	800/800	800/800	1250/1250
400 VAC	AC-23 A / AC-23 B	250/250	315/315	400/400	630/630	800/800	800/800	1000/1250
690 VAC	AC-22 A / AC-22 B	250 <sup>(2)</sup> /250 <sup>(2)</sup>	315 <sup>(2)</sup> /315 <sup>(2)</sup>	400/400	500/630	800/800	800/800	800/1250
690 VAC	AC-23 A / AC-23 B	250 <sup>(2)</sup> /250 <sup>(2)</sup>	250 <sup>(2)</sup> /315 <sup>(2)</sup>	315/400	315/400	630/630	800/800	800/1250
220 VDC	DC-20 A / DC-20 B	250/250	250/250	400/400	630/630	800/800	800/800	1250/1250
220 VDC	DC-21 A / DC-21 B	200/200	200/200	315/315	630/630	800/800	800/800	1250/1250
440 VDC	DC-22 A / DC-22 B	250 <sup>(3)</sup> / 250 <sup>(3)</sup>	250 <sup>(3)</sup> / 250 <sup>(3)</sup>	315 <sup>(3)</sup> /315 <sup>(3)</sup>	400 <sup>(3)</sup> /630 <sup>(3)</sup>	800 <sup>(3)</sup> / 800 <sup>(3)</sup>	800/800	1250 <sup>(3)</sup> / 1250 <sup>(3)</sup>
440 VDC	DC-23 A / DC-23 B	200 <sup>(3)</sup> / 200 <sup>(3)</sup>	200 <sup>(3)</sup> / 200 <sup>(3)</sup>	250 <sup>(3)</sup> / 315 <sup>(3)</sup>	400 <sup>(3)</sup> /630 <sup>(3)</sup>	800 <sup>(3)</sup> / 800 <sup>(3)</sup>	800/800 <sup>(3)</sup>	1000 <sup>(3)</sup> / 1000 <sup>(3)</sup>

### Operational power in AC-23 (kW)

At 400 VAC without pre-break in AC <sup>(1)(4)</sup>	132/132	160/160	220/220	355/355	450/450	450/450	560/560
At 690 VAC without pre-break in AC <sup>(1)(4)</sup>	220/220	220/295	220/295	295/400	400/400	400/400	400/475

### Reactive power (kvar)

At 400 VAC <sup>(4)</sup>	115	145	185	290	365	355	460
---------------------------	-----	-----	-----	-----	-----	-----	-----

### Fuse protected short-circuit withstand (kA rms prospective)

Prospective short-circuit (kA rms) <sup>(5)</sup>	80/100	80/-	80/50	80/100	80/100	-/100	-/100
Associated fuse rating (A) <sup>(5)</sup>	250/250	315/-	400/400	630/630	800/800	-/800	-/1250

### Short-circuit capacity

Rated peak withstand current (kA peak) <sup>(5)</sup>	32.5	40	40	70	80	80	90
---	------	----	----	----	----	----	----

### Fuse selection (maximum fuse size)\*\*

SOCOMECS BS88	6B20 0250	6B30 0315	6B40 0400	6C20 0630	6C30 0800		
SOCOMECS BS88	6B2M 3015	6B3M 0400	6B4M 0500				
SOCOMECS DIN	6712 0250		6722 0400	6732 0400		6746 0800	6746 1200
SOCOMECS DIN	6713 0250		6723 0400	6733 0400		6747 0800	6747 1200
BUSSMANN	ED 250	ED 315	ED 400	FF 630	GF 800		
BUSSMANN	DD 200M315	ED 315M400	ED 400M500				
LAWSON	TKF 250	TKF 315	TMF 400	TTM 630	TLM 800		
LAWSON	TF 200M315	TKF 315M400	TMF 400M500				
GE	TKF 250	TKF 315	TMF 400	TTM 630	TLM 800		
GE	TF 200M315	TKF 315M355	TMF 400M450				

### Connection

Minimum Cu cable cross-section (mm <sup>2</sup> )	95	185	185	2 x 150	2 x 185		
Maximum Cu cable cross-section (mm <sup>2</sup> )	240	240	240	2 x 300	2 x 300	4 x 185	4 x 185
Maximum busbar width (mm)	32	45	45	63	63	80	80
Tightening torque min (Nm)	20/26	20/26	20/26	40/45	40/45	40/45	40/45

### Mechanical characteristics

Durability (number of operating cycles)	10 000	10 000	10 000	8 000	8 000	5 000	5 000
Weight of 3 P switch (kg)	3.2	4.8	4.8	16	17	25	25
Weight of 4 P switch (kg)	4.5	6.1	6.1	20	21.5	30	30
Weight of 1 P extra (kg)	1.3	1.3	1.3			3	3
Frame pitch (mm)	60	66	66	94	94	120	120

(1) Category with index A = frequent operation - Category with index B = infrequent operation.

(2) With terminal shrouds or terminal screen.

(3) 4-pole device with 2 pole in series by polarity.

(4) The power value is given for information only, the current values vary from one manufacturer to another.

(5) For a rated operational voltage  $U_n = 400$  VAC.

\* 400 A direct operation switch.

\*\* Please ensure that fuse let through current does not exceed short-circuit capacity of the switch (kA peak).




## Dimensions


### External operation

NFC and DIN CD 25 to CD 32 A in size 10 x 38

External front operation

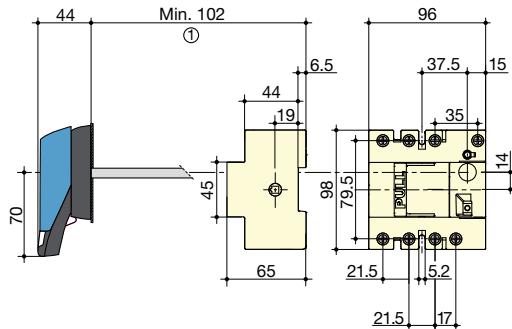


External side operation

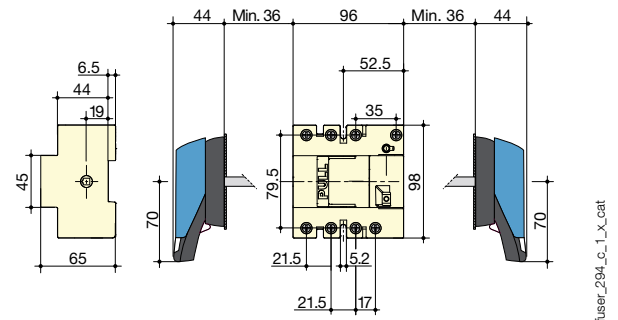


BS88 CD 20 to CD 32 A in size A1 - NFC and DIN 32 A in size 14 x 51

External front operation

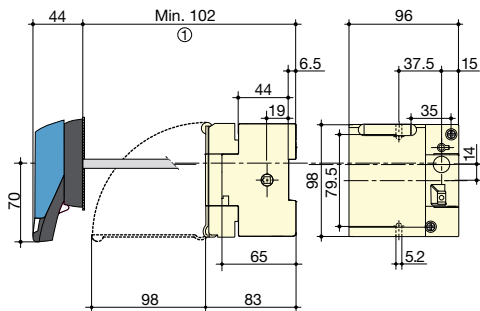


External side operation

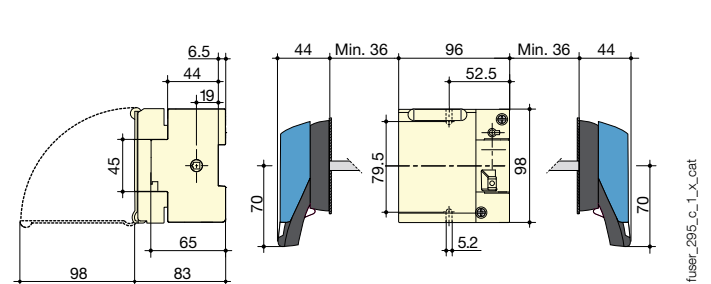

1. With 1 U-type AC: 130 mm.  
With 2 U-type AC: 155 mm.

BS88 CD 20 to CD 32 A in size A1 - NFC and DIN 25 to 32 in size 10 x 38 and 14 x 51

External front operation fuse combination changeover


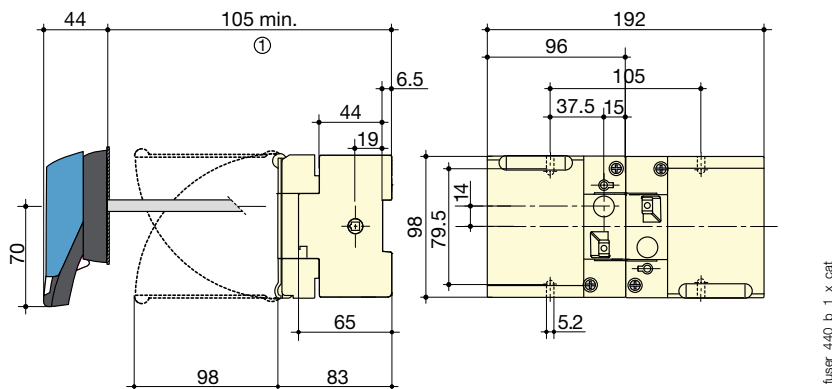


1. With 1 U-type AC: 130 mm.  
With 2 U-type AC: 155 mm.

## Dimensions (continued)

### External operation


BS88 32 to 250 A - NFC and DIN 50 to 250 A

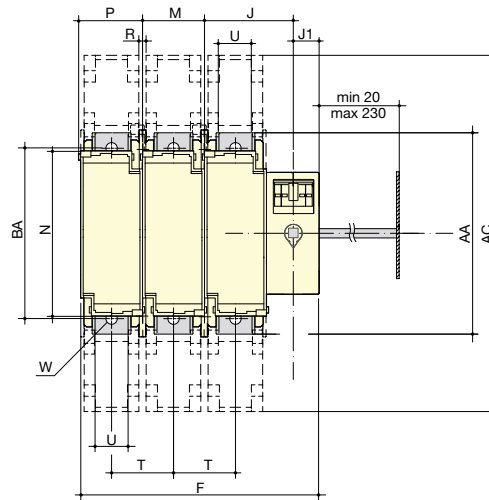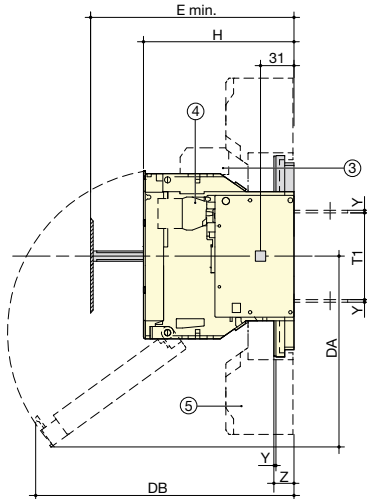

1. Position TEST.
2. Rear connection (option)
3. 1 or 2 CA type DDMM
4. 1 or 8 CA NO/NC pre-break.
5. Terminal shrouds.




Rating (A)	NFC/DIN Fuse size	BS88 Fuse size	Frame size	Overall dimensions E min	Terminal shrouds AC	Switch body								Switch mounting				Connection							
						F 3p.	F 4p.	H	J	J1	BC	DA	DB	M	N	P	R	T	T1	U	W	Y	Z	AA	BA
32		A1	11	100	-	121	148	87	45	18	70	85	153	27	106	31	6	27	59	12	-	2	-	118	-
50	14 x 51	-	11	100	-	121	148	87	45	18	70	85	153	27	106	31	6	27	59	12	-	2	-	118	-
63	00C	A2-A3	12	125	-	136	168	116	50	18	70	159	145	32	106	36	5.4	32	59	12	-	2	-	118	-
100	22x58	A4	13	135	268	148	184	116	54	18	125	141	187	36	127	40	5.4	36	62	20	8.5	2.5	19.5	162	141
125	22x58	-	13	135	268	148	184	116	54	18	125	141	179	36	127	40	5.4	36	62	20	8.5	2.5	19.5	162	141
125	00	-	13	135	268	148	184	126	54	18	125	141	193	36	127	40	5.4	36	62	20	8.5	2.5	19.5	162	141
160	00	-	13	135	268	148	184	126	54	18	125	141	193	36	127	40	5.4	36	62	20	8.5	2.5	19.5	162	141
CD 160 CD 200	-	A3-A4	13A	145	268	148	184	139	54	18	125	141	-	36	130	40	5.4	36	78	18	8.5	3	20	162	141
160	0	A4-B1-B2	14	145	268	190	240	136	64	18	125	174	229	50	140	54	5.4	50	62	20	8.5	2.5	19.5	162	141
200	-	B1-B2	15	154	345	234	294	146	86	25	125	185	251	60	162	64	6.4	60	84	32	11	2.5	19.5	195	166
250	1	B1-B2-B3	15	154	345	234	294	146	86	25	125	185	251	60	162	64	6.4	60	84	32	11	2.5	19.5	195	166

BS88 315 to 400 A (size B1-B2-B3-B4) - DIN 400 A (size 2)

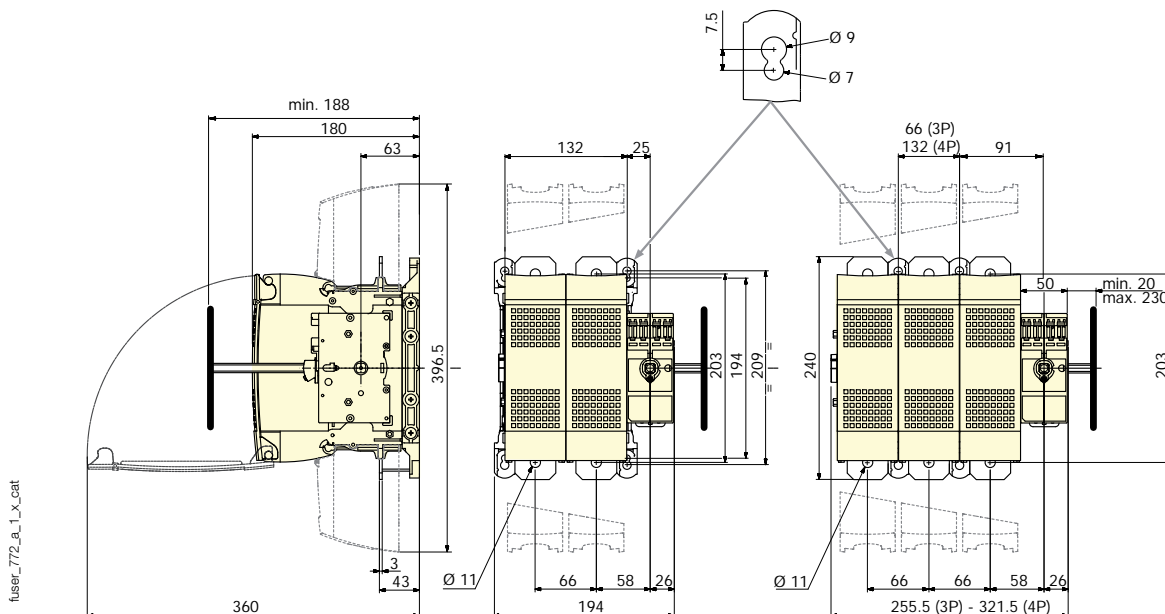

## BS88 - External front operation fuse combination changeover

32 to 400 A

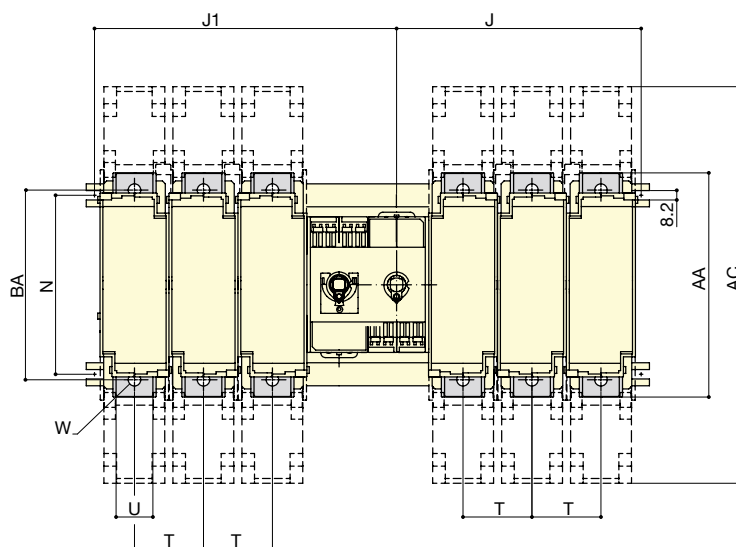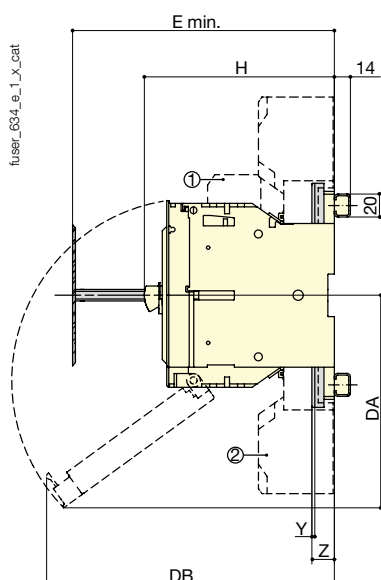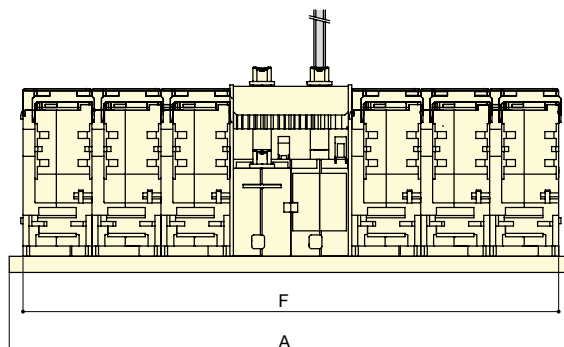

A. S1 handle: 32 and 63 A  
B. S1 handle: 100 to 400 A  
C. Door drilling

1. Fuse blown indication not available for BS88  
2. Terminal shrouds

Rating (A)	Fuse size	Frame size	Dimensions				Terminal shrouds	Switch body								Switch mounting	Connection							
			A 3 P	A 4 P	E min	E max		AC	F 3 P	F 4 P	H	J 3 P	J 4 P	J1 3 P	J1 4 P		DA	DB	N	T	U	W	Y	Z
32	A1	11	264	318	100 <sup>(1)</sup>	146 <sup>(1)</sup>		242	296	87	102	129	138	165	85	153	90	27					118	
63	A2-A3	12	294	358	124	145		272	336	116.5	121	153	157	189	159	145	90	32					118	
100	A4	13	318	390	124	145	268	296	368	116 <sup>(2)</sup>	133	169	169	205	141	179	128	36	20	8.5	2.5	19.5	162	141
CD 160	A3-A4	13 A	318	390	145	225	268	296	368	139	133	169	169	205			128	36	18	8.5	3	20	162	141
160	A4	14	402	502	124	225	268	380	480	136.5	176	226	212	262	174	229	128	50	20	8.5	2.5	19.5	162	141
160	B1-B2	14	402	502	130	225	268	380	480	136.5	176	226	212	262	174	229	128	50	20	8.5	2.5	19.5	162	141
CD 200	A3-A4	13 A	318	390	145	225	268	296	368	139	133	169	169	205			128	36	18	8.5	3	20	162	141
200	B1-B2	15	490	610	130	225	345	468	588	146	213	273	263	323	185	251	155	60	32	11	2.5	19.5	195	166
250	B1-B2-B3	15	490	610	154	225	345	468	588	146	213	273	263	323	185	251	155	60	32	11	2.5	19.5	195	166
315	B1-B2-B3	16	526	658	154	225	355	504	636	149	231	297	281	347	200	260	168	66	50	11	3	20	205	175
400	B1-B2-B3-B4	16	526	658	157	225	355	504	636	149	231	297	281	347	200	260	168	66	50	11	3	20	205	175

(1) 1 AC: + 23.5 mm / 2 AC: + 47 mm.  
(2) 132 mm with 2 AC.

# FUSERBLOC


Fuse combination switches

for industrial fuses up to 1250 A

## Dimensions (continued)

NFC and DIN - External front operation fuse combination changeover

50 to 400 A

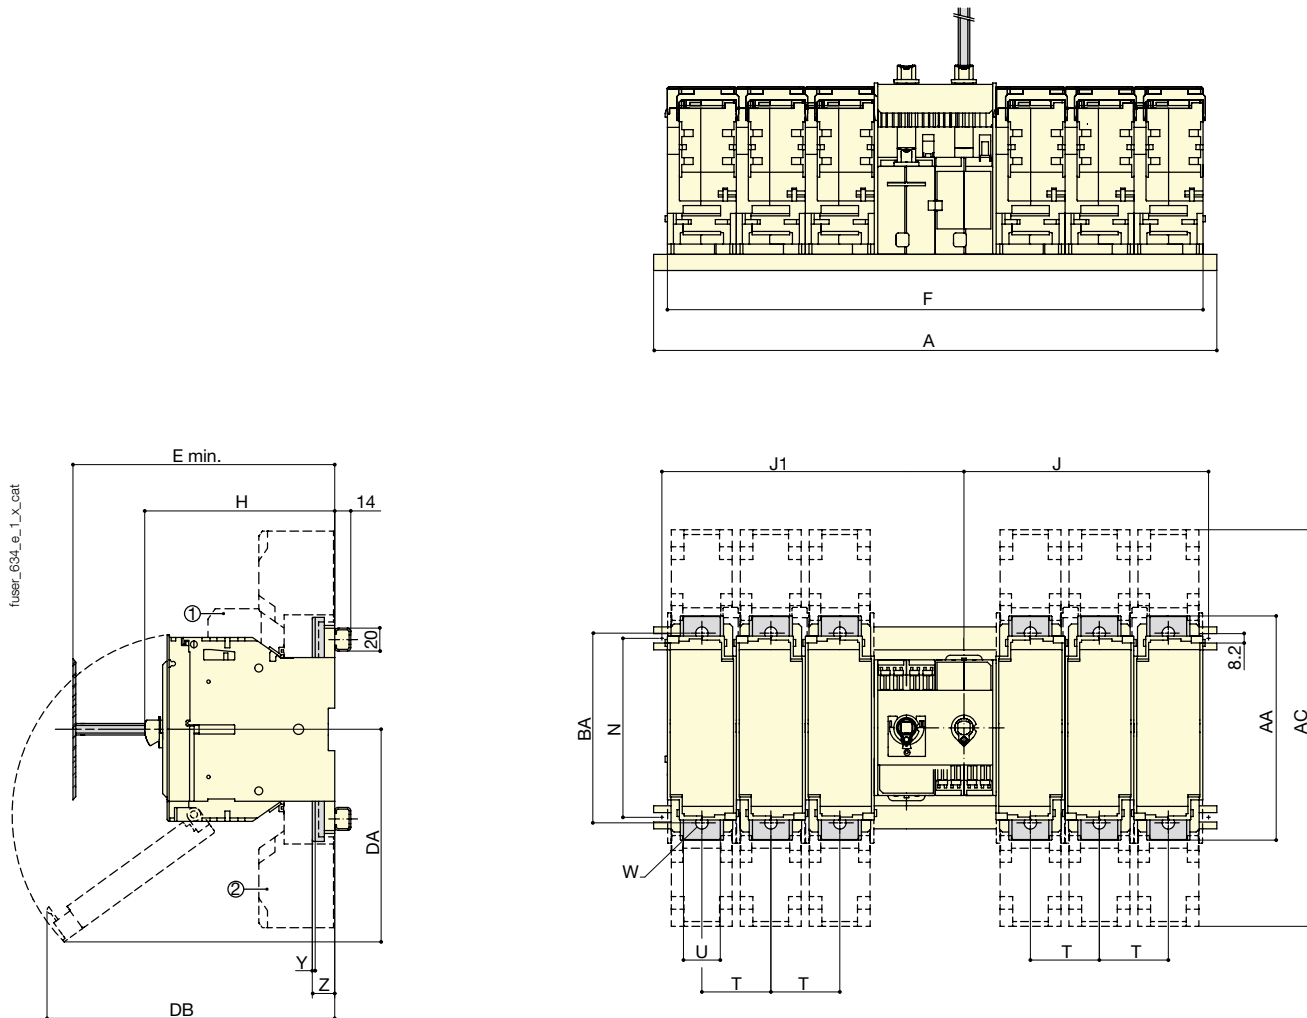

A. S1 handle: 50 and 63 A  
B. S2 handle: 100 to 400 A  
C. Door drilling


1. Fuse blown indication not available for BS88  
2. Terminal shrouds

Rating (A)	Fuse size	Frame size	Overall dimensions				Terminal shrouds	Switch body								Switch mounting	Connection							
			A 3p	A 4p	E min	E max		AC	F 3 P	F 4 P	H	J 3 P	J 4 P	J1 3 P	J1 4 P		DA	DB	N	T	U	W	Y	Z
50	14 x 51	11	264	318	100 <sup>(1)</sup>	146 <sup>(1)</sup>		121	148	87 <sup>(1)</sup>	102	129	138	165	85	153	90	27					118	
63	00C	12	294	358	125	145		136	168	116.5 <sup>(2)</sup>	121	153	158	189	159	145	90	32					118	
100	22 x 58	13	318	390	135	145	268	148	184	116 <sup>(2)</sup>	133	169	169	205	141	187	128	36	20	8.5	2.5	19.5	162	141
125	22 x 58	13	318	390	135	145	268	148	184	116 <sup>(2)</sup>	133	169	169	205	141	179	128	36	20	8.5	2.5	19.5	162	141
125	00	13	318	390	135	145	268	148	184	126.5	133	169	169	205	141	193	128	36	20	8.5	2.5	19.5	162	141
160	00	13	318	390	135	145	268	148	184	126.5	133	169	169	205	141	193	128	36	20	8.5	2.5	19.5	162	141
160	0	14	402	502	145	225	268	190	240	136.5	176	226	212	262	174	229	128	50	20	8.5	2.5	19.5	162	141
250	1	15	490	610	154	225	345	234	294	146	213	273	263	323	185	251	155	60	32	11	2.5	19.5	195	166
400	2	16	526	658	157	225	355	252	318	149	231	297	281	347	200	260	168	66	50	11	3	20	205	175


(1) 1 AC: +23.5 / 2 AC: +47  
(2) 132 with 2 AC

## Direct operation

NFC CD 25 to CD 32 A in frame size 0 / fuse size 10 x 38

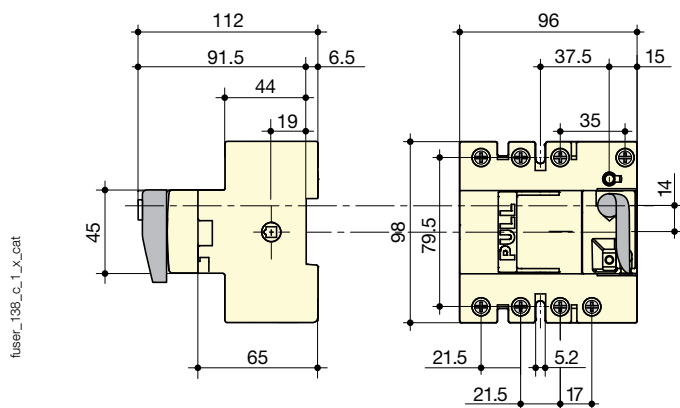



BS88 CD 20 to CD 32 A in frame size 0 / fuse size A1 - NFC CD 32 A in frame size 0 / fuse size 14 x 51

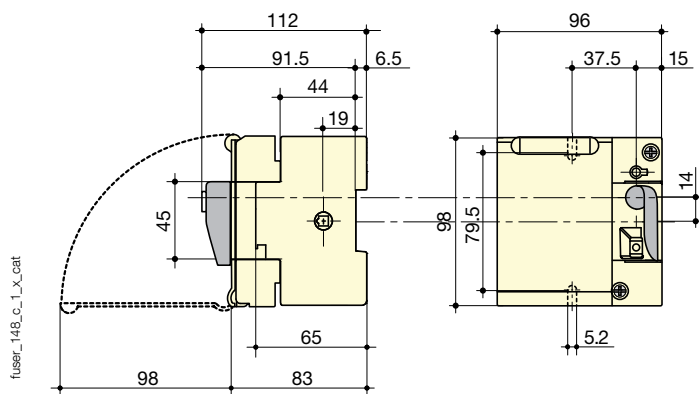

## Dimensions (continued)

### Direct operation (continued)

BS88 32 to 400 A - NFC and DIN 50 to 400 A

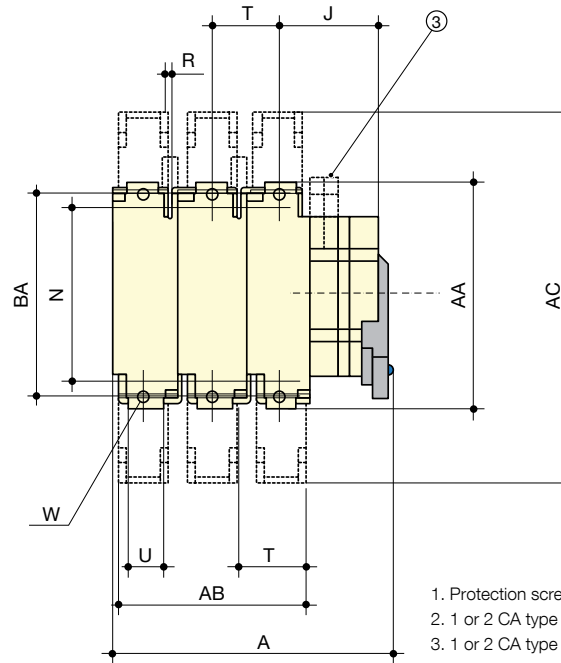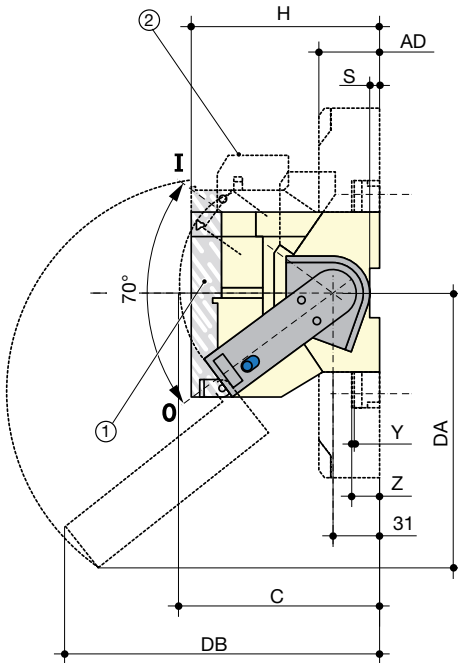


1. Protection screen lockable in position I
2. 1 or 2 CA type DDMM
3. 1 or 2 CA type A

fuser\_064\_b\_1\_x\_cat

				Overall dimensions			Terminal shrouds				Switch body				Switch mounting			Connection							
Rating (A)	NFC/DIN Fuse size	BS88 Fuse size	Frame size	A 3p.	A 4p.	C	AB 3p.	AB 4p.	AC	AD	H	J	DA	DB	N	R	S	T	U	W	Y	Z	AA	BA	
32	-	A1	1	118	145	134	-	-	-	-	87	33.5	-	-	106	5.4	6.5	27	-	-	-	-	118	-	
50	14 x 51	-	1	118	145	134	-	-	-	-	87	33.5	-	-	106	5.4	6.5	27	-	-	-	-	118	-	
63	00C	A2-A3	2	133	165	134	-	-	-	-	116	36	159	145	106	5.4	6.5	32	-	-	-	-	118	-	
100	22 x 58	A4	3	150	186	173	108	144	268	44	116	38	-	-	127	5.4	-	36	20	8.5	2.5	19.5	162	141	
125	22 x 58	-	3	150	186	173	108	144	268	44	116	38	-	-	127	5.4	-	36	20	8.5	2.5	19.5	162	141	
125	00	-	3	150	186	173	108	144	268	44	126	38	141	193	127	5.4	-	36	20	8.5	2.5	19.5	162	141	
160	00	-	3	150	186	173	108	144	268	44	126	38	141	189	127	5.4	-	36	20	8.5	2.5	19.5	162	141	
CD 160	-	A3-A4	3A	152	188	173	108	144	268	44	139	38	-	-	130	5.4	-	36	20	8.5	3	19.5	162	141	
160	-	A4	4	150	186	173	108	144	268	44	116	38	-	-	127	5.4	4	50	20	8.5	2.5	19.5	162	141	
160	0	B1-B2	4	192	242	173	136	172	268	44	136	45	174	229	140	5.4	-	50	20	8.5	2.5	19.5	162	141	
CD 200	-	A3-A4	3A	152	188	173	108	144	268	44	139	38	-	-	30	5.4	-	36	20	8.5	3	19.5	162	141	
200	-	B1-B2	5	192	242	173	136	172	345	44	123	45	-	-	140	5.4	-	60	32	8.5	2.5	19.5	195	166	
250	1	B1-B2-B3	5	253	313	173	180	240	345	65	146	81	185	251	162	6.4	-	60	32	11	2.5	19.5	195	166	
315		B1-B2-B3	6	253	313	173	180	240	355	65	146	81	185	251	162	6.4	-	66	32	11	2.5	19.5	195	175	
400	2	B1-B2-B3-B4	6	271	337	173	192	258	355	65	149	86	200	260	172	6.4	-	66	50	11	3	20	205	175	

## External and direct operation

BS88 630 to 800 A - DIN 630 to 1250 A

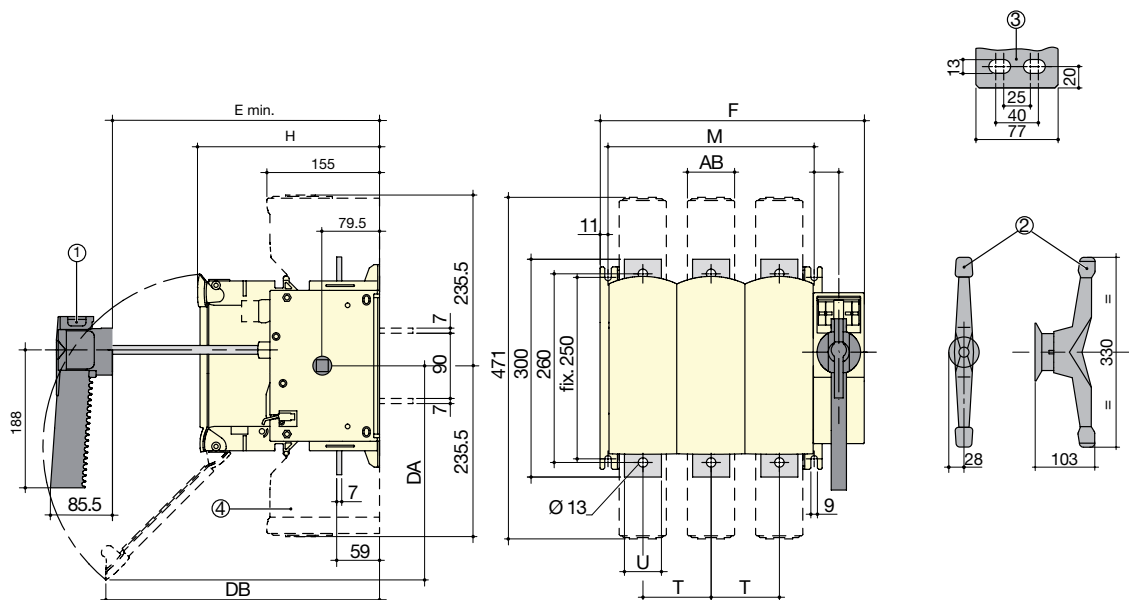

fuser\_415\_g\_1\_x\_cat

1. For handle frame size 17.
2. For handle frame size 18.
3. Connection terminals for frame size 18.
4. Terminal shrouds.

Rating (A)	DIN Fuse size	BS88 Fuse size	Frame size	Overall dimensions E min	Switch body					Switch mounting		Connection		Terminal shrouds AB
					F 3p.	F 4p.	H	DA	DB	M 3p.	M 4p.	T	U	
630	3	C1-C2	17	265	364	458	250	300	380	284	378	94	51	65
800	3	C1-C2-C3	17	265	364	458	250	300	380	284	378	94	51	65
800	4	-	18	304	442	562	289	355	295	362	482	120	77	88
1250	4	D1	18	304	442	562	289	355	295	362	482	120	77	88








# FUSERBLOC

Fuse combination switches






for industrial fuses up to 1250 A

## Dimensions for external operation handles






BS88 - 32 to 63 A - NFC and DIN - 25 to 63 A

Handle type	Front operation		Side operation	
	Direction of operation	Door drilling	Direction of operation	Door drilling
<b>S1 type</b> Box size 0 				






BS88 / NFC and DIN - 100 to 400 A

Handle type	Front operation		Side operation	
	Direction of operation	Door drilling	Direction of operation	Door drilling
<b>S2 type</b> Box size 11-16 				

BS88 / NFC and DIN - 630 to 800 A

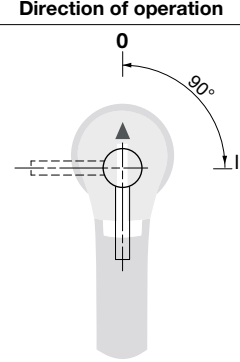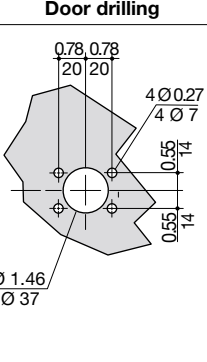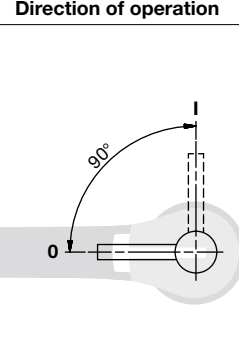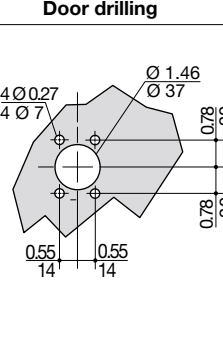Handle type	Front operation		Side operation	
	Direction of operation	Door drilling	Direction of operation	Door drilling
<b>S3 type</b> Box size 17 				

## BS88 / NFC and DIN - 800 to 1250 A

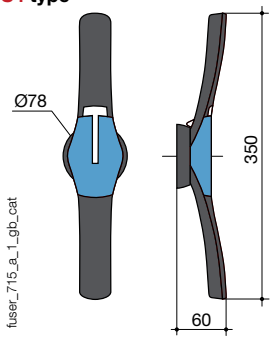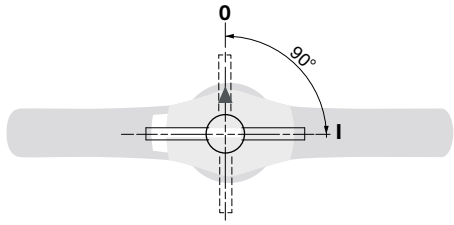Handle type	Front operation Direction of operation	Side operation Direction of operation	Door drilling
<b>S3 type</b> Box size 18 			
<b>S4 type</b> 			

SECTION  
12

APPENDIX F

PAINT SPECIFICATION:  
No. 704-60210

(PAINT PROCEDURE - 15 PAGES)



# IST POWER LTD

## PAINT APPLICATION AND PREPARATION PROCEDURE FOR LIQUID FILLED TRANSFORMERS FOR C4 (H) PROTECTION (>15 years)

---

### Quality Process Instruction

## Quick Guide

- a) All sharp edges and corners must be removed; welds dressed smooth, all welding spatter should be removed.
- b) All areas are to be thoroughly cleaned of any contamination before metal spraying or painting.
- c) The manufacturers paint datasheets form part of this specification and must be adhered to.
- d) Paint records must be taken

Circulation/storage
REFER TO "ISSUED DOCUMENT REGISTER" HELD BY COMPLIANCE

Ref: 704-60210 Issue: 1	Author: Peter Jones Approved for Issue: Peter Jones Date: 03/10/18	Change Ref: N/A
----------------------------	--	-----------------

IST Power Ltd	Title	Quality Process Instruction
---------------	-------	-----------------------------

## Safety

1. Review and adhere to all instructions contained in the company HSE Policies ref.GHI-001 & 002 (see company notice boards).
2. Review and adhere to all paint safety data sheet instructions referenced in this instruction (copies in COSHH folders)
3. PPE required: Full face respiratory mask, gloves, coveralls and safety footwear. Ensure no loose items of clothing or accessories.
4. Maintain a clean & tidy work area – remove potential trip hazards
5. Near Miss and HSE concerns must be reported by the “ARF” system, or directly to the Health & Safety Representative/Manager

## Scope

This specification covers the cleaning, preparation & preservation of ONAN & KNAN steel tanks for outdoor use in extreme weather conditions, and salt laden & heavily polluted environments.

## Summary of corrosion protection system

The corrosion protection of the steel components of the transformers will be as follows:

### *Interior*

- Blast clean
- 2 pack Epoxy paint

### *Exterior*

- Blast clean
- 2 pack Epoxy zinc phosphate/micaceous iron oxide primer
- 2 pack Acrylic Polysiloxane finish

The manufacturers paint datasheets form part of this specification.

During the painting process the manufacturer guidelines for mixing, spraying, curing/drying & over coating are to be followed.

## **Pre-blast clean inspection**

All sharp edges and corners must be removed; welds dressed smooth, all welding spatter should be removed.

All welds are to be dressed smooth in accordance with the ‘good’ standard of ISO 12944-3. All welds must be inspected for undercuts/irregularities and made good where necessary.

Ref: 704-60210 Issue: 1	Author: Peter Jones Approved for Issue: Peter Jones Date: 03/10/18	Page 1 of 4
----------------------------	--	-------------

IST Power Ltd	Title	Quality Process Instruction
---------------	-------	-----------------------------

## Exterior

### Blast clean

The exterior of the transformer tanks and conservators to be grit blasted to SA 2 1/2 of ISO 8501-1. Particular attention is to be made in hard to reach areas.

Mask stainless steel earth pads before blasting.

All areas are to be thoroughly cleaned of any contamination before metal spraying.

### Exterior Painting

A stripe coat is required on all edges, welds and hard to reach areas for all layers of paint.

#### Primer/Sealer

**Paint Manufacturer:** International

**Paint Type:** Two component epoxy primer

**Paint Description:** Intercure 200

**No of coats:** One

**Coat thickness:** 100 µm (minimum DFT)

**Colour:** Light Grey

**Drying Time:**

Temperature	Touch Dry	Hard Dry	Minimum
5° C	40 min	4.5 hours	3 hours
15° C	30 min	3 hours	2 hours
25° C	20 min	2 hours	1 hours
40° C	15 min	30 min	30 min

#### Finish coat

**Paint Manufacturer:** International

**Paint Type:** Two component acrylic polysiloxane

**Paint Description:** Interfine 979

**No of coats:** One

**Coat thickness:** 140 µm (minimum DFT)

**Colour:** Refer to tank fabrication drawing for Final Colour

**Drying Time:**

Temperature	Touch Dry	Hard Dry	Minimum
5° C	6 hours	8 hours	8 hours
15° C	4.5 hours	6 hours	6 hours
25° C	3 hours	4 hours	4 hours
40° C	1.5 hours	2.5 hours	2.5 hours

**Note: Minimum external dry film thickness is 240 microns**

Ref: 704-60210 Issue: 1	Author: Peter Jones Approved for Issue: Peter Jones Date: 03/10/18	Page 2 of 4
----------------------------	--	-------------

IST Power Ltd	Title	Quality Process Instruction
---------------	-------	-----------------------------

## Interior

### Blast Clean

The interior of the transformer tanks and conservators it to be grit blasted to SA 2 ½ of ISO 8501-1. All surplus grit and residue must be removed before painting.

Painting is to be carried out within four hours of grit blasting.

### Interior Painting

All of the transformer interior should be painted with Valspar 39,0009-50.

#### Interior paint

**Paint Manufacturer:** Valspar

**Paint Type:** Two component epoxy primer

**Paint Description:** Valspar

**No of coats:** One

**Coat thickness:** 40 µm (minimum DFT)

**Colour:** White

Temperature	Touch Dry	Hard Dry	Minimum
20° C		6 hours	6 hours

### Paint Repair Procedure

If the paint coating is damaged in any way, repairs must be done to the following procedure.

Using hand or mechanical means, rub down the affected area so that all paint coats are feathered towards the damaged area.

Clean down and thoroughly degrease.

Each coat of paint is to overlap the previous coat. Minimum film thicknesses are to be maintained.

All coats of paint are to be applied by brush.

Ref: 704-60210 Issue: 1	Author: Peter Jones Approved for Issue: Peter Jones Date: 03/10/18	Page 3 of 4
----------------------------	--	-------------



IST Power Ltd	Title	Quality Process Instruction
---------------	-------	-----------------------------

### Primer/Sealer

**Paint Manufacturer:** International

**Paint Type:** Two component epoxy primer

**Paint Description:** Intercure 200

**No of coats:** One

**Coat thickness:** 100 µm (minimum DFT)

**Colour:** Light Grey

**Drying Time:**

Temperature	Touch Dry	Hard Dry	Minimum
5°C	40 min	4.5 hours	3 hours
15°C	30 min	3 hours	2 hours
25°C	20 min	2 hours	1 hour
40°C	15 min	30 min	30 min

### Finish coat

**Paint Manufacturer:** International

**Paint Type:** Two component acrylic polysiloxane

**Paint Description:** Interfine 979

**No of coats:** One

**Coat thickness:** 140 µm (minimum DFT)

**Colour:** Refer to tank fabrication drawing for Final Colour

**Drying Time:**

Temperature	Touch Dry	Hard Dry	Minimum
5°C	6 hours	8 hours	8 hours
15°C	4.5 hours	6 hours	6 hours
25°C	3 hours	4 hours	4 hours
40°C	1.5 hours	2.5 hours	2.5 hours

**Note:** Minimum external dry film thickness is 240 microns

Ref: 704-60210 Issue: 1	Author: Peter Jones Approved for Issue: Peter Jones Date: 03/10/18	Page 4 of 4
----------------------------	--	-------------

**PRODUCT DESCRIPTION**

A two component epoxy zinc phosphate/micaceous iron oxide primer, formulated on proprietary polymer technology, which provides rapid cure and overcoating even under low temperature conditions.

A high solids, low VOC product.

**INTENDED USES**

As a primer for steelwork intended for use in a wide range of aggressive environments, including offshore, chemical and petrochemical plants, industrial buildings, pulp and paper mills, power plants and bridges.

Suitable for overcoating within 3 hours in most climatic conditions hence speeding up production and throughput in fabrication shops.

Can also be used on site as a rapid curing, maintenance coating.

**PRACTICAL INFORMATION FOR INTERCURE 200**

<b>Colour</b>	Buff, Red Oxide
<b>Gloss Level</b>	Matt
<b>Volume Solids</b>	67%
<b>Typical Thickness</b>	75-100 microns (3-4 mils) dry equivalent to 112-149 microns (4.5-6 mils) wet
<b>Theoretical Coverage</b>	8.90 m <sup>2</sup> /litre at 75 microns d.f.t and stated volume solids 358 sq.ft/US gallon at 3 mils d.f.t and stated volume solids
<b>Practical Coverage</b>	Allow appropriate loss factors
<b>Method of Application</b>	Airless Spray, Air Spray, Brush, Roller
<b>Drying Time</b>	

Temperature	Touch Dry	Hard Dry	Overcoating Interval with recommended topcoats	
			Minimum	Maximum
5°C (41°F)	40 minutes	4.5 hours	3 hours	Extended <sup>1</sup>
15°C (59°F)	30 minutes	3 hours	2 hours	Extended <sup>1</sup>
25°C (77°F)	20 minutes	2 hours	1 hour	Extended <sup>1</sup>
40°C (104°F)	15 minutes	30 minutes	30 minutes	Extended <sup>1</sup>

<sup>1</sup> See International Protective Coatings Definitions and Abbreviations

Maximum overcoating intervals are shorter when using polysiloxane topcoats. Consult International Protective Coatings for further details.

**REGULATORY DATA**

Flash Point	Part A 27°C (81°F); Part B 28°C (82°F); Mixed 27°C (81°F)		
Product Weight	1.60 kg/l (13.4 lb/gal)		
VOC	2.67 lb/gal (320 g/l) 213 g/kg	EPA Method 24 EU Solvent Emissions Directive (Council Directive 1999/13/EC)	
See Product Characteristics section for further details			



*Ecotech is an initiative by International Protective Coatings a world leader in coating technology to promote the use of environmentally sensitive products across the globe.*

**SURFACE  
PREPARATION**

All surfaces to be coated should be clean, dry and free from contamination. Prior to paint application all surfaces should be assessed and treated in accordance with ISO 8504:2000.

Oil or grease should be removed in accordance with SSPC-SP1 solvent cleaning.

**Abrasive Grit Blast Cleaning**

Abrasive grit blast clean to Sa2½ (ISO 8501-1:2007) or SSPC-SP6. If oxidation has occurred between blasting and application of Intercure 200, the surface should be reblasted to the specified visual standard.

Surface defects revealed by the blast cleaning process should be ground, filled, or treated in the appropriate manner.

A sharp, angular surface profile of 50-75 microns (2-3 mils) is recommended.

Intercure 200 is suitable for application to grit blast cleaned surfaces which were initially to the above standard but have been allowed to deteriorate under good shop conditions for up to 7-10 days. The surface may deteriorate to Sa2 standard but must be free from loose powdery deposits.

**Shop Primed Steel**

Weld seams and damaged areas should be grit blast cleaned to Sa2½ (ISO 8501-1:2007) or SSPC-SP6.

If the shop primer shows extensive or widely scattered breakdown overall grit sweep blasting may be necessary.

If the shop primer was applied over shot blasted surfaces, overall grit sweep blasting will be necessary prior to application of Intercure 200.

**APPLICATION**

Mixing	Material is supplied in two containers as a unit. Always mix a complete unit in the proportions supplied. Once the unit has been mixed it must be used within the working pot life specified. (1) Agitate Base (Part A) with a power agitator. (2) Combine entire contents of Curing Agent (Part B) with Base (Part A) and mix thoroughly with power agitator.			
Mix Ratio	3 part(s) : 1 part(s) by volume			
Working Pot Life	5°C (41°F) 6 hours	15°C (59°F) 3 hours	25°C (77°F) 2 hours	40°C (104°F) 45 minutes
Airless Spray	Recommended	Tip Range 0.43-0.53 mm (17-21 thou) Total output fluid pressure at spray tip not less than 176 kg/cm² (2503 p.s.i.)		
Air Spray (Pressure Pot)	Recommended	Gun DeVilbiss MBC or JGA Air Cap 704 or 765 Fluid Tip E		
Brush	Suitable - small areas only	Typically 50-75 microns (2.0-3.0 mils) can be achieved		
Roller	Suitable - small areas only	Typically 50-75 microns (2.0-3.0 mils) can be achieved		
Thinner	International GTA220 (or International GTA415)	Do not thin more than allowed by local environmental legislation		
Cleaner	International GTA220	(or International GTA415)		
Work Stoppages	Do not allow material to remain in hoses, gun or spray equipment. Thoroughly flush all equipment with International GTA220. Once units of paint have been mixed they should not be resealed and it is advised that after prolonged stoppages work recommences with freshly mixed units.			
Clean Up	Clean all equipment immediately after use with International GTA220. It is good working practice to periodically flush out spray equipment during the course of the working day. Frequency of cleaning will depend upon amount sprayed, temperature and elapsed time, including any delays.			
	All surplus materials and empty containers should be disposed of in accordance with appropriate regional regulations/legislation.			

**PRODUCT  
CHARACTERISTICS**

Intercure 200 is preferred for use with systems for chemical environments where zinc based materials can be subject to attack in both acidic and alkaline conditions.

The maximum overcoating interval will be dependent upon the integrity of the exposed film. A film of 75 microns (3 mils) dry film thickness will normally be overcoatable after 6 months exposure provided it is adequately cleaned and any areas of mechanical damage repaired.

Over-application should be avoided as thick films will not be as good a substrate for topcoat adhesion after ageing as those at the specified thickness. When using as a blast holding primer avoid over-application as thick films may suffer from cohesive film splitting if subsequent coats are also over-applied.

Surface temperature must always be a minimum of 3°C (5°F) above dew point.

This product must only be thinned using recommended International thinners. The use of alternative thinners, particularly those containing ketones, can severely inhibit the curing mechanism of the coating.

Intercure 200 is capable of curing at temperatures below 0°C (32°F). However, this product should not be applied at temperatures below 0°C (32°F) where there is a possibility of ice formation on the substrate.

For further details regarding cure times and overcoatability, please contact International Protective Coatings.

This product is not available in pale and pastel shades due to a tendency to discolour rapidly. Additionally, in common with all epoxies Intercure 200 will chalk on exterior exposure. However, these phenomena are not detrimental to anti-corrosive performance.

In C1 and C2 corrosive environments (ISO 12944) it is possible to repair weld seams and small damaged areas via hand or power tool cleaning. Consult International Protective Coatings for more information.

Intercure 200 is not intended for use as a primer for steelwork which may be subjected to immersion conditions.

Intercure 200 can also be used as a primer for substrates other than blasted steel, e.g. stainless steel, alloys, etc. Consult International Protective Coatings for further details.

Absolute measured adhesion of topcoats to aged Intercure 200 is less than that to fresh material, however, it is adequate for the specified end use.

Note: VOC values quoted are based on maximum possible for the product taking into account variations due to colour differences and normal manufacturing tolerances.

Low molecular weight reactive additives, which will form part of the film during normal ambient cure conditions, will also affect VOC values determined using EPA Method 24.

**SYSTEMS  
COMPATIBILITY**

Intercure 200 will normally be applied to suitably prepared steel, e.g. blast cleaned. However, if necessary, application over prefabrication blast primers can be performed. Consult International Protective Coatings for further details.

The following primers are recommended for Intercure 200:

Interzinc 22            (mist coat or tie coat may be required)\*

The following topcoats/intermediates are recommended for Intercure 200:

Intercure 420	Interseal 670HS
Interfine 979	Interthane 990
Intergard 475HS	Interzone 1000
Intergard 740	Interzone 954

For other suitable topcoats/intermediates, consult International Protective Coatings.

\*See relevant product data sheet for details.

**ADDITIONAL  
INFORMATION**

Further information regarding industry standards, terms and abbreviations used in this data sheet can be found in the following documents available at [www.international-pc.com](http://www.international-pc.com):

- Definitions & Abbreviations
- Surface Preparation
- Paint Application
- Theoretical & Practical Coverage

Individual copies of these information sections are available upon request.

**SAFETY  
PRECAUTIONS**

This product is intended for use only by professional applicators in industrial situations in accordance with the advice given on this sheet, the Material Safety Data Sheet and the container(s), and should not be used without reference to the Material Safety Data Sheet (MSDS) which International Protective Coatings has provided to its customers.

All work involving the application and use of this product should be performed in compliance with all relevant national, Health, Safety & Environmental standards and regulations.

In the event welding or flame cutting is performed on metal coated with this product, dust and fumes will be emitted which will require the use of appropriate personal protective equipment and adequate local exhaust ventilation.

If in doubt regarding the suitability of use of this product, consult International Protective Coatings for further advice.

PACK SIZE	Unit Size	Part A		Part B	
		Vol	Pack	Vol	Pack
	20 litre	15 litre	20 litre	5 litre	5 litre
	4 US gal	3 US gal	5 US gal	1 US gal	1 US gal
For availability of other pack sizes, contact International Protective Coatings.					
SHIPPING WEIGHT	Unit Size	Part A		Part B	
	20 litre	29.1 kg		5.3 kg	
	4 US gal	49.8 lb		8.8 lb	
STORAGE	Shelf Life	12 months minimum at 25°C (77°F). Subject to re-inspection thereafter. Store in dry, shaded conditions away from sources of heat and ignition.			

**Important Note**

*The information in this data sheet is not intended to be exhaustive; any person using the product for any purpose other than that specifically recommended in this data sheet without first obtaining written confirmation from us as to the suitability of the product for the intended purpose does so at their own risk. All advice given or statements made about the product (whether in this data sheet or otherwise) is correct to the best of our knowledge but we have no control over the quality or the condition of the substrate or the many factors affecting the use and application of the product. Therefore, unless we specifically agree in writing to do so, we do not accept any liability at all for the performance of the product or for (subject to the maximum extent permitted by law) any loss or damage arising out of the use of the product. We hereby disclaim any warranties or representations, express or implied, by operation of law or otherwise, including, without limitation, any implied warranty of merchantability or fitness for a particular purpose. All products supplied and technical advice given are subject to our Conditions of Sale. You should request a copy of this document and review it carefully. The information contained in this data sheet is liable to modification from time to time in the light of experience and our policy of continuous development. It is the user's responsibility to check with their local International Paint representative that this data sheet is current prior to using the product.*

Issue date: 07/07/2009

Copyright © AkzoNobel, 07/07/2009.

 International and all product names mentioned in this publication are trademarks of, or licensed to, AkzoNobel.

[www.international-pc.com](http://www.international-pc.com)

## Acrylic Polysiloxane

### PRODUCT DESCRIPTION

A patented (US 6,281,321 and EP 0 941290), high performance, two component, high solids inorganic hybrid finish which offers compliance to all current VOC legislation, and contains no free isocyanates.

Interfine 979 significantly improves upon the gloss and colour retention exhibited by typical polyurethane finishes as well as offering improvement in gloss and colour retention when compared to 1st generation epoxy modified polysiloxane finishes.

Interfine 979 also displays the same corrosion resistance and has enhanced mechanical properties when compared to traditional epoxy technology.

### INTENDED USES

Interfine 979 is part of International's premium range of polysiloxane finishes. It is designed to provide excellent long-term colour and gloss retention and provide extended lifetime to first maintenance when utilised as part of a high performance anti-corrosive system. Interfine 979 is intended for use in those market sectors where visual impact is important, and the need for a high standard of cosmetic appearance is required. These include high performance constructions such as bridges, offshore structures and tank farms in addition to general industrial and commercial steelwork where high levels of cosmetic performance are a key requirement.

The dual benefits of corrosion protection & high cosmetic appearance afforded by Interfine 979 mean that as well as exhibiting superior durability, this product also serves as an effective barrier coat similar to a traditional epoxy intermediate, and as such, allows a reduction in the total number of coats required from a multi-coat high performance system - saving application costs, and improving productivity during application.

### PRACTICAL INFORMATION FOR INTERFINE 979

<b>Colour</b>	Wide range via the Chromascan system			
<b>Gloss Level</b>	Gloss			
<b>Volume Solids</b>	76%			
<b>Typical Thickness</b>	100-150 microns (4-6 mils) dry equivalent to 132-197 microns (5.3-7.9 mils) wet			
<b>Theoretical Coverage</b>	6.10 m <sup>2</sup> /litre at 125 microns d.f.t and stated volume solids 244 sq.ft/US gallon at 5 mils d.f.t and stated volume solids			
<b>Practical Coverage</b>	Allow appropriate loss factors			
<b>Method of Application</b>	Airless Spray, Air Spray, Brush, Roller			
<b>Drying Time</b>				
			Overcoating Interval with recommended topcoats	
<b>Temperature</b>	<b>Touch Dry</b>	<b>Hard Dry</b>	<b>Minimum</b>	<b>Maximum</b>
5°C (41°F)	6 hours	8 hours	8 hours	Extended <sup>1</sup>
15°C (59°F)	4.5 hours	6 hours	6 hours	Extended <sup>1</sup>
25°C (77°F)	3 hours	4 hours	4 hours	Extended <sup>1</sup>
40°C (104°F)	1.5 hours	2.5 hours	2.5 hours	Extended <sup>1</sup>

<sup>1</sup> On other undercoats consult Interfine 979 Recommended Working Procedures or Interspec for specific details. The drying times quoted have been determined at the quoted temperature and 50% relative humidity. In warmer climates (>25°C (77°F)) and/or those that have a tendency for high relative humidity (>60%), an alternative curing agent is available which will allow improved product workability. See Product Characteristics.

### REGULATORY DATA

<b>Flash Point (Typical)</b>	Part A 32°C (90°F); Part B 55°C (131°F); Mixed 35°C (95°F)		
<b>Product Weight</b>	1.33 kg/l (11.1 lb/gal)		
<b>VOC</b>	1.81 lb/gal (218 g/l) 162 g/kg	EPA Method 24 EU Solvent Emissions Directive (Council Directive 1999/13/EC)	

See Product Characteristics section for further details

## Acrylic Polysiloxane

### SURFACE PREPARATION

All surfaces to be coated should be clean, dry and free from contamination. Prior to paint application all surfaces should be assessed and treated in accordance with ISO 8504:2000.

#### Primed Surfaces

Interfine 979 should always be applied over a recommended anti-corrosive coating scheme. The primer surface should be dry and free from all contamination and Interfine 979 must be applied within the overcoating intervals specified (consult the relevant product data sheet).

Areas of breakdown, damage etc., should be prepared to the specified standard (e.g. Sa2½ (ISO 8501-1:2007) or SSPC-SP10, Abrasive Blasting, or SSPC-SP11, Power Tool Cleaning) and patch primed prior to the application of Interfine 979.

#### Metallic Zinc Primed Surfaces

Ensure that the surface of the primer is clean, dry and free from contamination and zinc salts before application of Interfine 979. Ensure zinc primers are fully cured before overcoating.

### APPLICATION

Mixing	Material is supplied in two containers as a unit. Always mix a complete unit in the proportions supplied. Once the unit has been mixed it must be used within the working pot life specified. (1) Agitate Base (Part A) with a power agitator. (2) Combine entire contents of Curing Agent (Part B) with Base (Part A) and mix thoroughly with power agitator.			
Mix Ratio	4.00 part(s) : 1.00 part(s) by volume			
Working Pot Life	5°C (41°F)	15°C (59°F)	25°C (77°F)	40°C (104°F)
	3.5 hours	2.5 hours	2 hours	1.5 hours
Note: Pot life times are applicable to both curing agent grades.				
Airless Spray	Recommended	Tip Range 0.28-0.53 mm (11-21 thou) Total output fluid pressure at spray tip not less than 155 kg/cm² (2204 p.s.i.)		
Air Spray (Conventional)	Recommended	Gun	DeVilbiss MBC or JGA Air Cap 704 or 765 Fluid Tip E	
Brush	Suitable	Typically 50-75 microns (2.0-3.0 mils) can be achieved		
Roller	Suitable	Typically 50-75 microns (2.0-3.0 mils) can be achieved		
Thinner	International GTA007	Do not thin more than allowed by local environmental legislation		
Cleaner	International GTA007			
Work Stoppages	Do not allow material to remain in hoses, gun or spray equipment. Thoroughly flush all equipment with International GTA007. Once units of material have been mixed they should not be resealed and it is advised that after prolonged stoppages work recommences with freshly mixed units.			
Clean Up	Clean all equipment immediately after use with International GTA007. It is good working practice to periodically flush out spray equipment during the course of the working day. Frequency of cleaning will depend upon amount sprayed, temperature and elapsed time, including any delays.  All surplus materials and empty containers should be disposed of in accordance with appropriate regional regulations/legislation.			



## Acrylic Polysiloxane

### PRODUCT CHARACTERISTICS

**The detailed Interfine 979 Application Guidelines should be consulted prior to use.**

Level of sheen and surface finish are dependent on application method. Avoid using a mixture of application methods whenever possible. Best results in terms of gloss and appearance will always be obtained by conventional air spray application.

When applying Interfine 979 by brush or roller, it may be necessary to apply multiple coats to achieve the total specified system dry film thickness.

This product must only be thinned using recommended International thinners. The use of alternative thinners, particularly those containing alcohols and ketones, can severely inhibit the curing mechanism of the coating.

After mixing a slight exotherm may be noted, which is typical of this product and is a result of chemical reaction.

Pot life times must not be exceeded even though the material may be still liquid and appear useable. It is good working practice that application should commence with full unopened units of material. Due to the moisture sensitivity with partially filled units of the curing agent component, there is a danger of reaction with atmospheric moisture which could adversely affect the performance of the final coating film. This phenomenon will be more prominent in the faster drying grade of curing agent where mixed product surface skinning in the container may occur more readily, particularly in warmer climates and / or those with high humidity.

Surface temperature must always be a minimum of 3°C (5°F) above dew point.

When applying Interfine 979 in confined spaces ensure adequate ventilation.

Care must be taken when spray applying multiple coats of Interfine 979 to ensure that a continuous wet film is applied and a minimum dry film thickness of 100 microns (4 mils) is achieved. Failure to do so may result in pinholing which will detract from ultimate appearance and performance.

Interfine 979 will cure satisfactorily at relative humidities between 40% and 85%. Curing will be slower at lower humidities and faster at higher humidities.

Condensation occurring during or immediately after application may result in a matt finish and an inferior film.

When overcoating after weathering or ageing, ensure the coating is fully cleaned to remove all surface contamination such as oil, grease, salt crystals and traffic fumes, before application of a further coat of Interfine 979.

Premature exposure to ponding water will cause colour change, especially in dark colours and at low temperatures.

Absolute measured adhesion of topcoats to aged Interfine 979 is less than that to fresh material, however, it is adequate for the specified end use.

This product is not recommended for use in immersion conditions. When severe chemical or solvent splashing is likely to occur contact International Protective Coatings for information regarding suitability.

Note: VOC values are typical and are provided for guidance purpose only. These may be subject to variation depending on factors such as differences in colour and normal manufacturing tolerances.

Low molecular weight reactive additives, which will form part of the film during normal ambient cure conditions, will also affect VOC values determined using EPA Method 24.

#### Alternative Curing Agent

For improved product workability in warmer climates and / or those with high relative humidity.

The drying times quoted have been determined at the quoted temperature and 50% relative humidity.

Temperature	Touch Dry	Hard Dry	Overcoating Interval with recommended topcoats	
			Minimum	Maximum
5°C (41°F)	10 hours	24 hours	24 hours	Extended <sup>1</sup>
15°C (59°F)	6 hours	12 hours	12 hours	Extended <sup>1</sup>
25°C (77°F)	4 hours	8 hours	8 hours	Extended <sup>1</sup>
40°C (104°F)	2 hours	6 hours	6 hours	Extended <sup>1</sup>

<sup>1</sup> On other undercoats consult Interfine 979 Recommended Working Procedures or Interspec for specific details.

### SYSTEMS COMPATIBILITY

Interfine 979 can be applied over a limited range of primers and intermediates.

Suitable primers are:

Intercure 200	Intercure 200HS
Interzinc 52	Interplus 356
Interzinc 315	Interzinc 22
Interzinc 52HS	

Suitable intermediates are:

Intercure 420	Intergard 475HS
Interseal 670HS	Interzone 505
Interzone 954	

Interfine 979 must not be applied directly over Interzinc 52 low temperature grade cure (EPA176).

Absolute maximum overcoating intervals with Interfine 979 are dependent upon primer/intermediate. Interfine 979 Recommended Working Procedures must be consulted prior to use.

Interfine 979 should only be overcoated with itself.

## Acrylic Polysiloxane

### ADDITIONAL INFORMATION

Further information regarding industry standards, terms and abbreviations used in this data sheet can be found in the following documents available at [www.international-pc.com](http://www.international-pc.com):

- Definitions & Abbreviations
- Surface Preparation
- Paint Application
- Theoretical & Practical Coverage
- Interfine 979 Application Guidelines

Individual copies of these information sections are available upon request.

### SAFETY PRECAUTIONS

This product is intended for use only by professional applicators in industrial situations in accordance with the advice given on this sheet, the Material Safety Data Sheet and the container(s), and should not be used without reference to the Material Safety Data Sheet (MSDS) which International Protective Coatings has provided to its customers.

All work involving the application and use of this product should be performed in compliance with all relevant national, Health, Safety & Environmental standards and regulations.

In the event welding or flame cutting is performed on metal coated with this product, dust and fumes will be emitted which will require the use of appropriate personal protective equipment and adequate local exhaust ventilation.

If in doubt regarding the suitability of use of this product, consult International Protective Coatings for further advice.

PACK SIZE	Unit Size	Part A		Part B	
		Vol	Pack	Vol	Pack
	20 litre	16 litre	20 litre	4 litre	5 litre
	5 US gal	4 US gal	5 US gal	1 US gal	1 US gal
For availability of other pack sizes, contact International Protective Coatings.					
SHIPPING WEIGHT (TYPICAL)	Unit Size	Part A		Part B	
	20 litre	24.3 kg		4.4 kg	
	5 US gal	49.6 lb		8.8 lb	
STORAGE	Shelf Life	Part A: 12 months minimum at 25°C (77°F).			
		Part B: 6 months minimum at 25°C (77°F). Subject to re-inspection thereafter. Store in dry, shaded conditions away from sources of heat and ignition.			

### Important Note

*The information in this data sheet is not intended to be exhaustive; any person using the product for any purpose other than that specifically recommended in this data sheet without first obtaining written confirmation from us as to the suitability of the product for the intended purpose does so at their own risk. All advice given or statements made about the product (whether in this data sheet or otherwise) is correct to the best of our knowledge but we have no control over the quality or the condition of the substrate or the many factors affecting the use and application of the product. Therefore, unless we specifically agree in writing to do so, we do not accept any liability at all for the performance of the product or for (subject to the maximum extent permitted by law) any loss or damage arising out of the use of the product. We hereby disclaim any warranties or representations, express or implied, by operation of law or otherwise, including, without limitation, any implied warranty of merchantability or fitness for a particular purpose. All products supplied and technical advice given are subject to our Conditions of Sale. You should request a copy of this document and review it carefully. The information contained in this data sheet is liable to modification from time to time in the light of experience and our policy of continuous development. It is the user's responsibility to check with their local representative that this data sheet is current prior to using the product.*

*This Technical Data Sheet is available on our website at [www.international-marine.com](http://www.international-marine.com) or [www.international-pc.com](http://www.international-pc.com), and should be the same as this document. Should there be any discrepancies between this document and the version of the Technical Data Sheet that appears on the website, then the version on the website will take precedence.*

Copyright © AkzoNobel, 05/02/2015.

All trademarks mentioned in this publication are owned by, or licensed to, the AkzoNobel group of companies.

**[www.international-pc.com](http://www.international-pc.com)**

## Informacja techniczna

### EP-farba do gruntowania

Nr art. 39,0009-50

Ausgabe 06/04

Rev. 2

Nr art. 588.33.99 utwardzacz

390009-50

Sch

**Charakterystyka:** Dwuskładnikowa farba epoksydowa, zawierająca rozcieńczalnik organiczny, schnąca na powietrzu i w suszarce. Nie zawiera chromu i ołowiu..

**Zastosowanie:** Farba gruntująca dla konstrukcji żelaznych i stalowych, dla odpowiedzialnych systemów antykorozyjnych oraz jako warstwa gruntująca dla powierzchni ocynkowanych takich jak: kadzie transformatorów, pokrywy, konserwatory i radiatory.

Farba EP Art. nr. 39,009 – 50 została dopuszczona przez Firmy ABB i ALSTOM do malowania powierzchni wewnętrznych transformatorów.

#### Dane techniczne:

Wszystkie dane dotyczą farby zmieszanej z utwardzaczem (art. nr. 588.33.99 ) w stosunku wagowym 5:1. Dane określone zostały dla warunków znormalizowanych, 20°C i 65% wilgotności względnej.

#### Nr art.

**39,0009-50**

Kolor

biały

Stosunek mieszania, wagowy

5:1

		Prüfnormen nach DIN	
Gęstość	(g/cm <sup>3</sup> )	53217	1,45
Zawartość części stałych	(%)	53216	ca. 68
Objętość części stałych	(cm <sup>3</sup> / kg)	53219	ca. 330
Objętość części stałych	(%)	53219	ca. 48
Wydajność teoretyczna przy 40 µm	(m <sup>2</sup> / kg)	55945	ca. 8,5
Lepkość		53219	strukturalna
Czas schnięcia przy 20 °C i 40 µm grubości warstwy suchej:			
Stopień 1		53150	po 20 minutach
Stopień 4		53150	po 5 godzinach
Stopień 6		53150	po 6 godzinach

Do zestawów z farbami „Valspar“:

EP, EPW, PUR, ACN

Osagalna grubość powłoki: polewanie  
natrysk

40 µm  
80 µm

Odporność na temp. -suche powietrze

do 150 °C

Max. czas magazynowania

12

Rozcieńczalnik specjalny : Art. nr.

39.0410

## Wskazówki dotyczące przygotowania:

**Powierzchni:** Najlepiej metodą strumienio-ścierną wg. DIN 55928 część 4, stopień czystości Sa 2,5 - 3. Należy zachować uśrednioną wysokość nierówności  $R_z$ , zgodnie z normą DIN 4768 część 1 lub DIN ISO 8503 część 1. Im większa jest wysokość nierówności, tym grubsza musi być warstwa powłoki malarskiej, tak aby osiągnąć tzw. „wystarczające pokrycie wierzchołków nierówności powierzchni”. Trwałość ochrona warstwy malarskiej zależy w znacznej mierze od dokładności przygotowania podłoża przed malowaniem.

**Farby:** w razie potrzeby należy używać rozcieńczalnika art.-nr. 39.0410:

Nakładanie pędzlem	Bez rozcieńczania. Tylko w wyjątkowych przypadkach
Natrysk metodą powietrzną	Ustawić odpowiednią lepkość farby przez dodanie 10- 20 % rozcieńczalnika. Dysza 1,5 - 1,8 mm / ciśnienie powietrza 4-5 bar
Natrysk Airless	Lepkość dostawcza. Rozcieńczać tylko w wyjątkowych przypadkach. Dysza 0,43-0,55 mm / kąt natrysku 40° (w zależności od wielkości obiektu), ciśnienie natrysku 150-200 bar.
Natrysk Airmix, Air-Coat	Lepkość dostawcza, ewentualnie ustawić odpowiednią lepkość farby przez dodanie 3 – 10 % rozcieńczalnika, dysza 0,28 – 0,45 mm / kąt natrysku 20 - 65° (w zależności od wielkości obiektu), ciśnienie natrysku 50 - 100 bar; ciśnienie powietrza wspomagającego 1-4 bar.
Czas przydatności zmieszanych składników przy 20 °C	około 12 godzin, w zbiorniku do polewania max. 8 godzin!
Temperatura pracy	min +5 °C!
Temp.obiektu / wilg.wzgl.	min +3 °C powyżej punktu rosy / max. 85 %!

**Uwagi:** Minimalny czas konieczny do nałożenia farby nawierzchniowej na bazie PUR lub ACN wynosi:

16 godz. przy 20 °C temp. obiektu      2 godz. przy 40 °C temp. obiektu,      1 godz. przy 60 °C temp. obiektu.

Nałożenie farby nawierzchniowej EP, przy temp. obiektu 20 °C, możliwe jest najwcześniej:

-przy grubości warstwy suchej 40µm po 4 godz.,      -przy grubości warstwy suchej 80µm po 8 godz.

Przy temperaturach +5,+10 °C należy stosować "szybki" utwardzacz Art.nr. 39,0809

**Grubość powłoki suchej przy malowaniu wnętrza transformatora nie może przekraczać 80 µm**

### Przykładowy zestaw warstw malarskich:

Farbą EP można kilkakrotnie przemalowywać powierzchnię gruntowaną.

np.: farba do gruntowania EP biała	nr art. 39,0009-50	
farba międzywarstwowa EP	nr art. 39,0075 -50	
farba nawierzchniowa ACN	nr art. 41, 7633	lub
farba do gruntowania EP biała	nr art. 39,0009-50	
farba międzywarstwowa EP z mika	nr art. 39,0915-F	
farba nawierzchniowa ACN	nr art. 41,7633	

Do malowania nawierzchniowego można stosować wszystkie farby - wymienione w pozycji na stronie pierwszej - Do zestawów z farbami „Valspar”-

Dane techn. dot. farby międzywarstwowej i nawierzchniowej zawarte są w odrębnych informacjach.

<b>Dane bezpieczeństwa:</b>	<b>farba bazowa: 39,0009-50</b>	<b>utwardzacz: 588.33.99</b>
Temperatura zapłonu	24°C	24 °C
Klasa zagrożenia wg VbF	nie dotyczy	A II
Przepisy transportowe wg ADR/RID	patrz nadruk na opakowaniu lub „Karta danych bezpieczeństwa”	
Znakowanie wg EWG 88/379	patrz nadruk na opakowaniu lub „Karta danych bezpieczeństwa”	

**Środki bezpieczeństwa:** Przy stosowaniu produktu należy zachować wszelkie środki ostrożności obowiązujące w odniesieniu do materiałów malarskich, wynikające z „Karty danych bezpieczeństwa”. Są to np.: „Przepisy dot. zapo-biegania nieszczęśliwym wypadkom” VBG 23, Branżowego Stowarzyszenia Przemysłu Chemicznego.

Niniejsza publikacja unieważnia wszystkie wcześniejsze wersje Informacji Technicznej dot. w/w farby.

### UWAGA:

Pisemne lub ustne zalecenia techniczno-aplikacyjne dot. naszych produktów, przekazywane jako pomoc naszym Klientom, nie są zobowiązujące i nie stanowią podstawy do jakichkolwiek dodatkowych roszczeń z tytułu zawarcia umowy kupna. Zalecenia te opracowane zostały zgodnie z naszymi doświadczeniami i zgodnie z aktualnym stanem wiedzy naukowej i praktycznej. Nie zwalniają one Kupującego od samodzielnej kontroli przydatności naszego produktu do przewidzianego zastosowania. Ponadto obowiązują nasze ogólne warunki dostaw i płatności.

# iST POWER